
NORTEK™
AIR SOLUTIONS
CLEANPAK

CLEAN-TRAK TOP-LOAD FLUSH CEILING SYSTEM

The CLEANPAK cleanroom filtered ceiling system with continuous grid in both directions features powder coated extruded aluminum grid channels, integrated lighting, integrated sprinkler system, associated connectors, grid hanging all-thread rod from grid to turnbuckle, filters, and accessories such as filter dampers, blank pans, return air grilles, clips, and miscellaneous hanging hardware and clips for wall head track and grid face hanging support. The system enables up to full filter coverage by moving the lighting out of the grid opening and placing it in a linear grid channel. It allows full flexibility in cleanroom, wall, equipmment, and track layouts. Filters and components can be top loaded or loaded from the bottom by tipping the component through the grid opening. The ceiling fully integrates with air movement devices for complete systems like fan tunnel systems with RAHs on top of plenum, remote RAHs ducted to filters in grid, remote RAHs pressurizing interstitial, end blower modules, vertical side blower modules, or FFUs in grid or plenum.

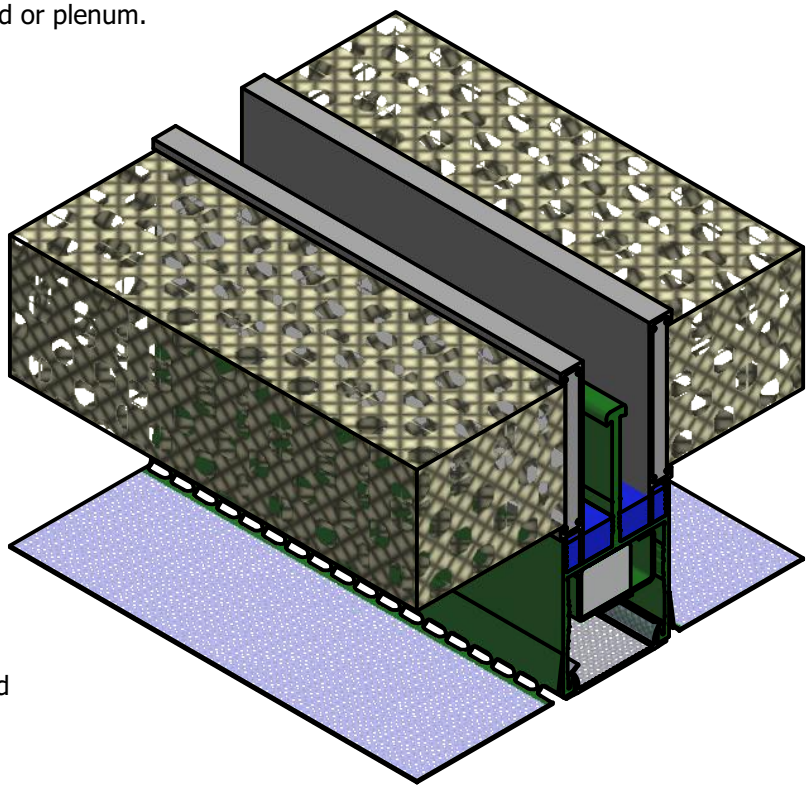


KEY FEATURES


- Flush ceiling grid module.
- Extruded aluminum top-load grid.
- Welded modules up to 8x24 foot for rapid field installation. Optional stick-built grid.
- Gasketed or gel filter interface.
- Integral LED lighting.
- Integral fire protection. A true flush concealed sprinkler head can be used in the grid extrusion.
- Clean-Screens for washing out particles under grid channel.
- Optional GelLink seal that flows between modules for leak-free module to module joints.
- Optional integrated ionization wiring.
- Option to be walkable on the filters, FFUs, or blank pans.
- Optional Equalizer can be used to balance the ceiling filters.
- Optional plenum can.

CONDENSED SPECIFICATION optional items noted in [ ]

The grid [plenum] system shall be the Clean-Trak top-load flush as manufactured by CLEANPAK. The cleanroom filtered ceiling system shall consist of a continuous ceiling grid with powder coated extruded aluminum grid channel, integrated lighting, integrated sprinkler system, associated connectors, grid hanging all-thread rod from grid to turnbuckle, nominal 2x4 foot [4x4 foot] filters, and accessories such as filter dampers, blank pans, return air grilles, clips, and miscellaneous hanging hardware and clips for wall head track, grid face hanging, and piping. The ceiling grid shall have a top trough to accept gel in the field for a leak-free seal of components. [The ceiling system shall have gasket on the top for a non-pressurized interstitial application.] [The ceiling system shall also include a positively pressurized plenum that is an integral part of the ceiling grid. The ceiling grid for plenums is required to have gel seals for sealing the filters to the grid. Gasketed seals between filter and grid for positively pressurized plenums are not allowed.] [The plenum shall have a series of fans installed in the roof to provide for airflow through the system.] The grid extrusion shall have integrated flush lighting within the grid channel that is capable of 100% filter coverage of the entire ceiling. The grid extrusion shall be capable of accepting a true flush sprinkler head within the width of the extrusion. [The grid shall have a GelLink seal that flows gel between module joints.] [The grid shall have Clean-Screens at the grid face that have perimeter slots to jet air underneath the grid member and wash out the area of particles.]

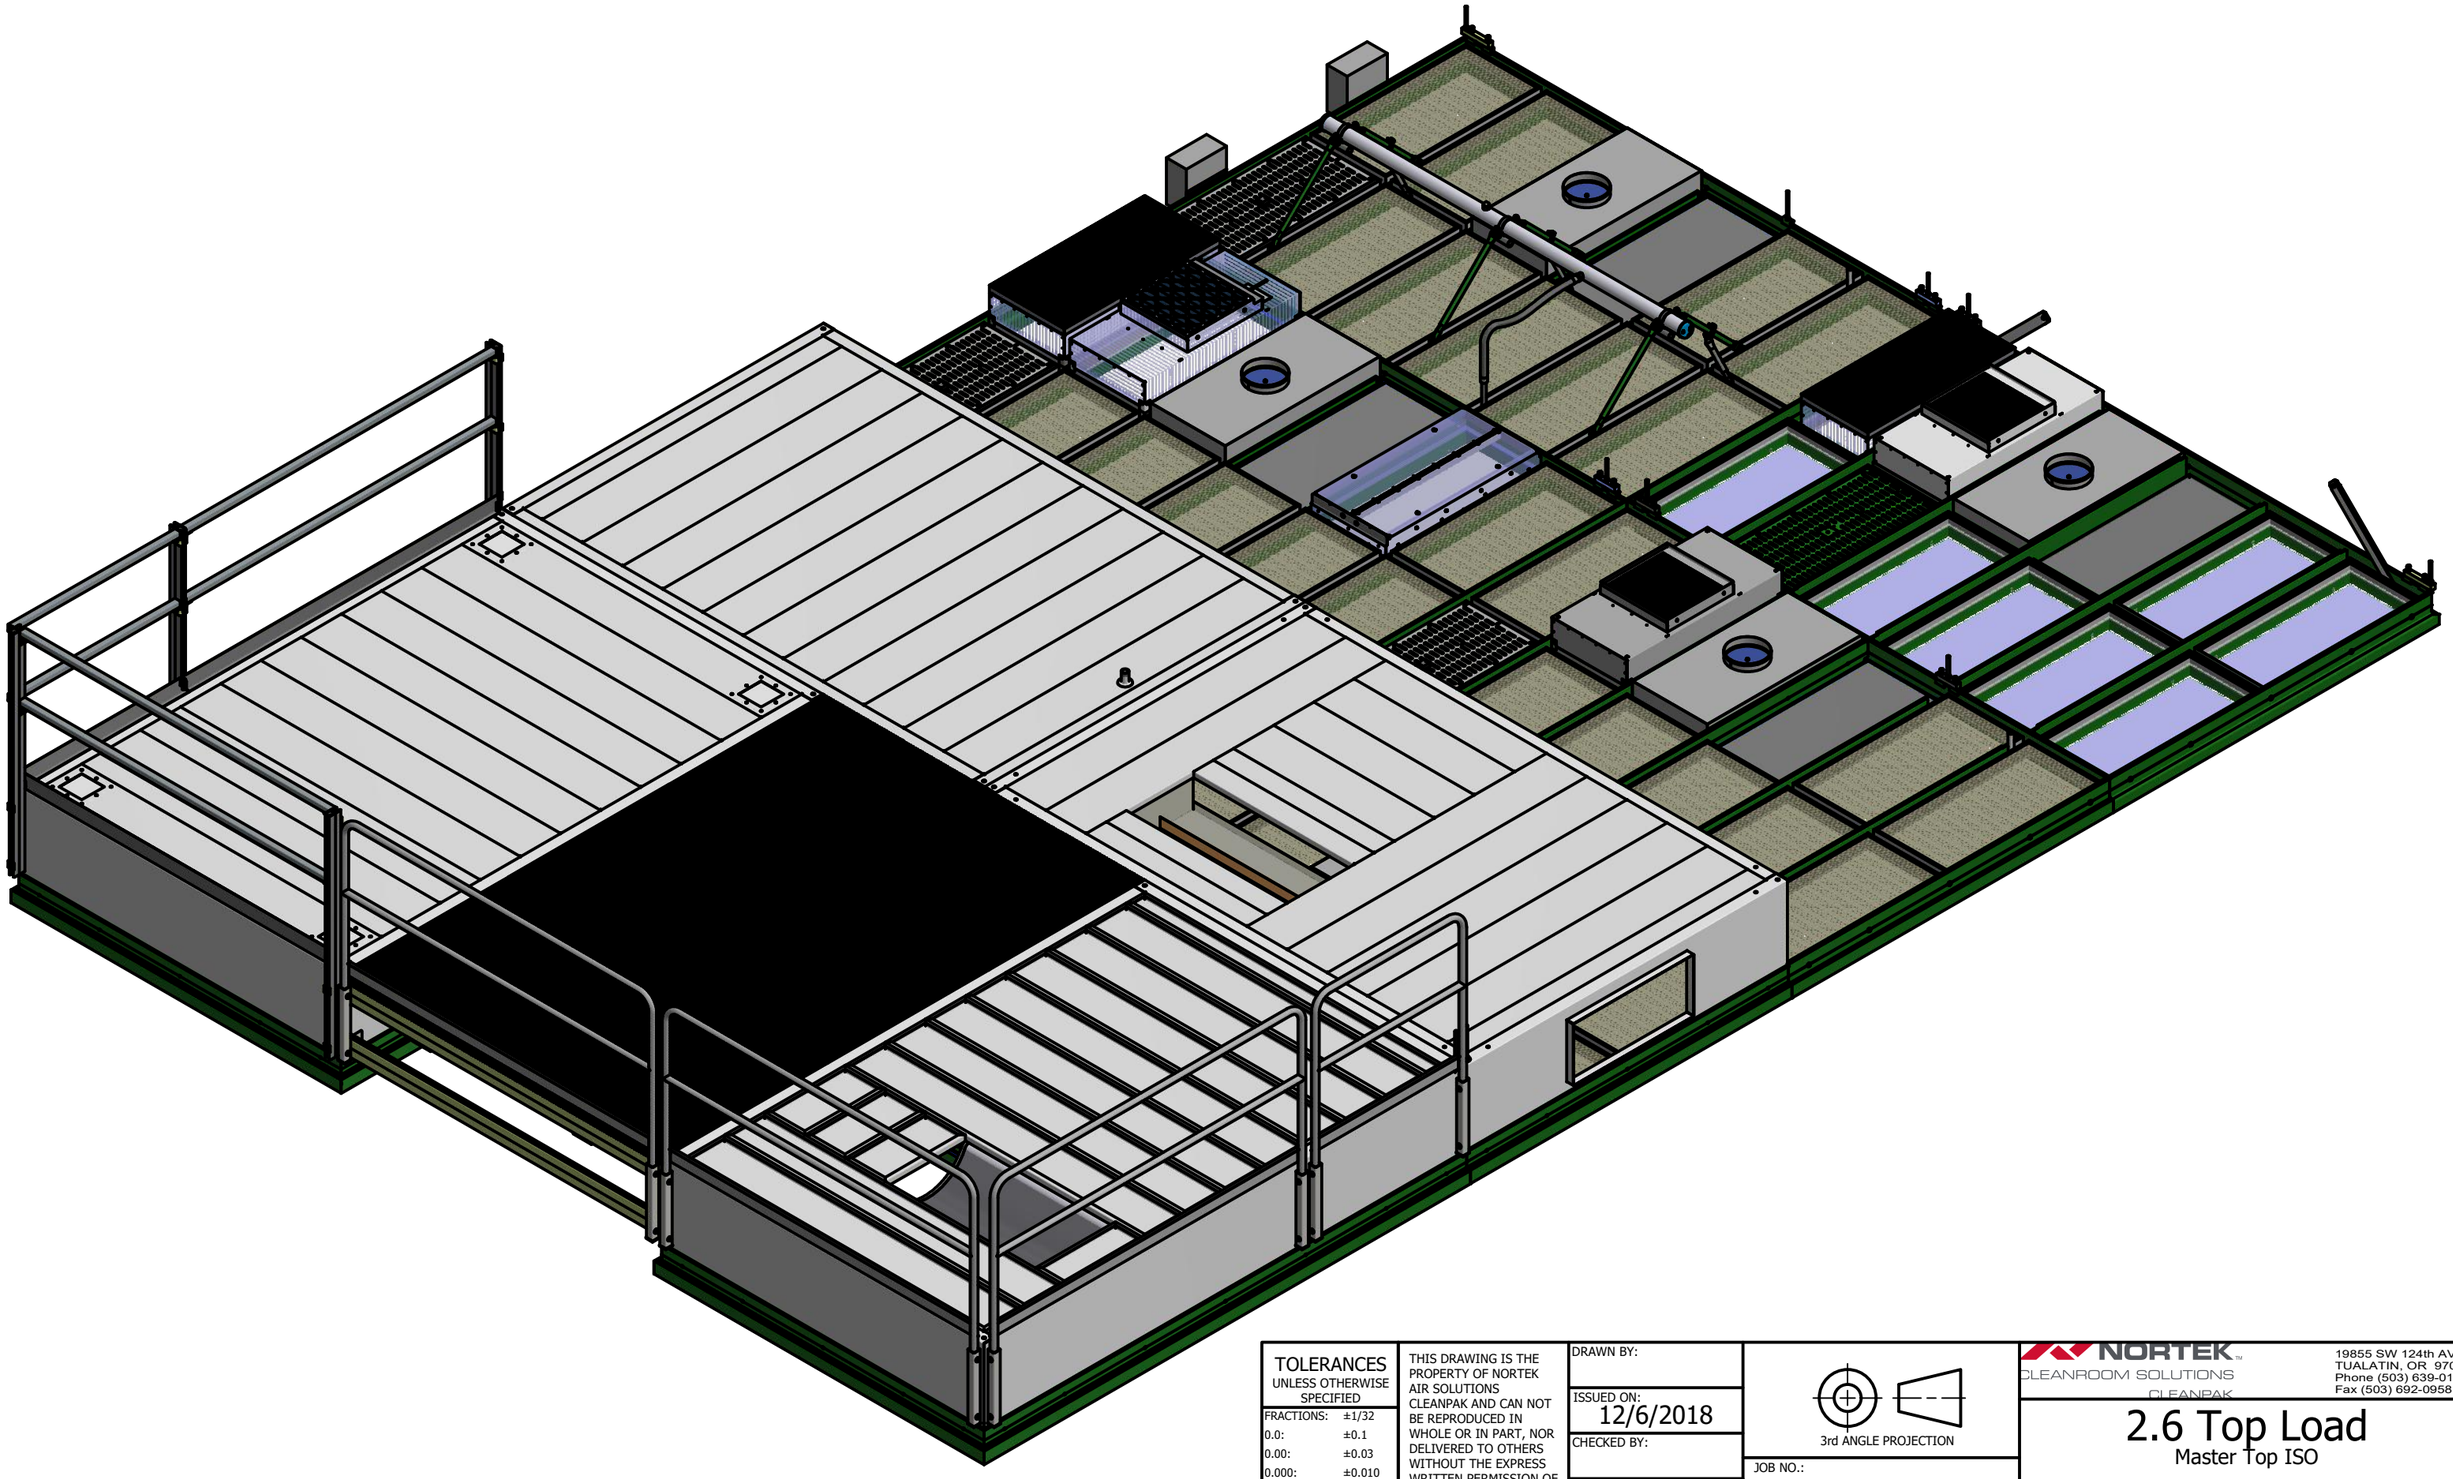

TOLERANCES UNLESS OTHERWISE SPECIFIED		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
FRACTIONS:	±1/32		ISSUED ON: 12/6/2018		2.6 Top Load	
0.0:	±0.1		CHECKED BY:		Master Top ISO	
0.00:	±0.03			JOB NO.:		
0.000:	±0.010		PART NO.:	FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 2 OF 53
ANGLES:	±0.5°					
OTHER: SEE DOC. QMS000.01A						

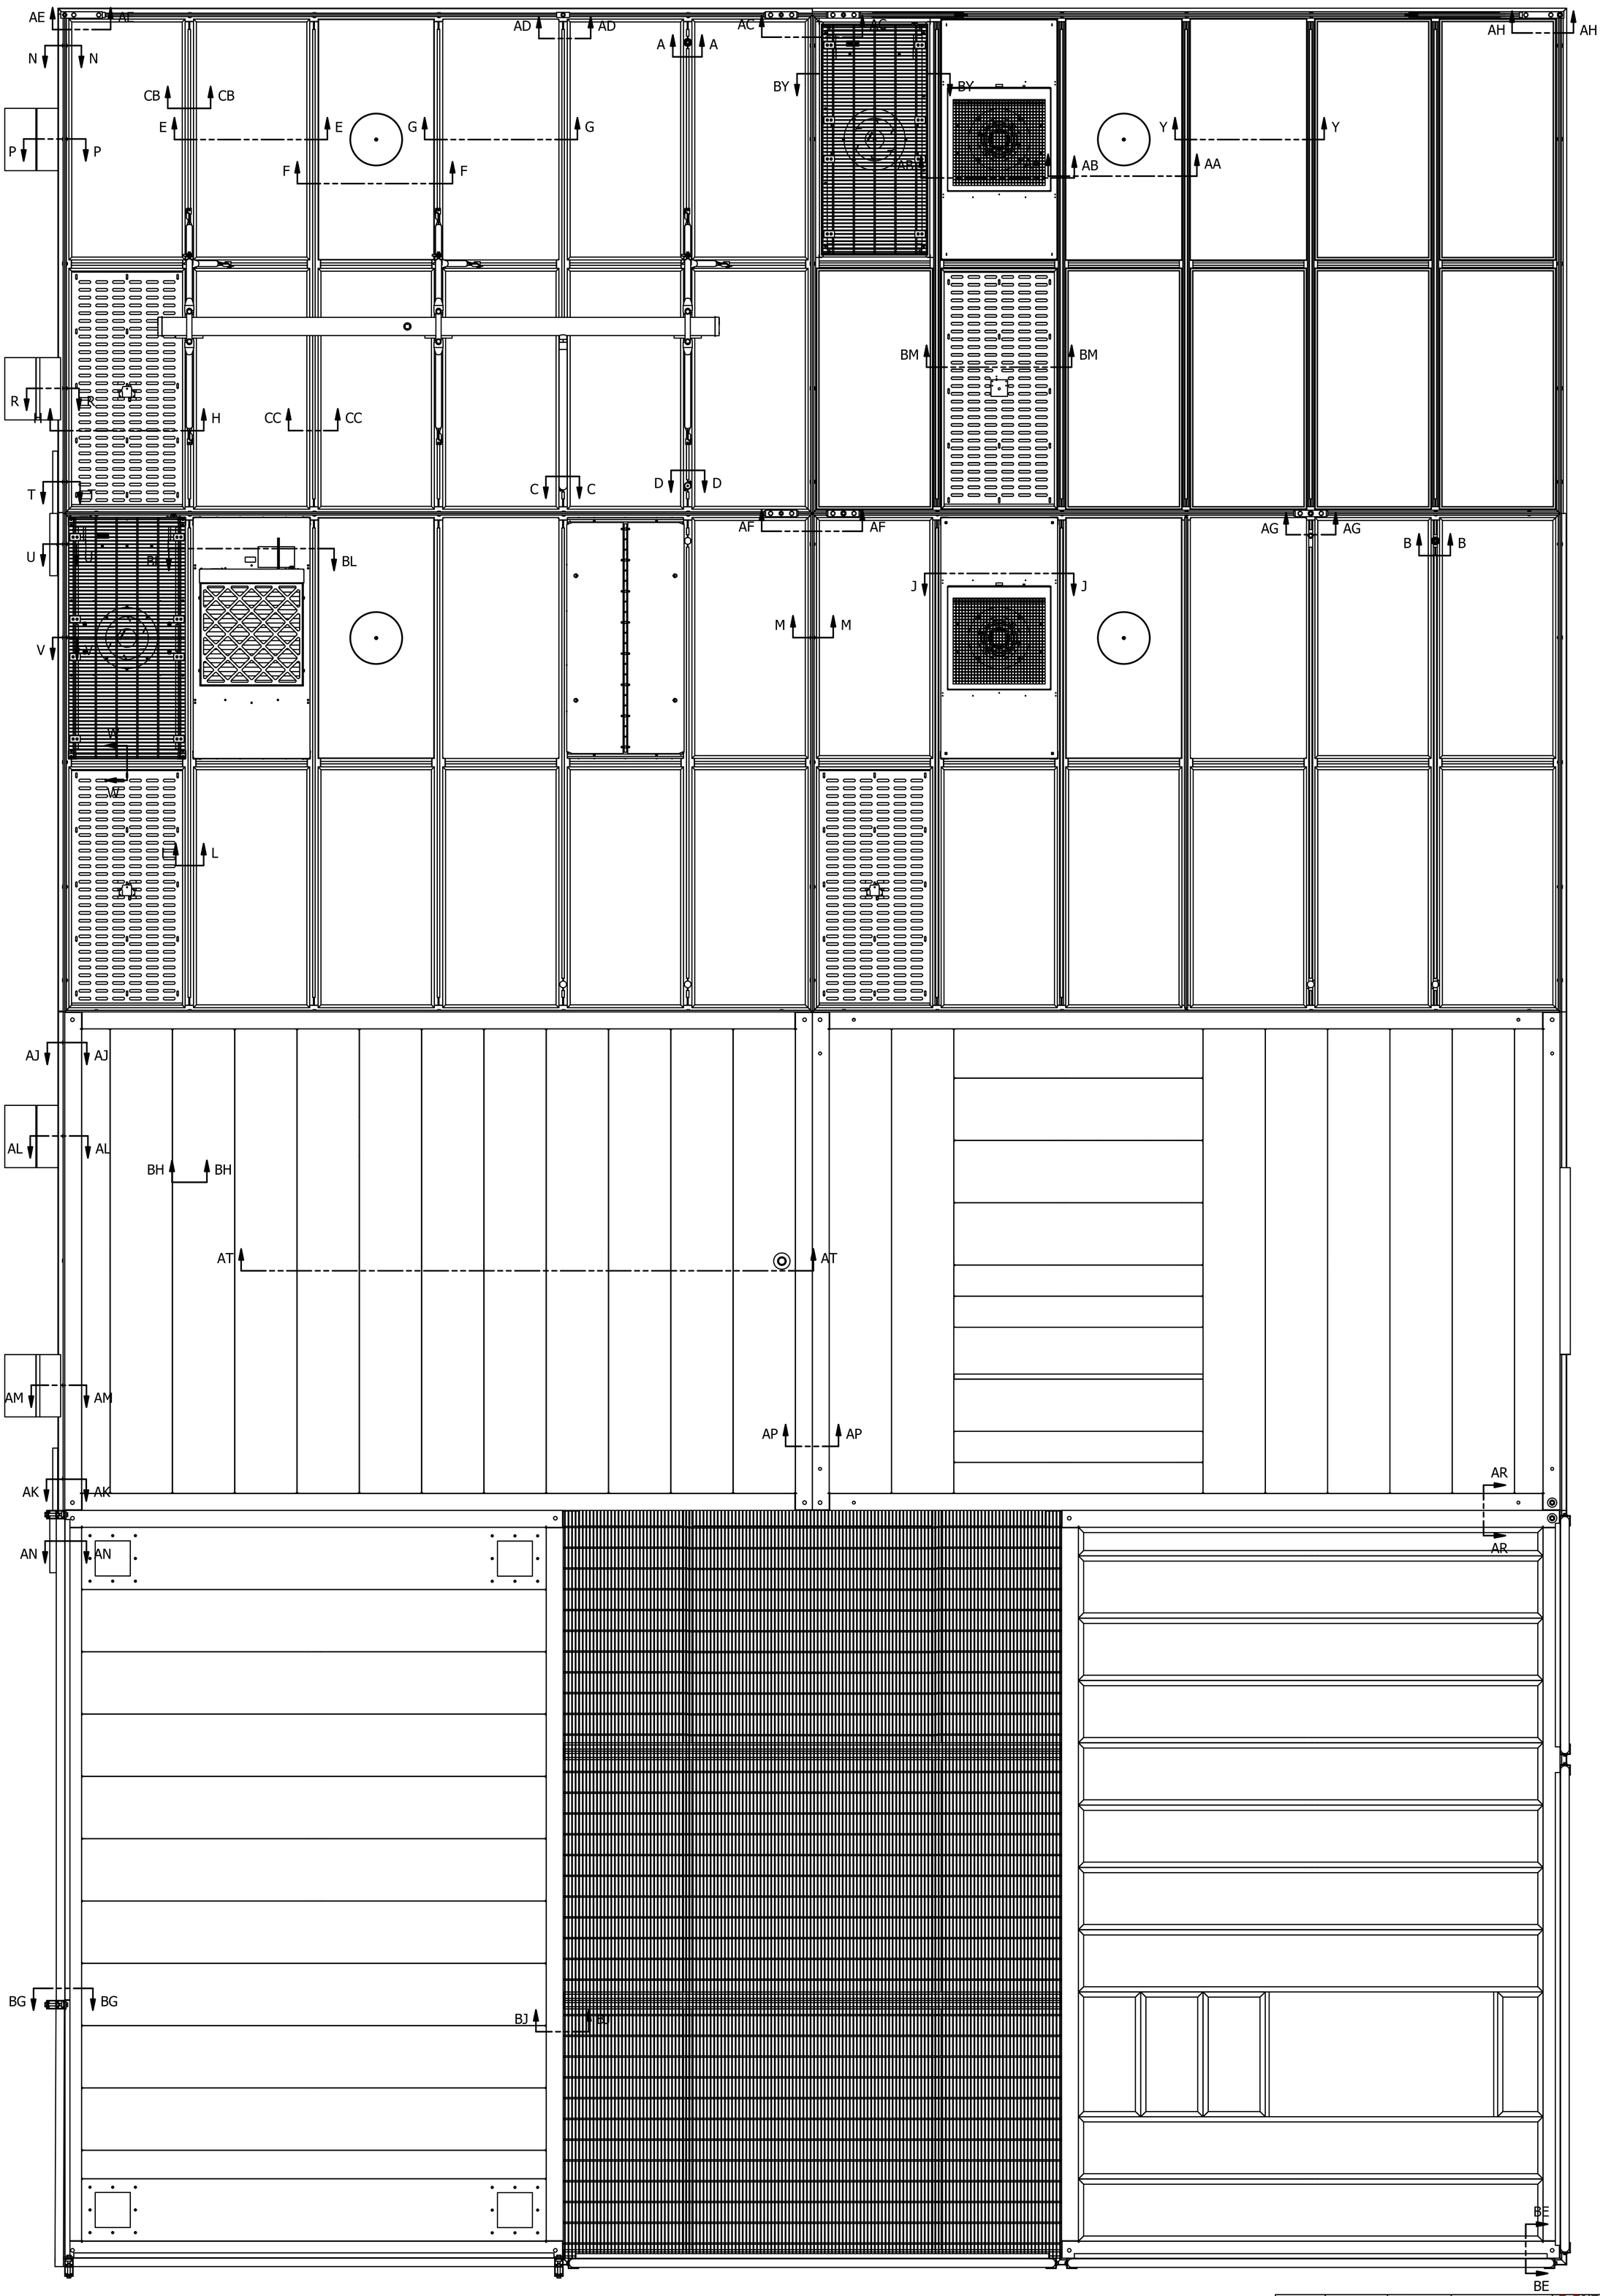


TOLERANCES UNLESS OTHERWISE SPECIFIED	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	NORTEK AIR SOLUTIONS CLEANPAK
FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC: DR5000.01A		ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:
			FILE NAME: 2.6TopLoad.idw

19855 SW 124th AVE
TUALATIN, OR 97062
Phone (503) 639-0113
Fax (503) 692-0958

2.6 Top Load
Master Plan View

REV: 1

ITEM	STOCK NUMBER	DESCRIPTION	QTY
1	240-10-24	Extr 2.6 Int Gel TB	
2	240-10-25	Extr 2.6 Int Gel	
4	240-10-66	Extr 2.6 Ext Gel	
5	240-10-67	Extr 2.6 Ext Gel Link Plen RVT	
7	240-10-121	Extr 2.6 Int2 Gskt TTS	
8	240-10-112	Extr 2.6 Int2 Gel TT	
9	240-10-122	Extr 2.6 Int Gskt TBS	
10	240-10-120	Extr 2.6 Ext2 Gskt S	
11	240-10-111	Extr 2.6 Ext2 Gel	

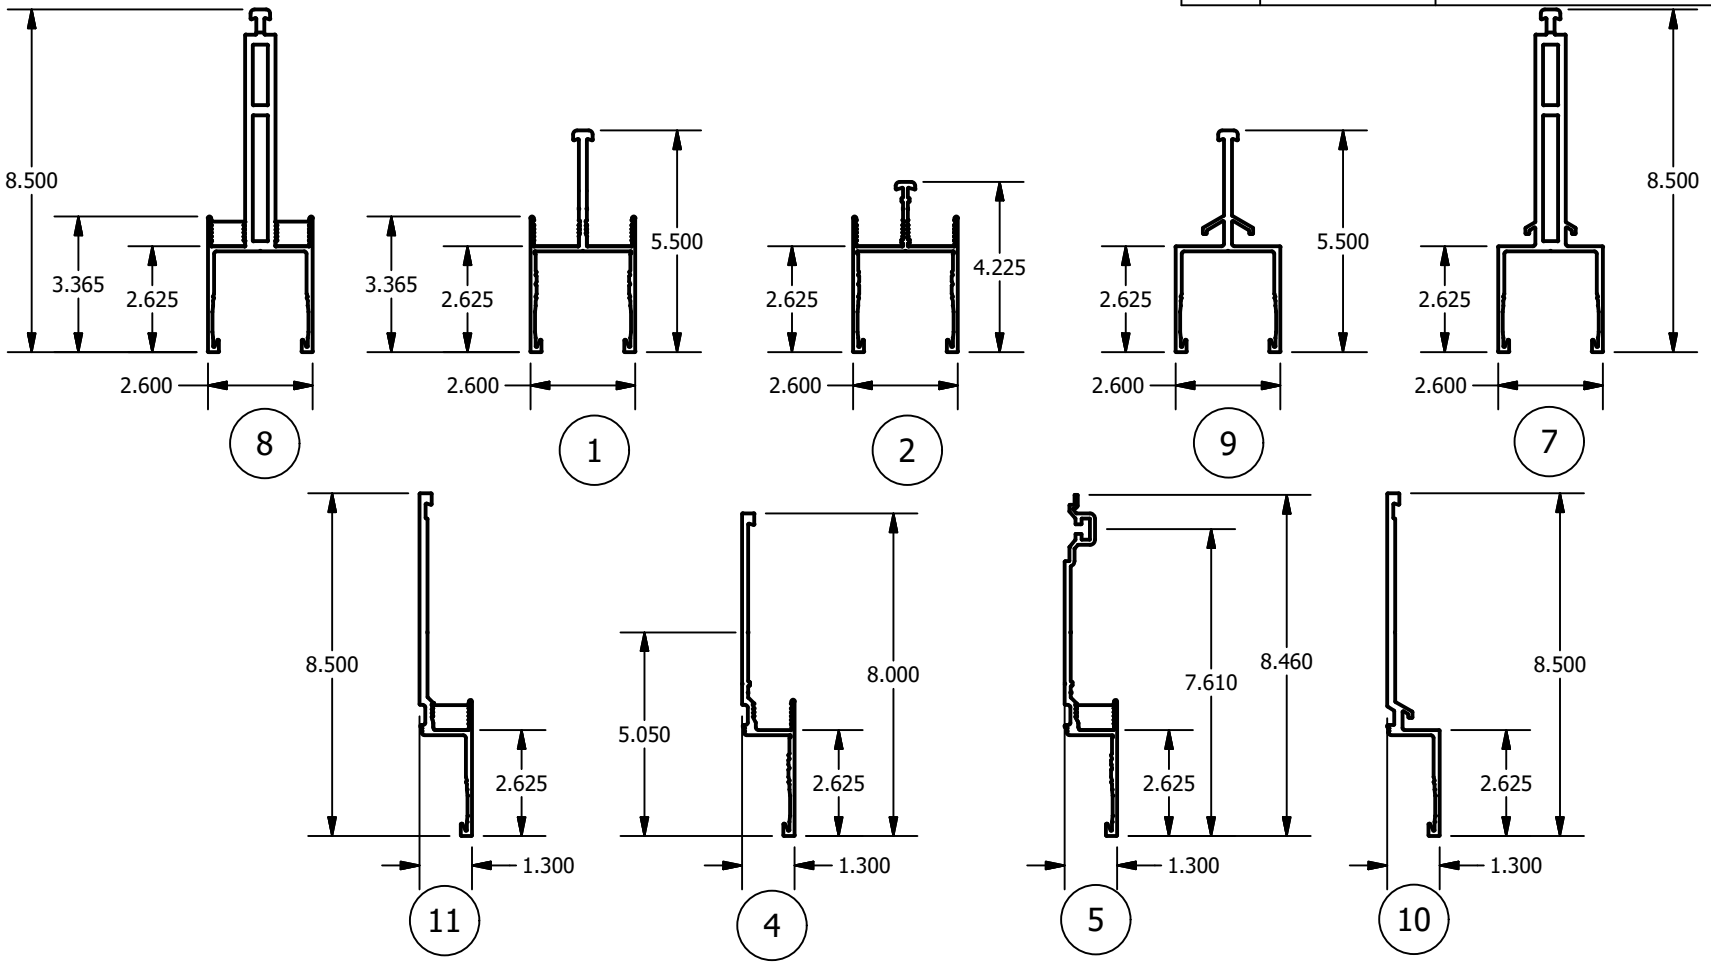



TOLERANCES		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK
UNLESS OTHERWISE SPECIFIED			ISSUED ON: 12/6/2018		19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
FRACTIONS:	±1/32		CHECKED BY:		
0.0:	±0.1				
0.00:	±0.03				
0.000:	±0.010				
ANGLES:	±0.5°				
OTHER: SEE DOC. QMS000.01A			PART NO.:	JOB NO.:	

2.6 Top Load Grid

Extrusion Profiles


FILE NAME: 2.6TopLoad.idw | REV: 1 | SHEET 4 OF 53

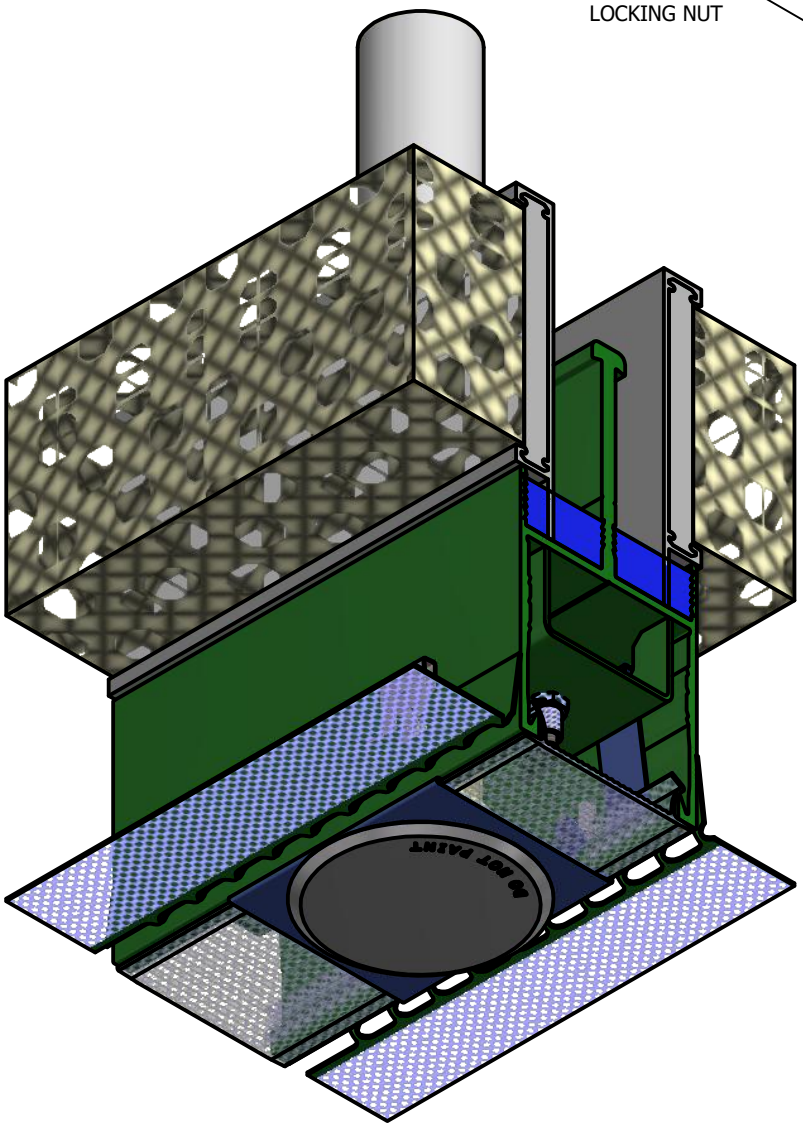


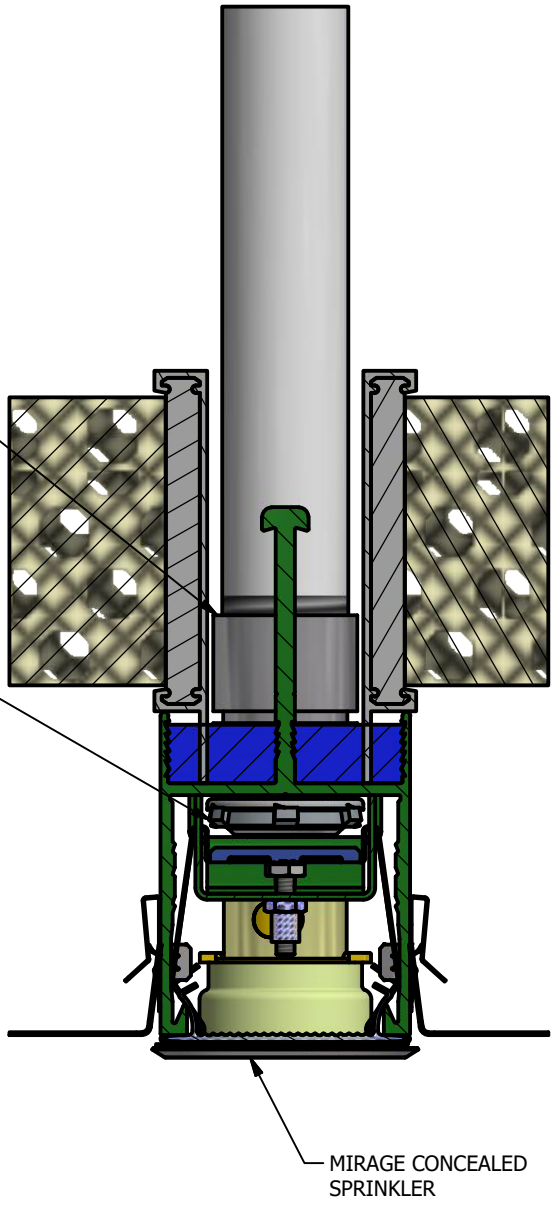

SECTION A-A
SCALE 1 / 2


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.: FILE NAME: 2.6TopLoad.idw	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958 2.6 Top Load Grid Sprinkler Concealed Hard Piped Type "B" Coupling REV: 1 SHEET 5 OF 53

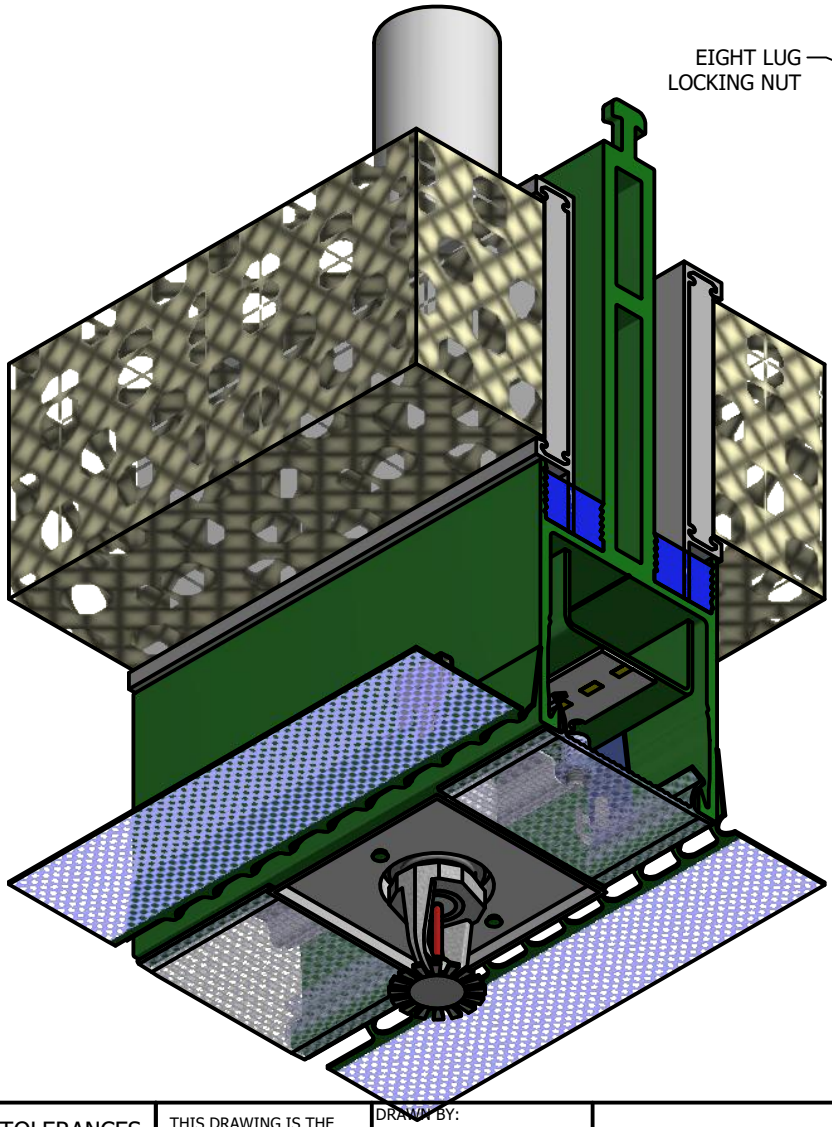


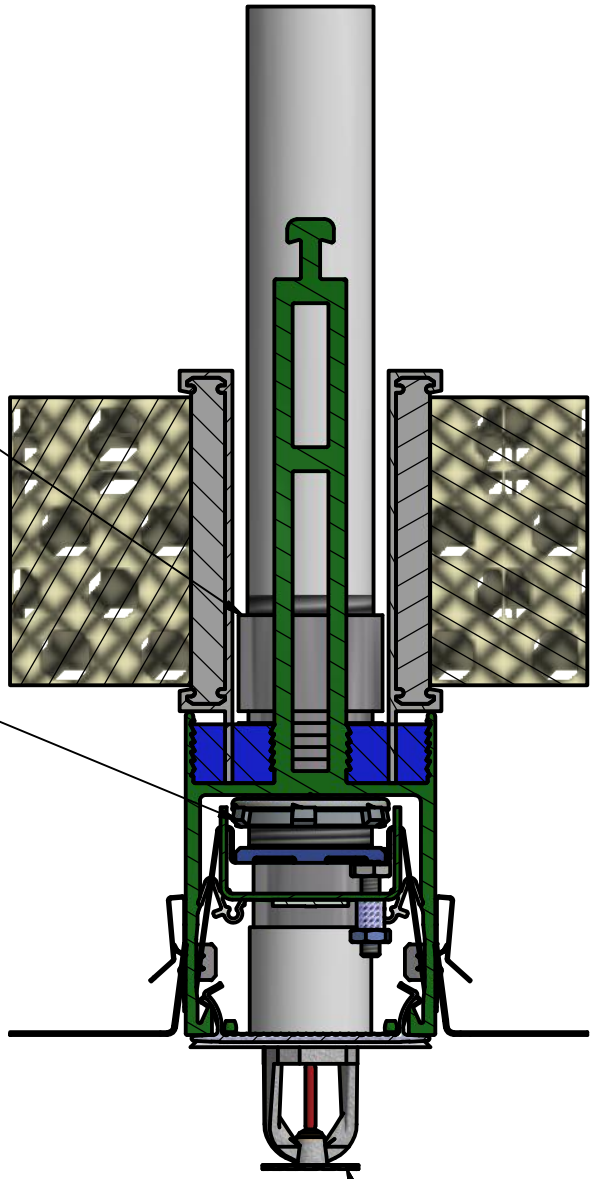

SECTION B-B
SCALE 1 / 2


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.: FILE NAME: 2.6TopLoad.idw	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958 2.6 Top Load Grid Sprinkler Pendant Hard Piped Type "M" Threaded Coupling REV: 1 SHEET 6 OF 53

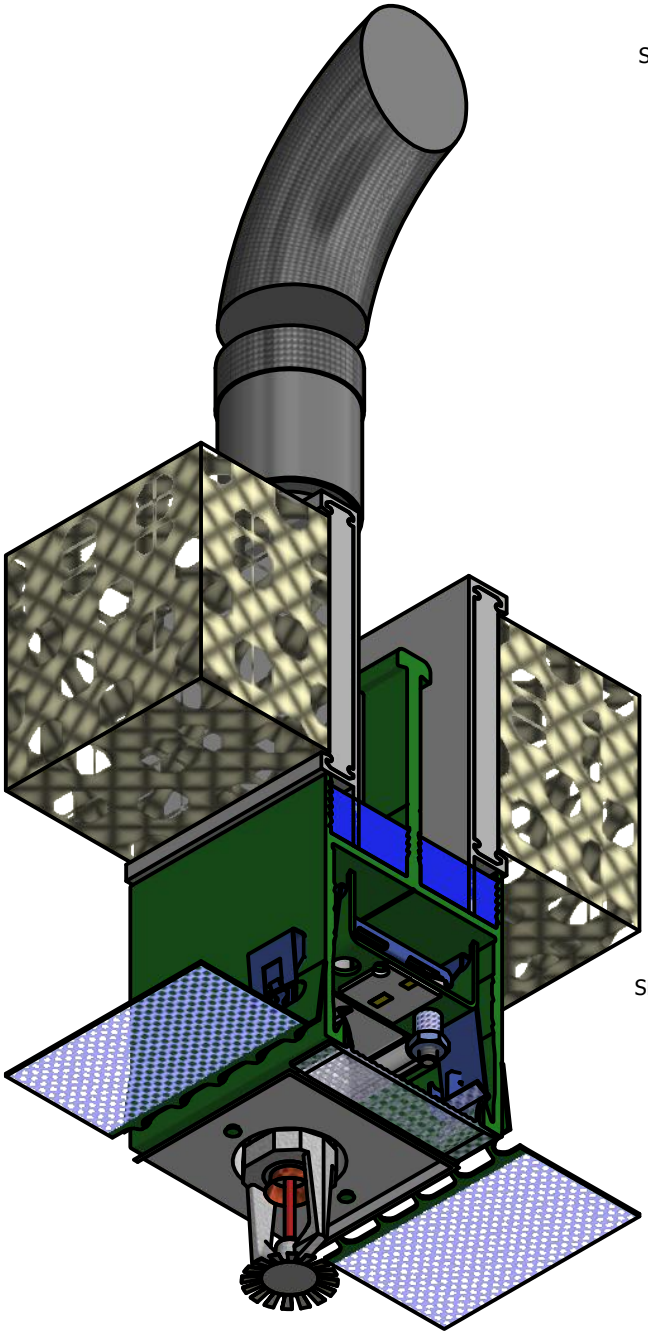

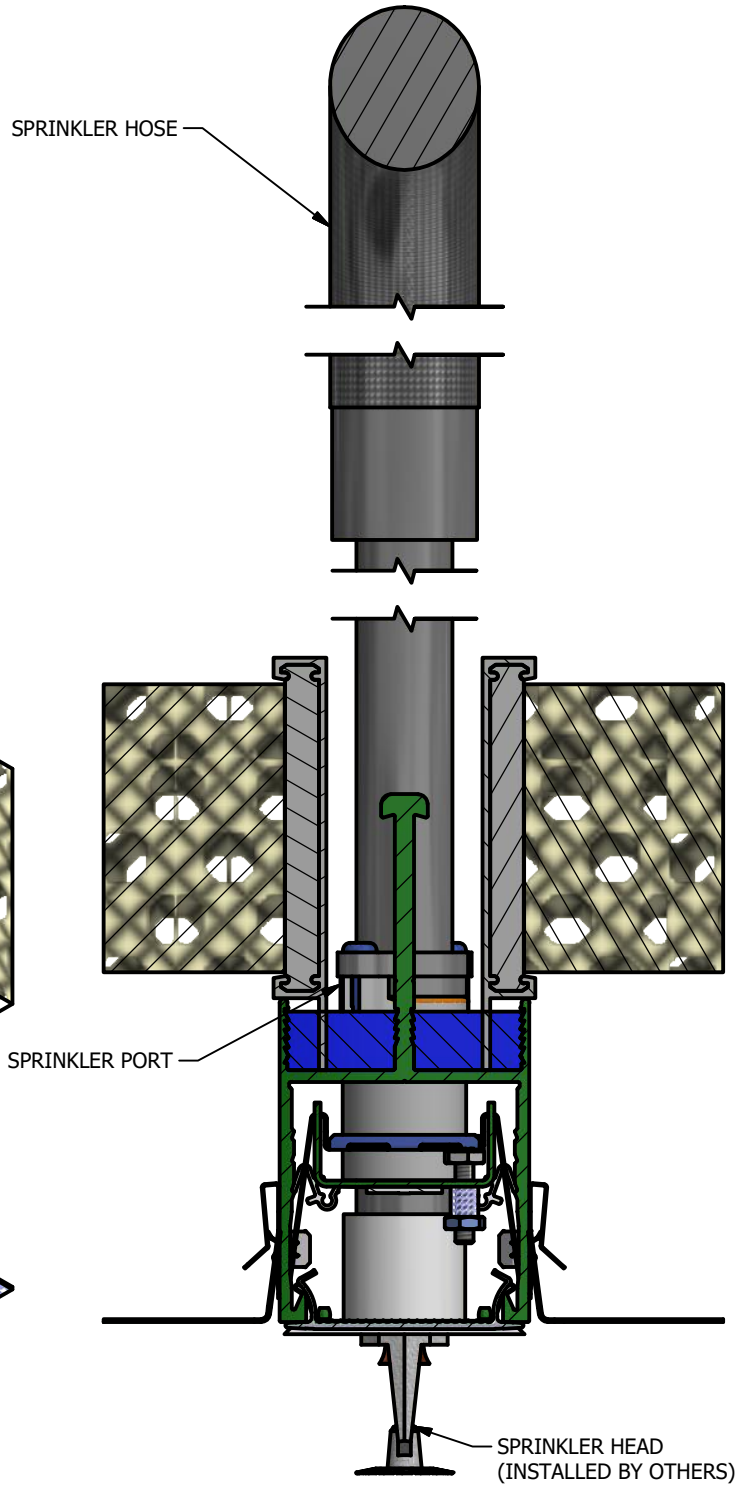


SECTION C-C
SCALE 1 / 2


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958	2.6 Top Load Grid Sprinkler Flexible Hose FILE NAME: 2.6TopLoad.idw REV: 1 SHEET 7 OF 53

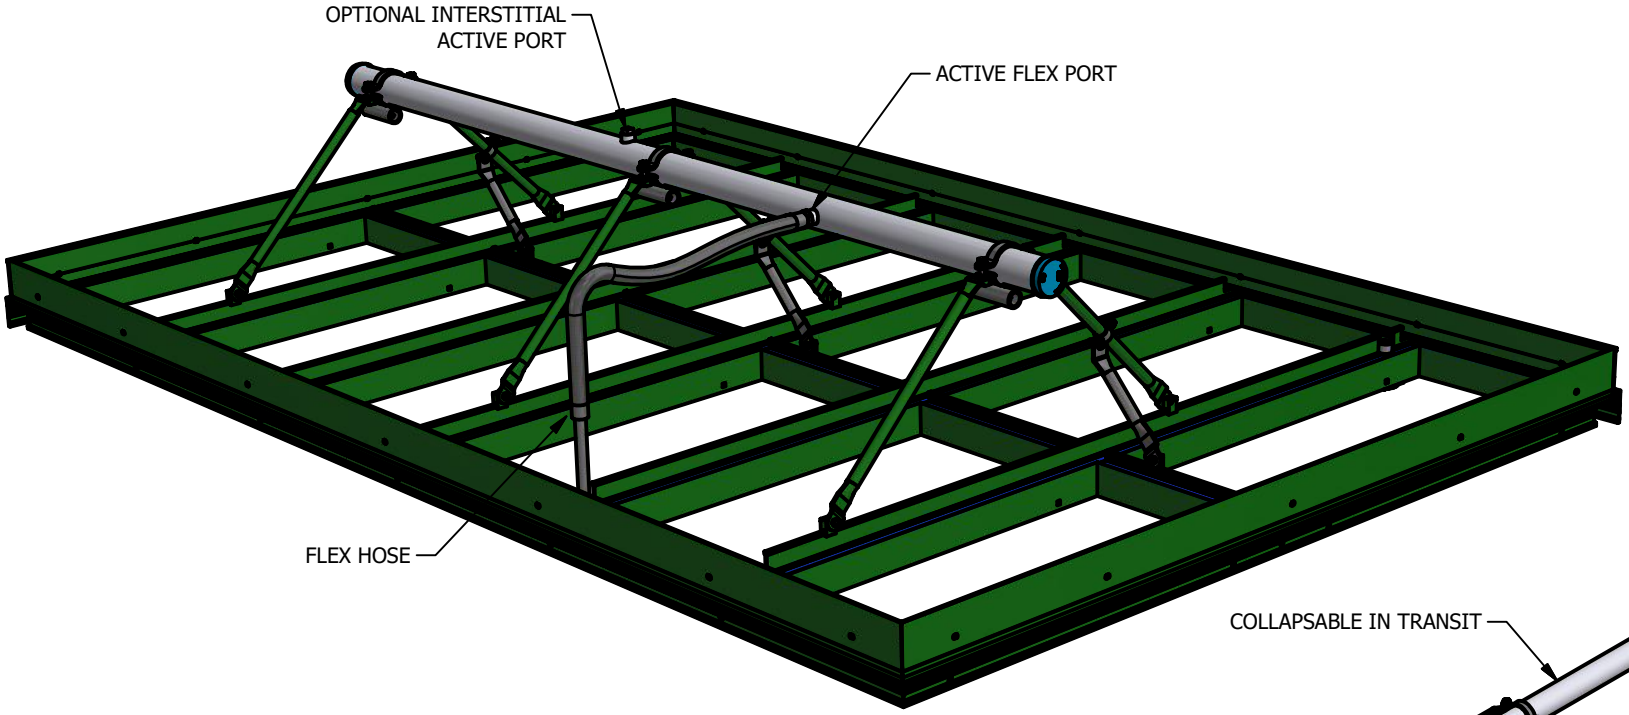

3" SPRINKLER MAIN INSTALLED ON GRID

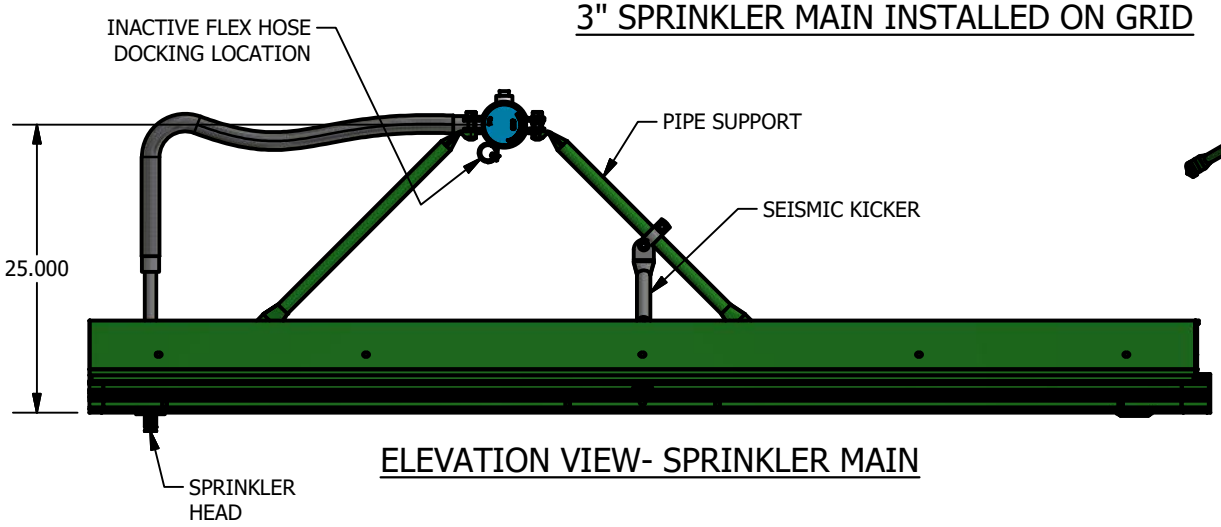

ELEVATION VIEW- SPRINKLER MAIN

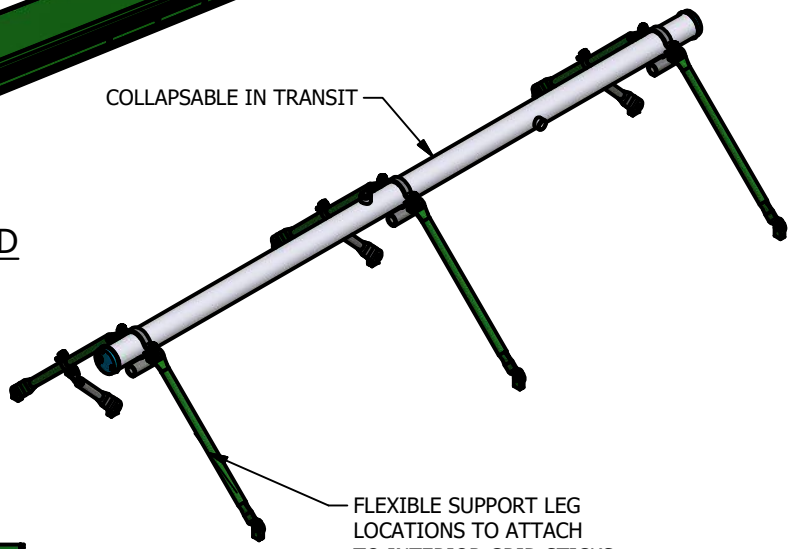


3" SPRINKLER MAIN

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958

2.6 TOP LOAD GRID


3" MAIN PIPE SPRINKLER OPTION


FILE NAME: 2.6TopLoad.idw | REV: 1 | SHEET 8 OF 53

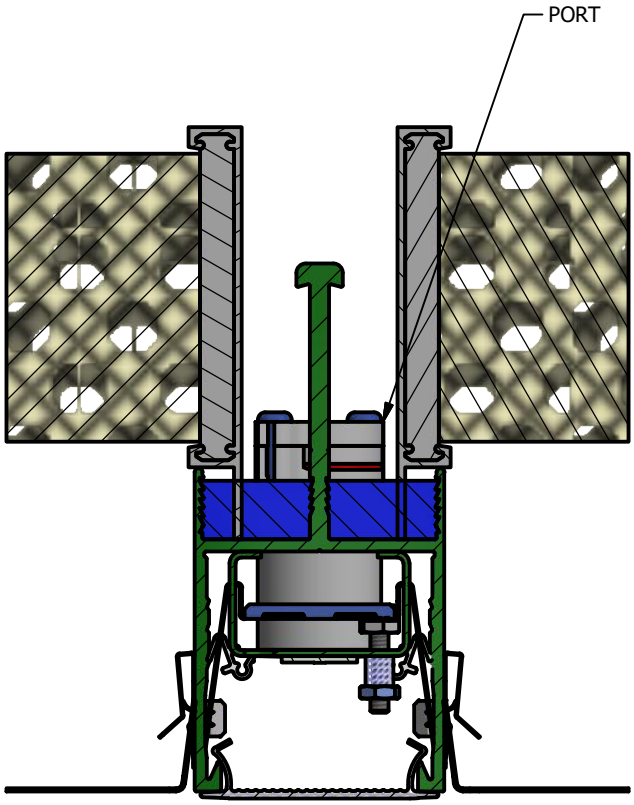

SECTION D-D
SCALE 1 / 2

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.: FILE NAME: 2.6TopLoad.idw	NORTEK CLEANROOM SOLUTIONS CLEANPAK 2.6 Top Load Grid Port REV: 1	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958

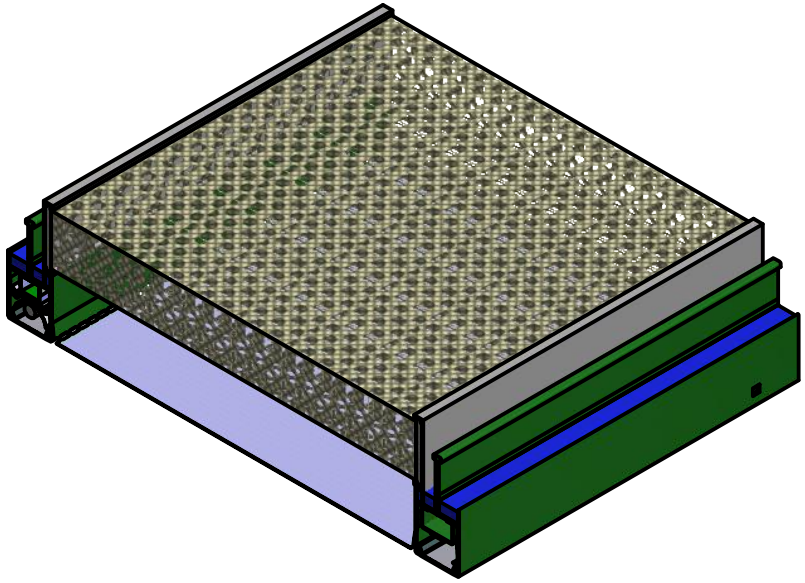

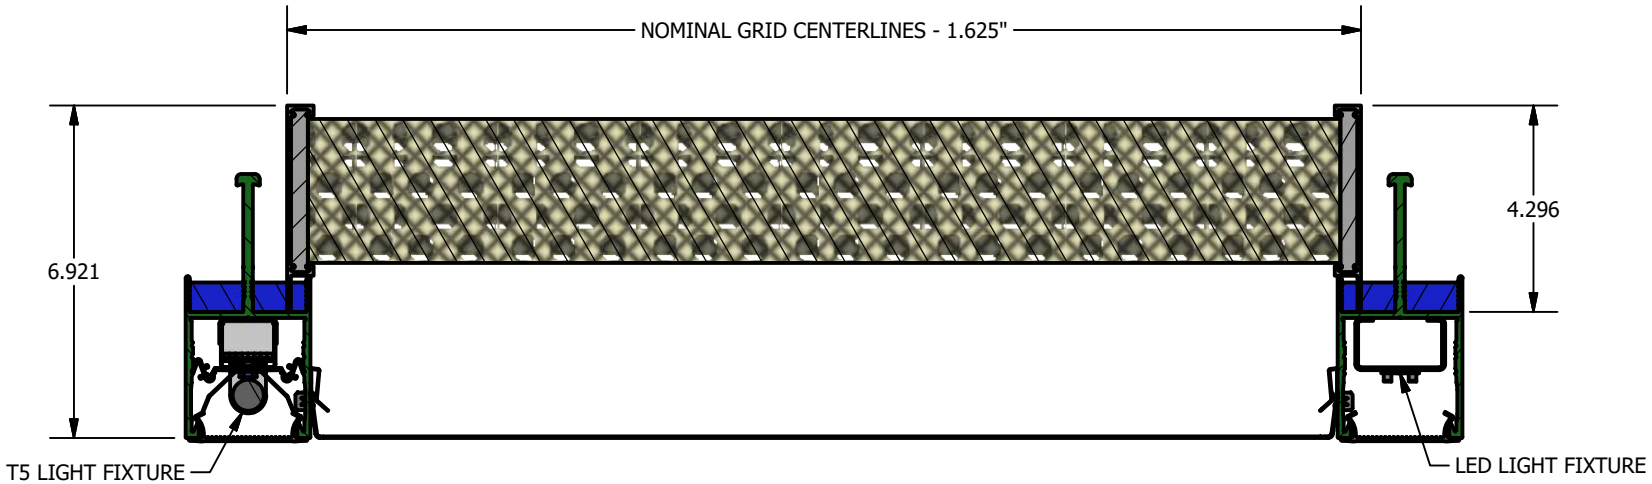


SECTION E-E
SCALE 1 / 4


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958

2.6 Top Load Gel Grid

Filter Top Load Plenum Style


FILE NAME: 2.6TopLoad.idw | REV: 1 | SHEET 10 OF 53

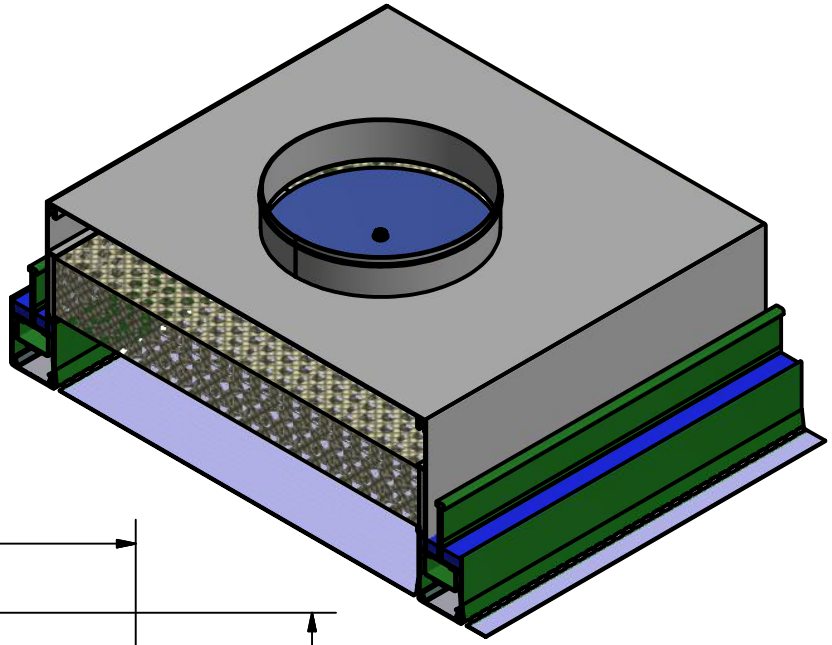


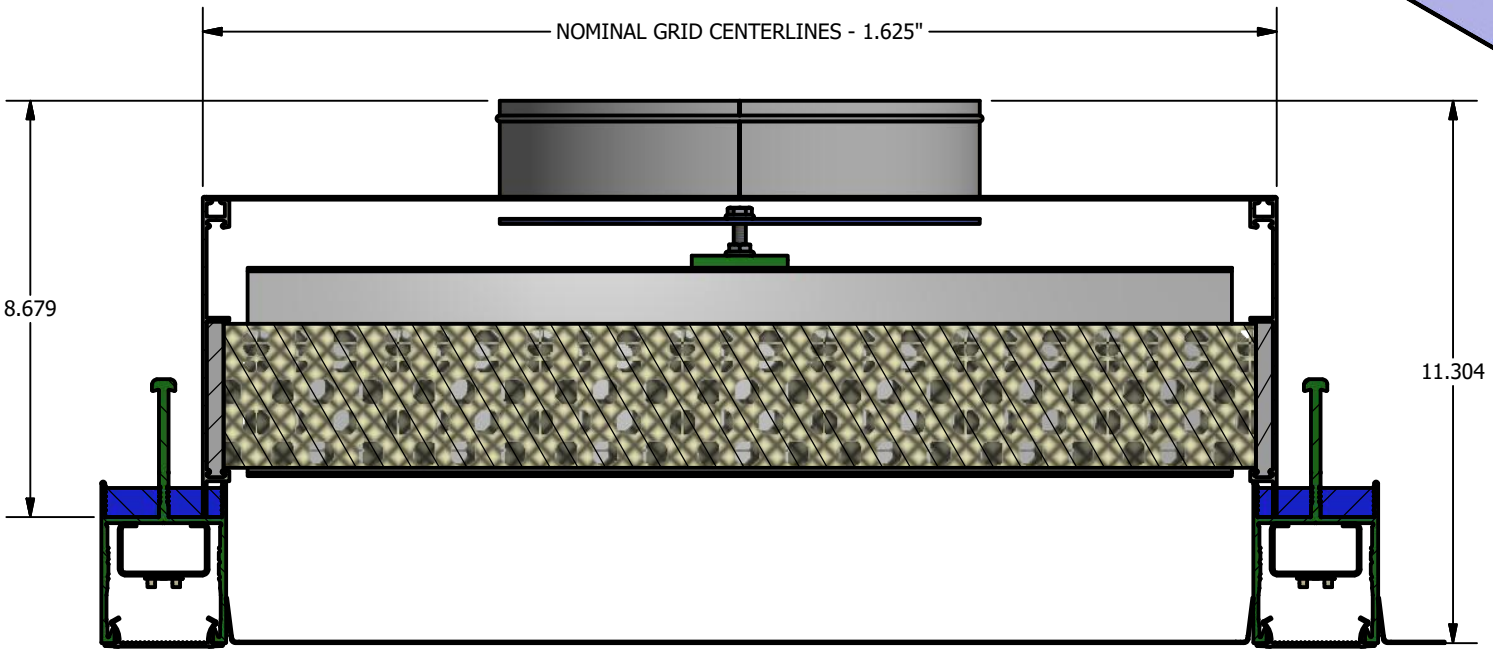

SECTION F-F
SCALE 1 / 4


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958	2.6 Top Load Gel Grid Filter Top Load Terminal Ducted Filter Style
			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 11 OF 53

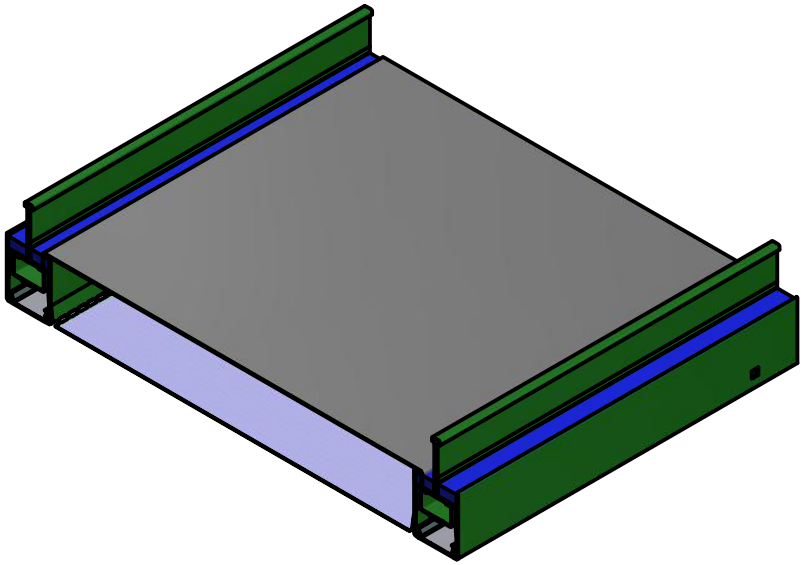


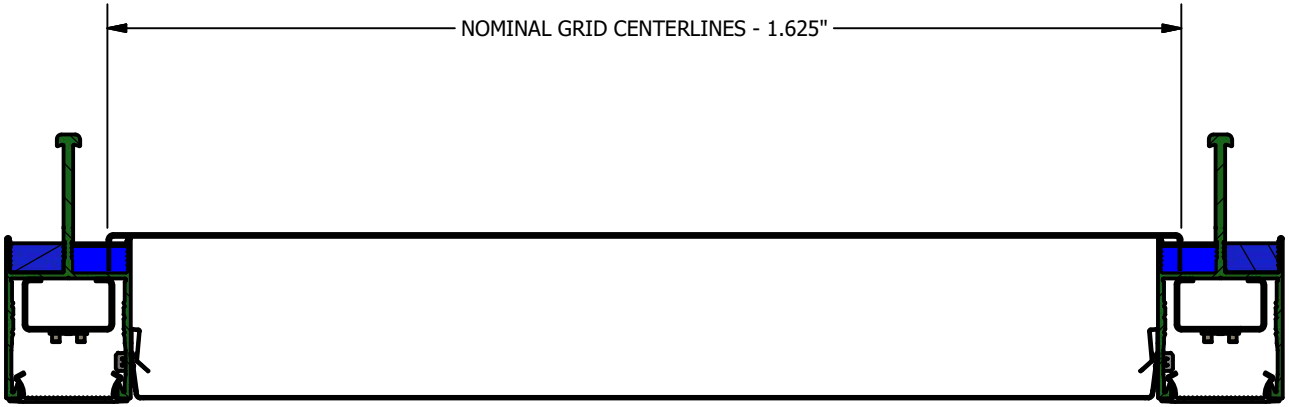

SECTION G-G
SCALE 1/4


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.: FILE NAME: 2.6TopLoad.idw	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958 2.6 Top Load Gel Grid Top Load Blank Pan Gel REV: 1 SHEET 12 OF 53

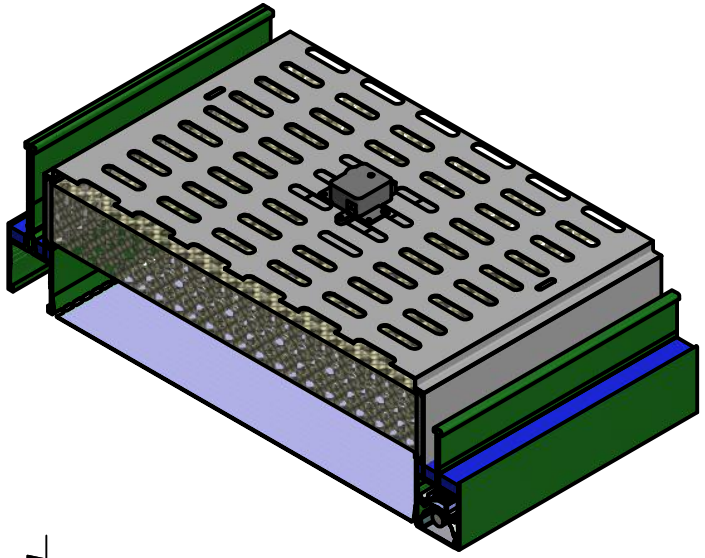

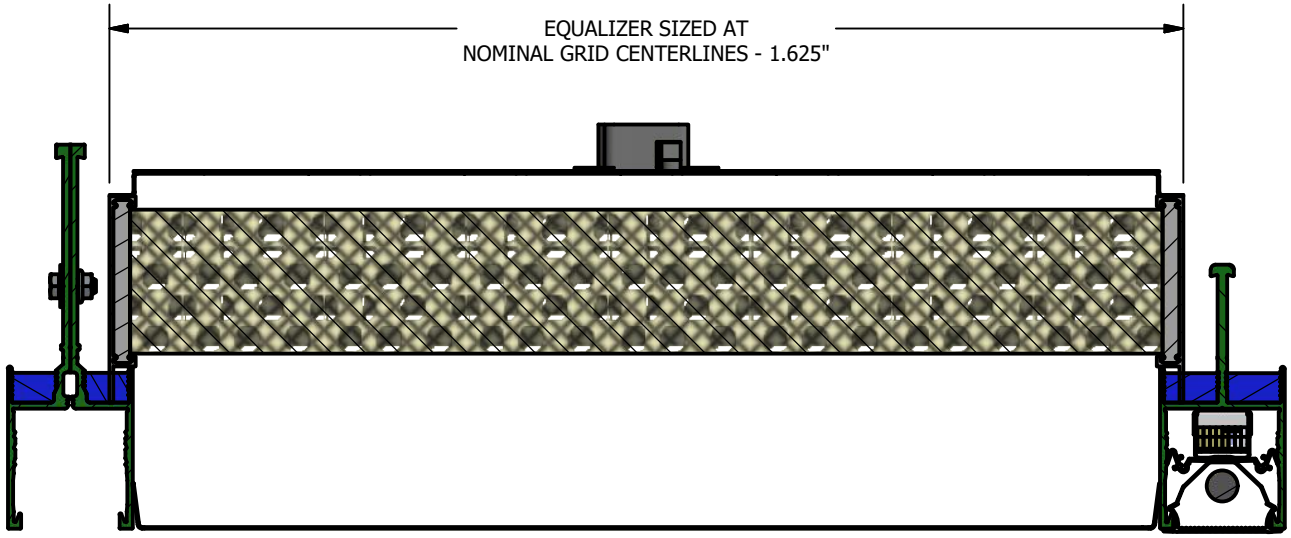

SECTION H-H
SCALE 1/4

TOLERANCES		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
UNLESS OTHERWISE SPECIFIED			ISSUED ON: 12/6/2018		2.6 Top Load Gel Grid	
FRACTIONS:	±1/32		CHECKED BY:		Equalizer on Top Load Plenum Filter	
0.0:	±0.1			JOB NO.:		
0.00:	±0.03					
0.000:	±0.010		PART NO.:			
ANGLES:	±0.5°			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 13 OF 53
OTHER: SEE DOC. QMS000.01A						

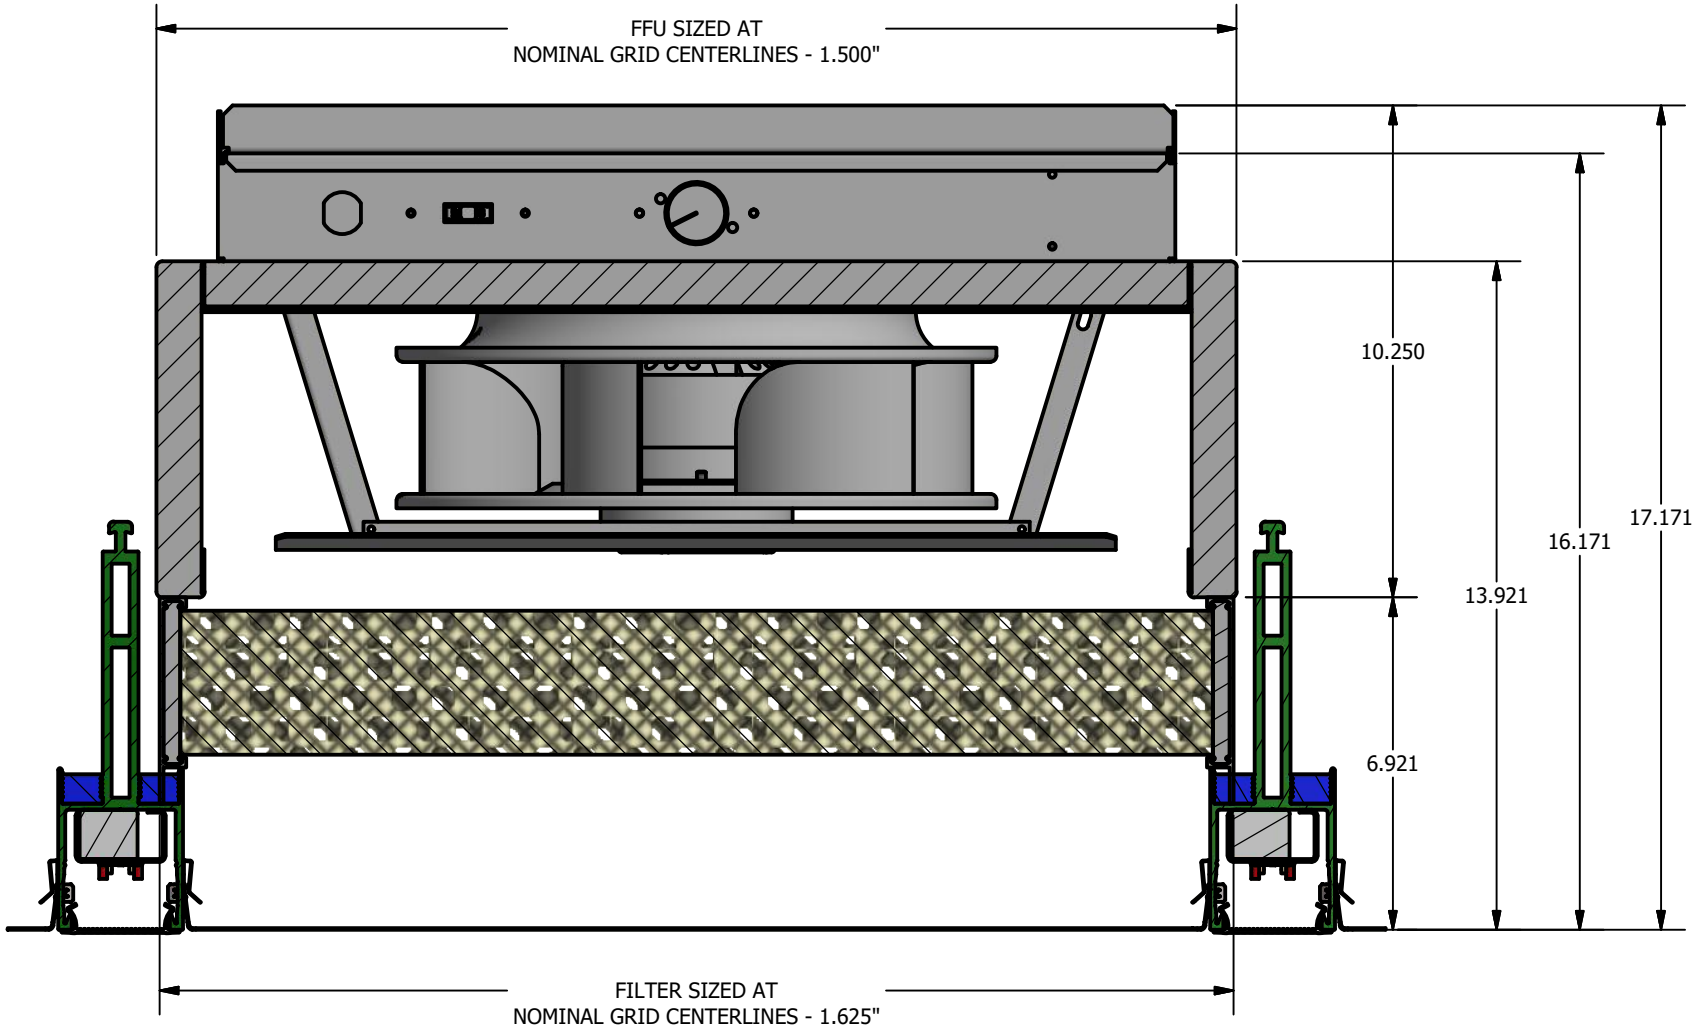


SECTION J-J
SCALE 1/4

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958

2.6 Top Load Gel Grid


FFU-AC1-EB on Top Load Plenum Style Filter

FILE NAME: 2.6TopLoad.idw | REV: 1 | SHEET 14 OF 53

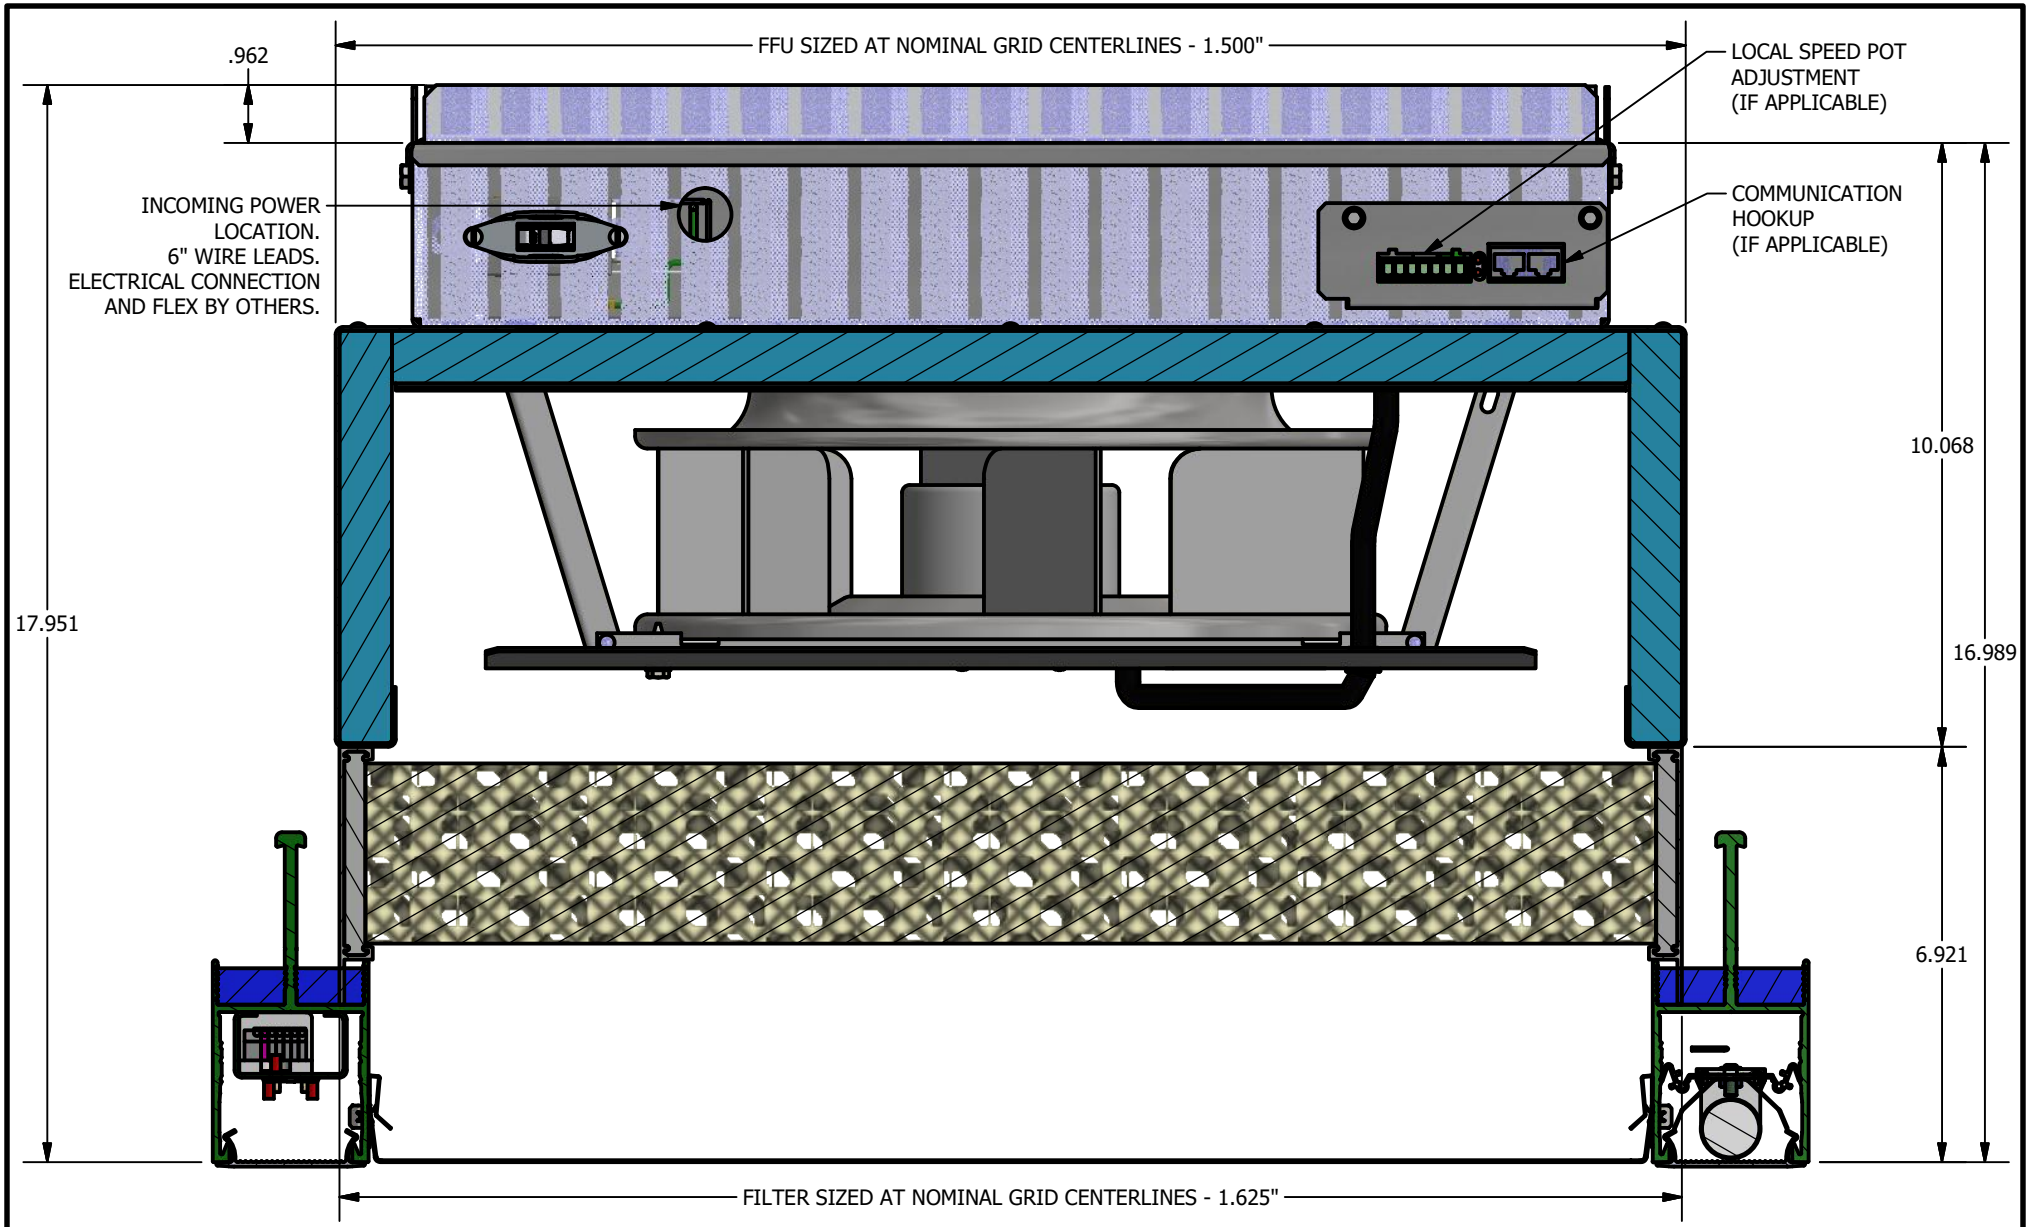


SECTION BL-BL
SCALE 5/16


TOLERANCES UNLESS OTHERWISE SPECIFIED		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
FRACTIONS:	±1/32		ISSUED ON: 12/6/2018		2.6 Top Load	
0.0:	±0.1		CHECKED BY:		FFU-DC-EB on Plenum Filter Section	
0.00:	±0.03			JOB NO.:		
0.000:	±0.010		PART NO.:			
ANGLES:	±0.5°			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 15 OF 53
OTHER: SEE DOC. QMS000.01A						

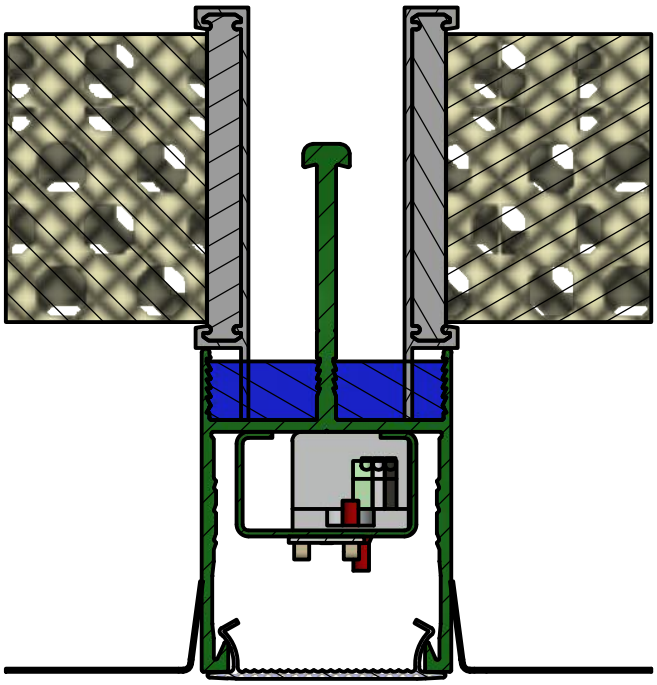


SECTION BH-BH
SCALE 1 / 2

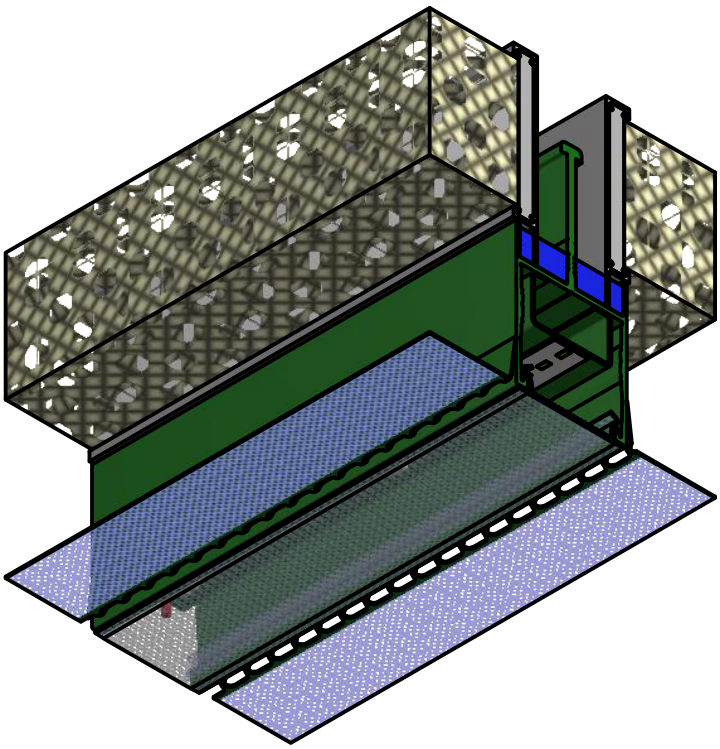


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958	2.6 Top Load Flush Light LED
			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 16 OF 53

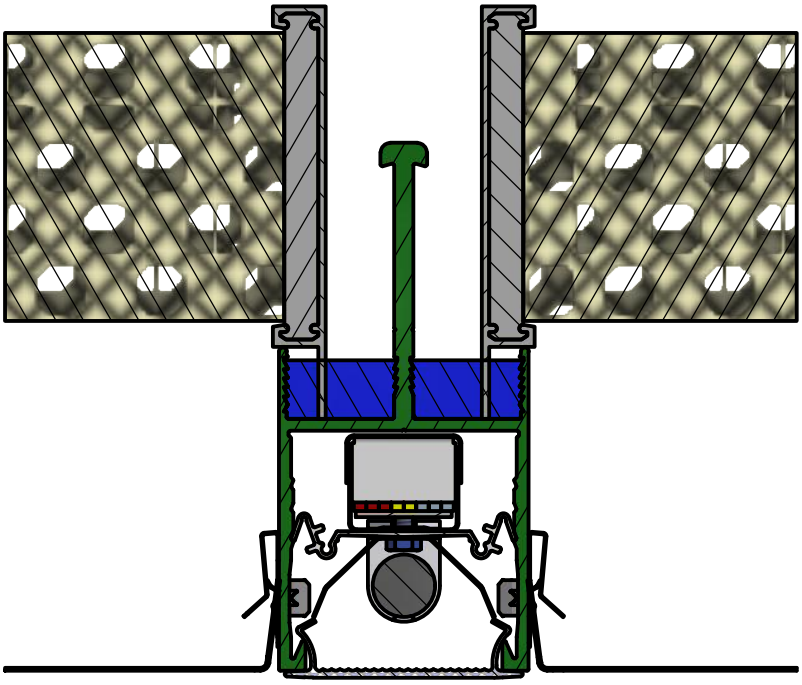


SECTION CB-CB
SCALE 1/2

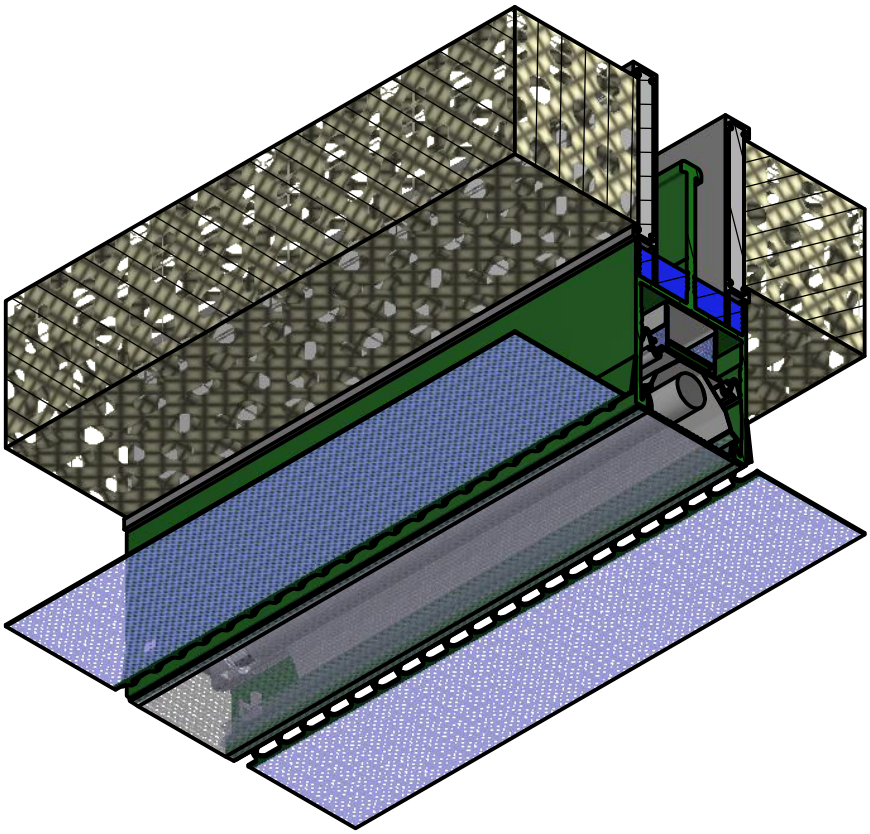


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
				2.6 Top Load Flush Light T5	
			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 17 OF 53

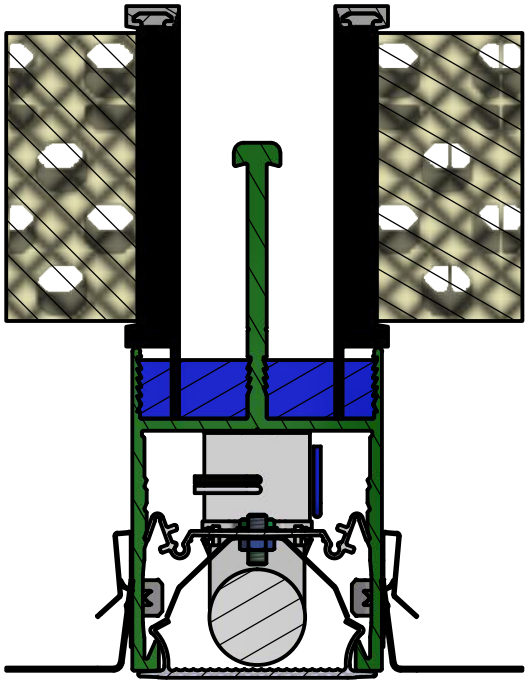

SECTION L-L
SCALE 1 / 2

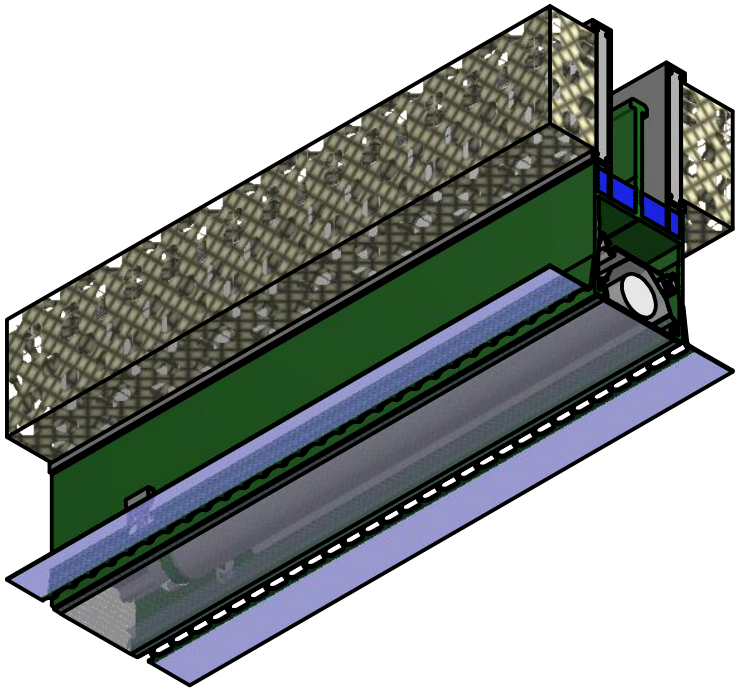

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
				2.6 Top Load Flush Light T8	
			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 18 OF 53

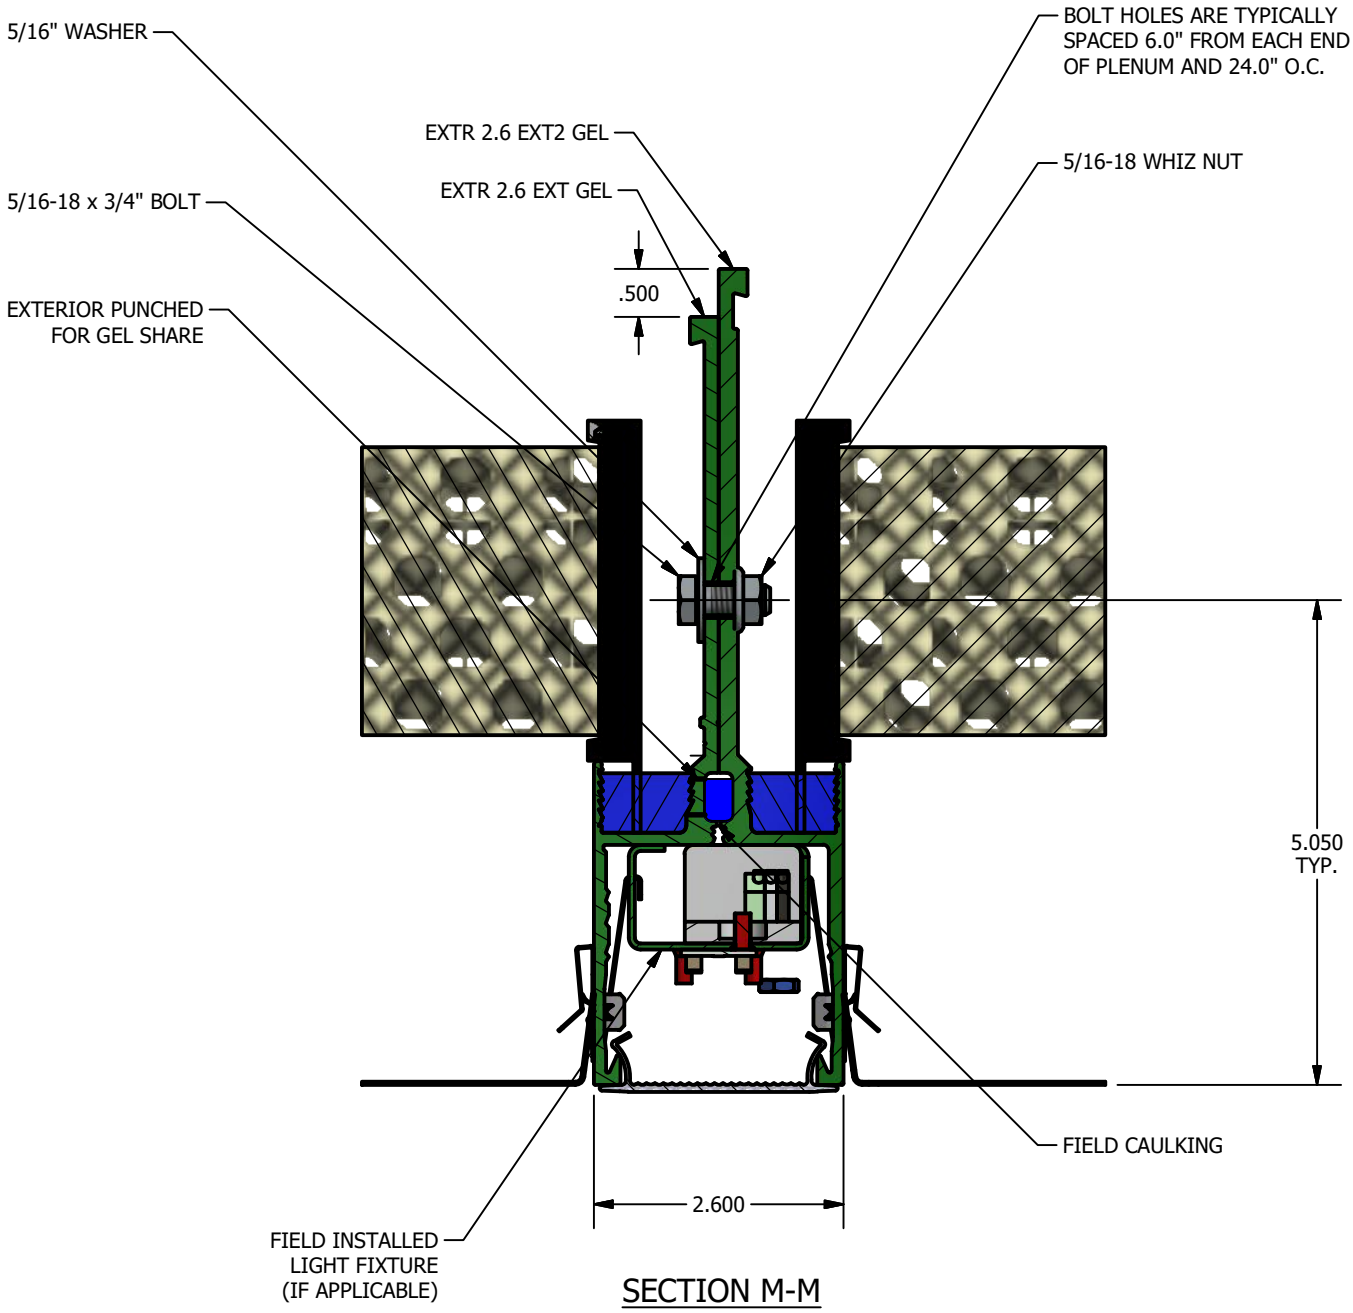


SECTION M-M
SCALE 1 / 2

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.: FILE NAME: 2.6TopLoad.idw	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958


2.6 Top Load Gel Grid

Gel-Link Module to Module Joint
Module Seam Lighting (If Applicable)

REV: 1

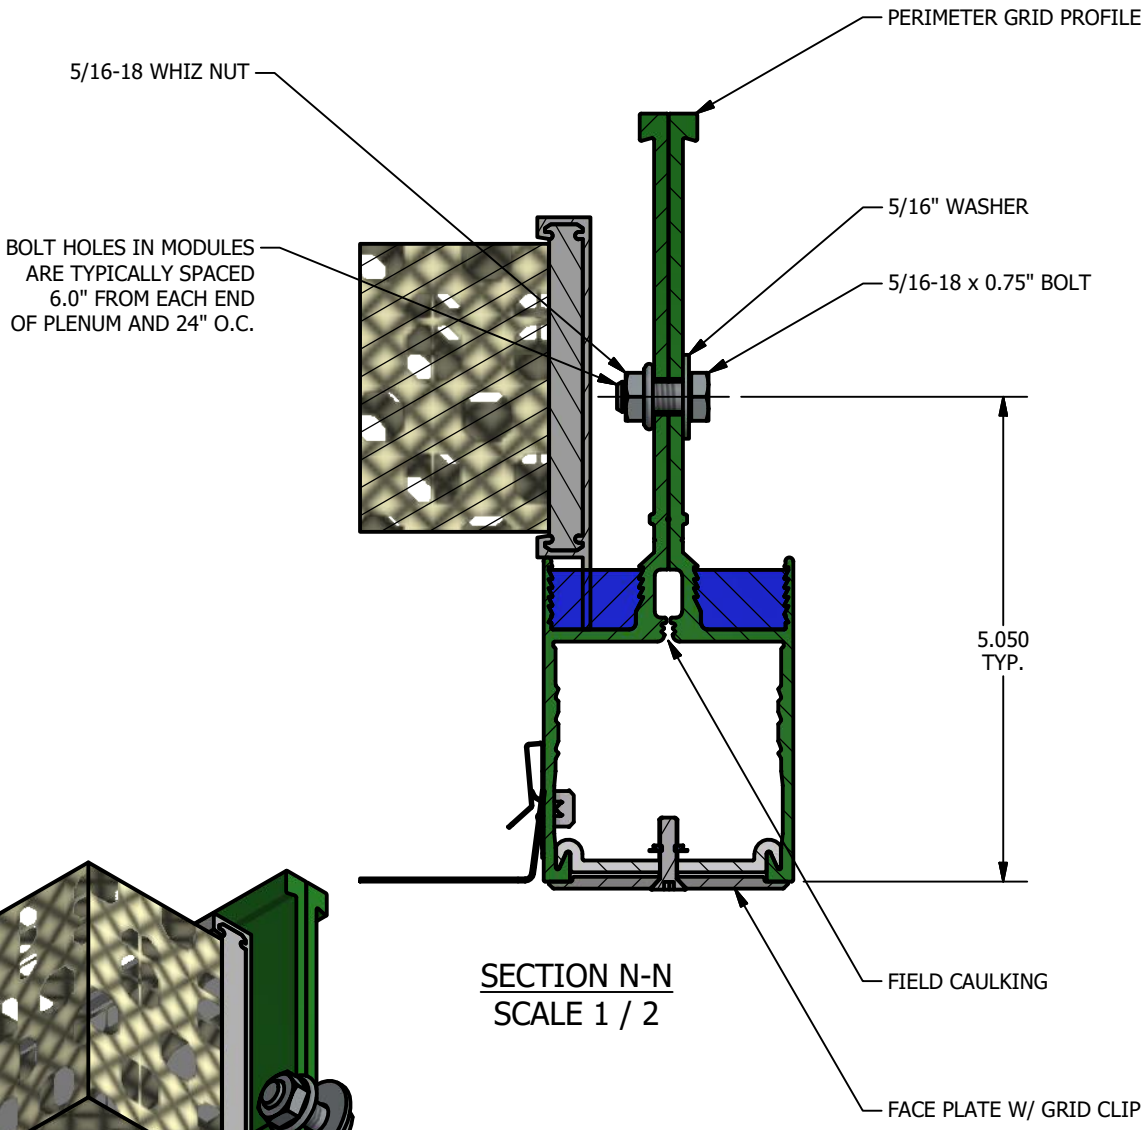



SECTION N-N
SCALE 1 / 2

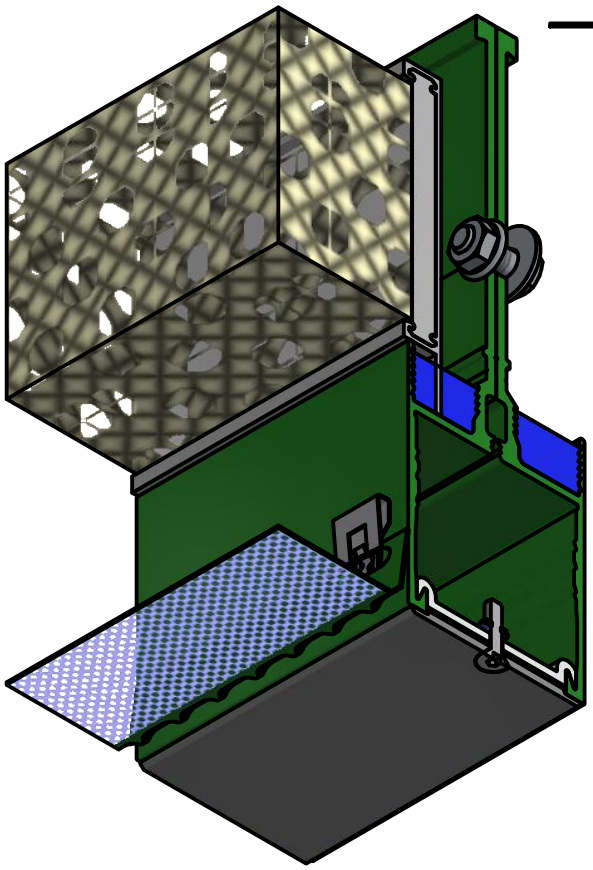

NOTES:
FIELD CUTTING OF PERIMETER GRID INCLUDING CORNER MITERS ARE TO BE DONE IN THE FIELD. SOME BOLT HOLES IN PERIMETER GRID PIECES WILL NEED TO BE CUSTOM DRILLED IN THE FIELD.

TOLERANCES UNLESS OTHERWISE SPECIFIED		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
FRACTIONS:	±1/32		ISSUED ON: 12/6/2018		2.6 Top Load Grid	
0.0:	±0.1		CHECKED BY:		Perimeter Grid	
0.00:	±0.03			JOB NO.:		
0.000:	±0.010		PART NO.:	FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 20 OF 53
ANGLES:	±0.5°					
OTHER: SEE DOC. QMS000.01A						

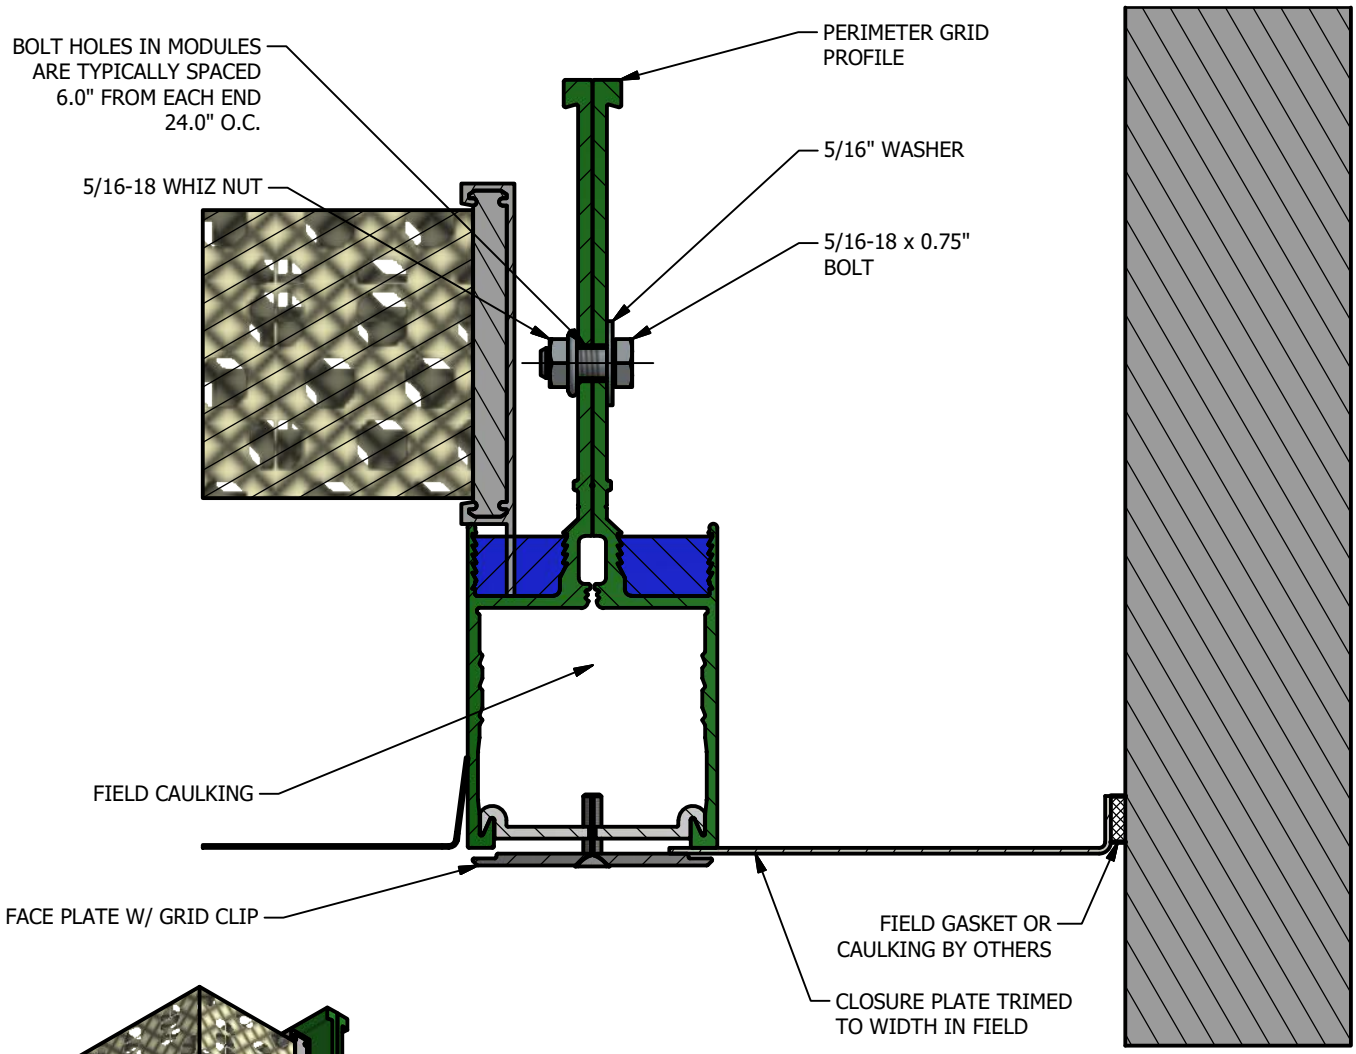


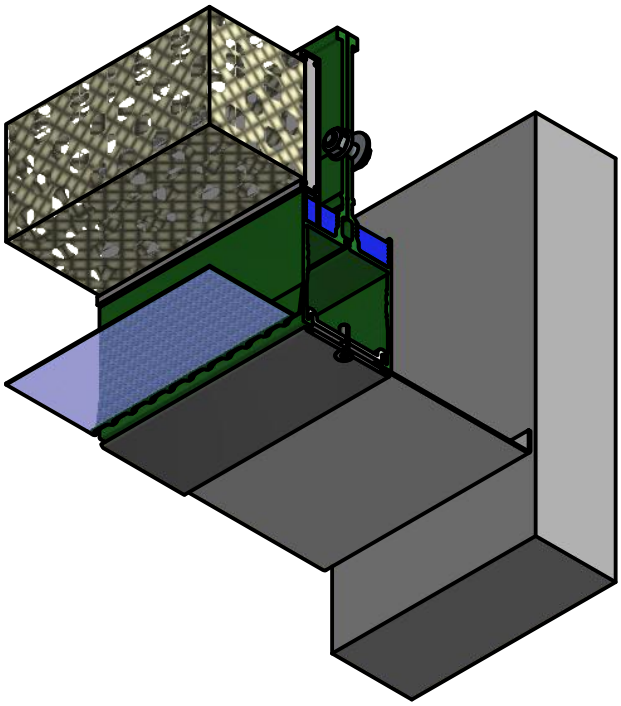

SECTION P-P
SCALE 1 / 2

NOTES:
FIELD CUTTING OF PERIMETER GRID INCLUDING CORNER MITERS ARE TO BE DONE IN THE FIELD. SOME BOLT HOLES IN PERIMETER GRID PIECES WILL NEED TO BE CUSTOM DRILLED IN THE FIELD.

TOLERANCES		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
UNLESS OTHERWISE SPECIFIED			ISSUED ON: 12/6/2018		2.6 Top Load Grid	
FRACTIONS:	±1/32		CHECKED BY:		Perimeter Grid w/ Closure Plate to Wall	
0.0:	±0.1			JOB NO.:		
0.00:	±0.03					
0.000:	±0.010		PART NO.:			
ANGLES:	±0.5°			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 21 OF 53
OTHER: SEE DOC. QMS000.01A						

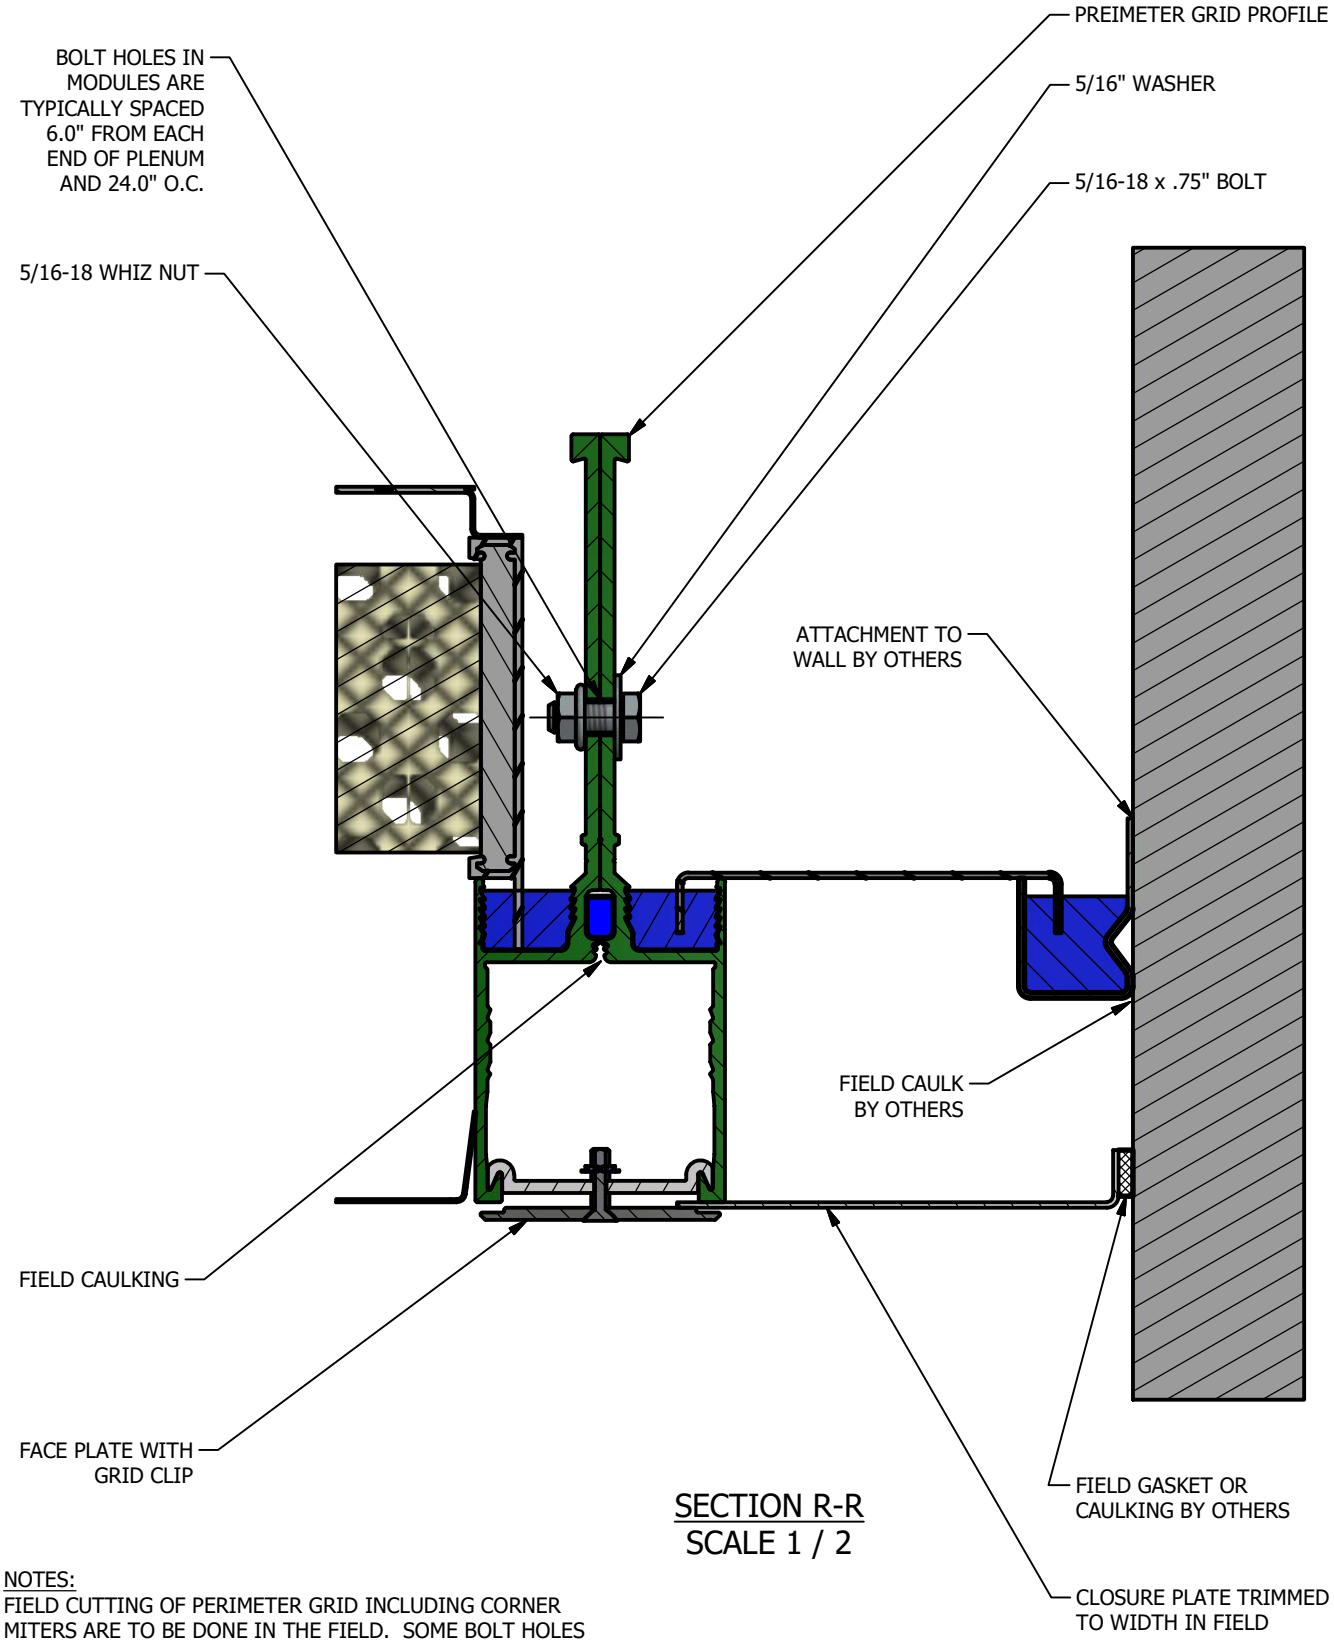


SECTION R-R
SCALE 1 / 2

NOTES:
FIELD CUTTING OF PERIMETER GRID INCLUDING CORNER MITERS ARE TO BE DONE IN THE FIELD. SOME BOLT HOLES IN PERIMETER GRID PIECES WILL NEED TO BE CUSTOM DRILLED IN THE FIELD.


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.: FILE NAME: 2.6TopLoad.idw	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958 REV: 1 SHEET 22 OF 53

2.6 Top Load Grid

Perimeter Grid w/ Closure Plate and Gel Sealed Functional Wall Closure

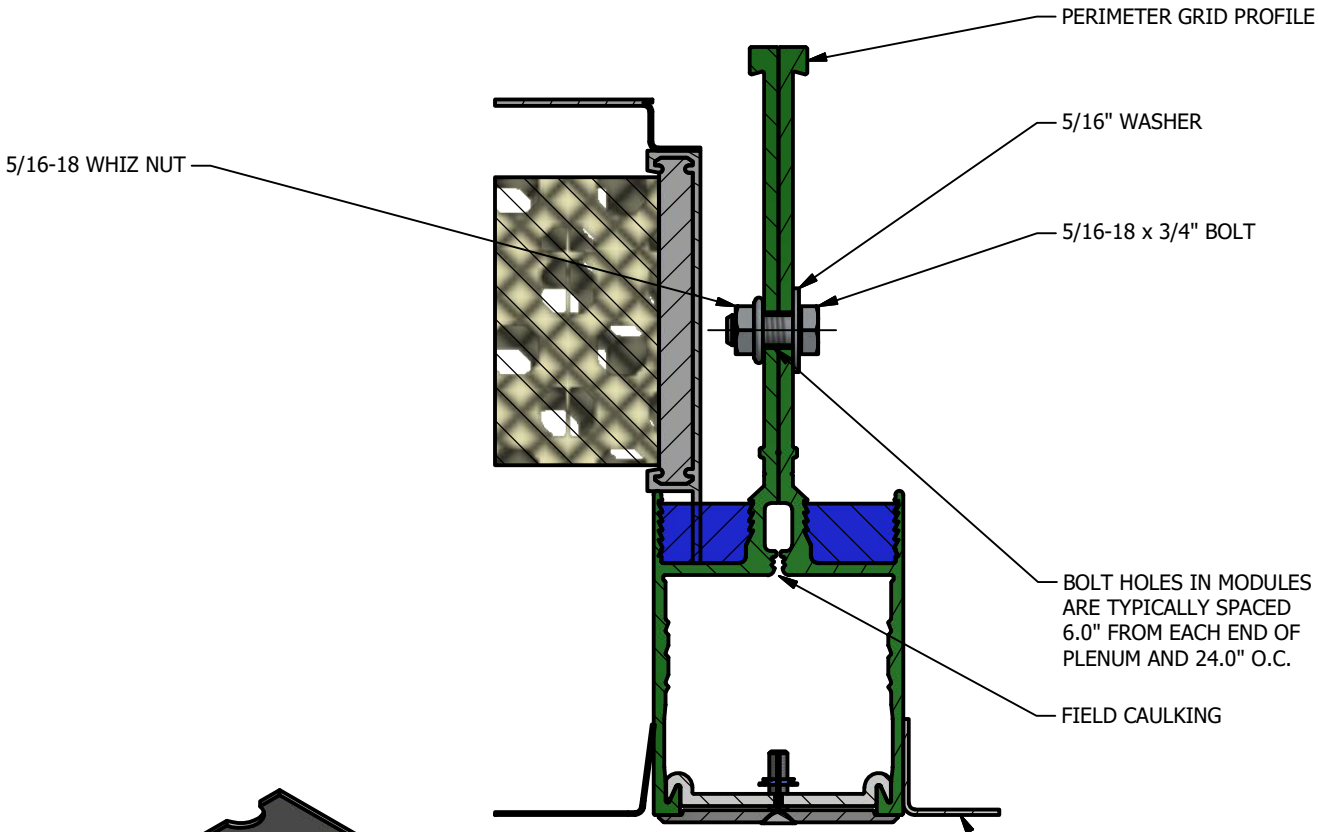



SECTION T-T
SCALE 1 / 2

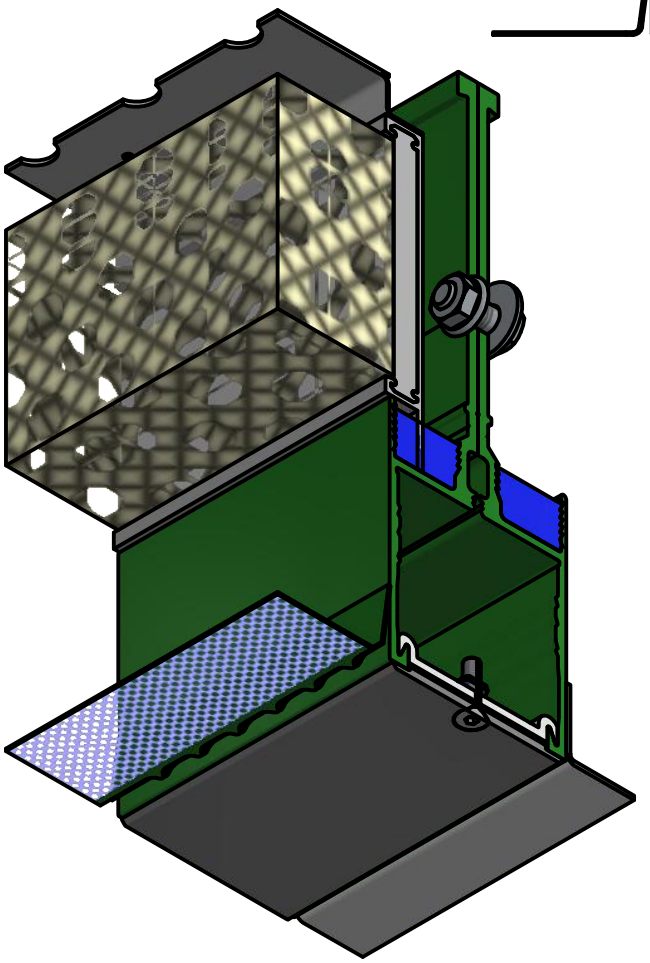

NOTES:
FIELD CUTTING OF PERIMETER GRID INCLUDING CORNER MITERS ARE TO BE DONE IN THE FIELD. SOME BOLT HOLES IN PERIMETER GRID PIECES WILL NEED TO BE CUSTOM DRILLED IN THE FIELD.

TOLERANCES		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:		NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
UNLESS OTHERWISE SPECIFIED			ISSUED ON: 12/6/2018	3rd ANGLE PROJECTION	2.6 Top Load Grid	
FRACTIONS:	±1/32		CHECKED BY:		Perimeter Grid w/ Angle Ledge	
0.0:	±0.1			JOB NO.:		
0.00:	±0.03		PART NO.:			
0.000:	±0.010			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 23 OF 53
ANGLES:	±0.5°					
OTHER: SEE DOC. QMS000.01A						

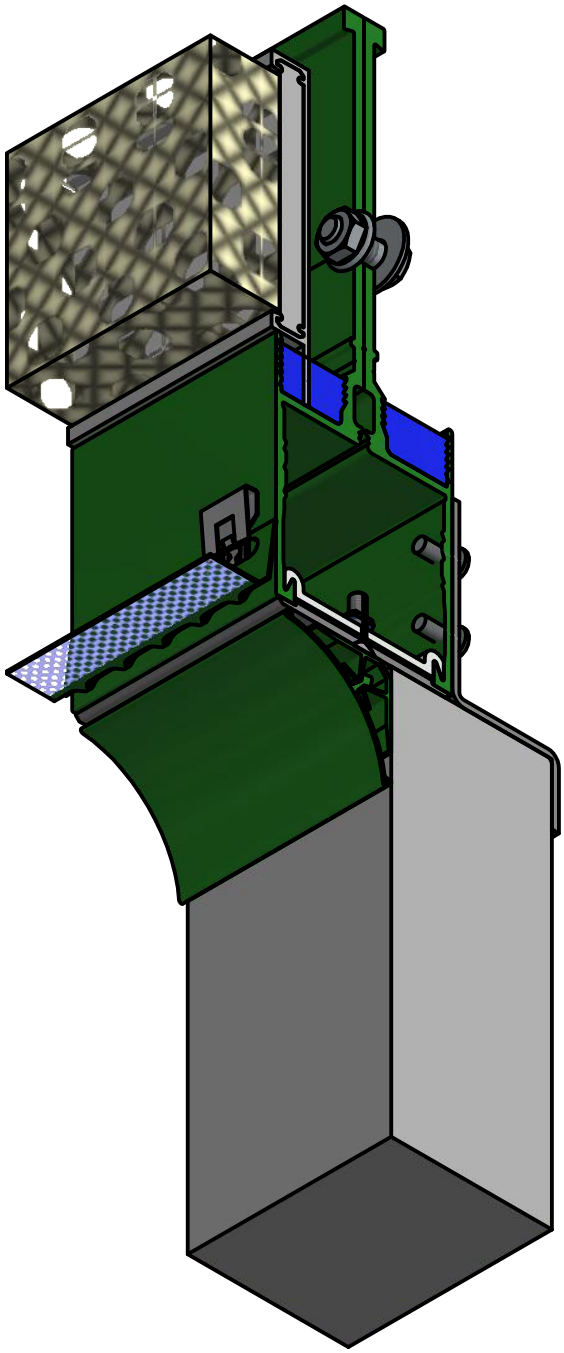


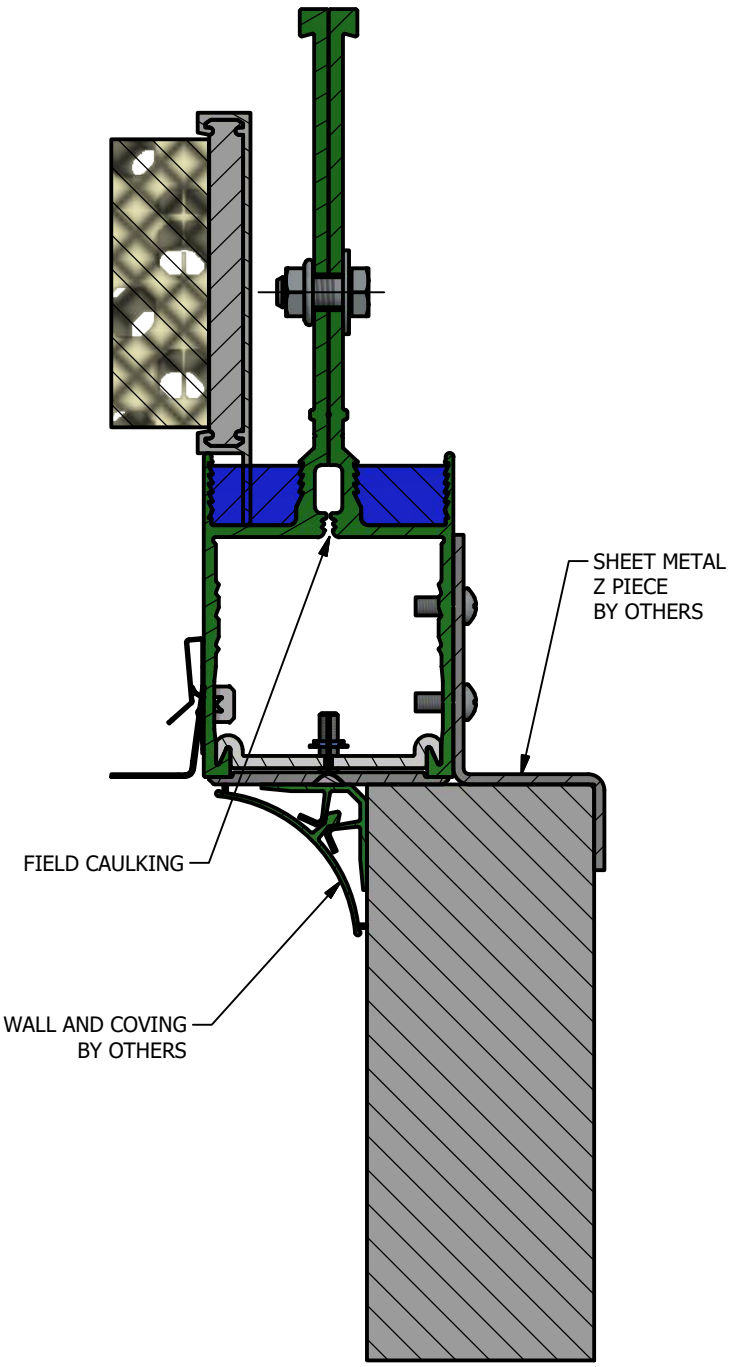


SECTION U-U
SCALE 1 / 2

NOTES:
FIELD CUTTING OF PERIMETER GRID INCLUDING CORNER MITERS ARE TO BE DONE IN THE FIELD. SOME BOLT HOLES IN PERIMETER GRID PIECES WILL NEED TO BE CUSTOM DRILLED IN THE FIELD.

TOLERANCES		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
UNLESS OTHERWISE SPECIFIED			ISSUED ON: 12/6/2018		2.6 Top Load Grid	
FRACTIONS:	±1/32		CHECKED BY:		Perimeter Grid Interface to Wall Coved	
0.0:	±0.1			JOB NO.:		
0.00:	±0.03					
0.000:	±0.010		PART NO.:	FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 24 OF 53
ANGLES:	±0.5°					
OTHER: SEE DOC. QMS000.01A						

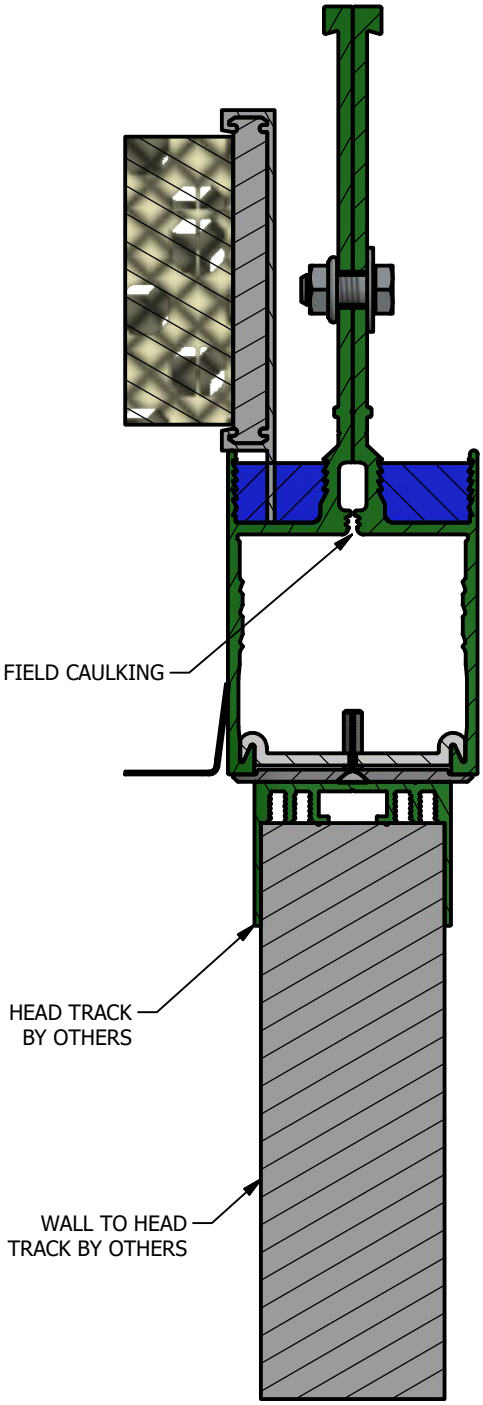


AT PERIMETER GRID SECTION V-V
SCALE 1 / 2

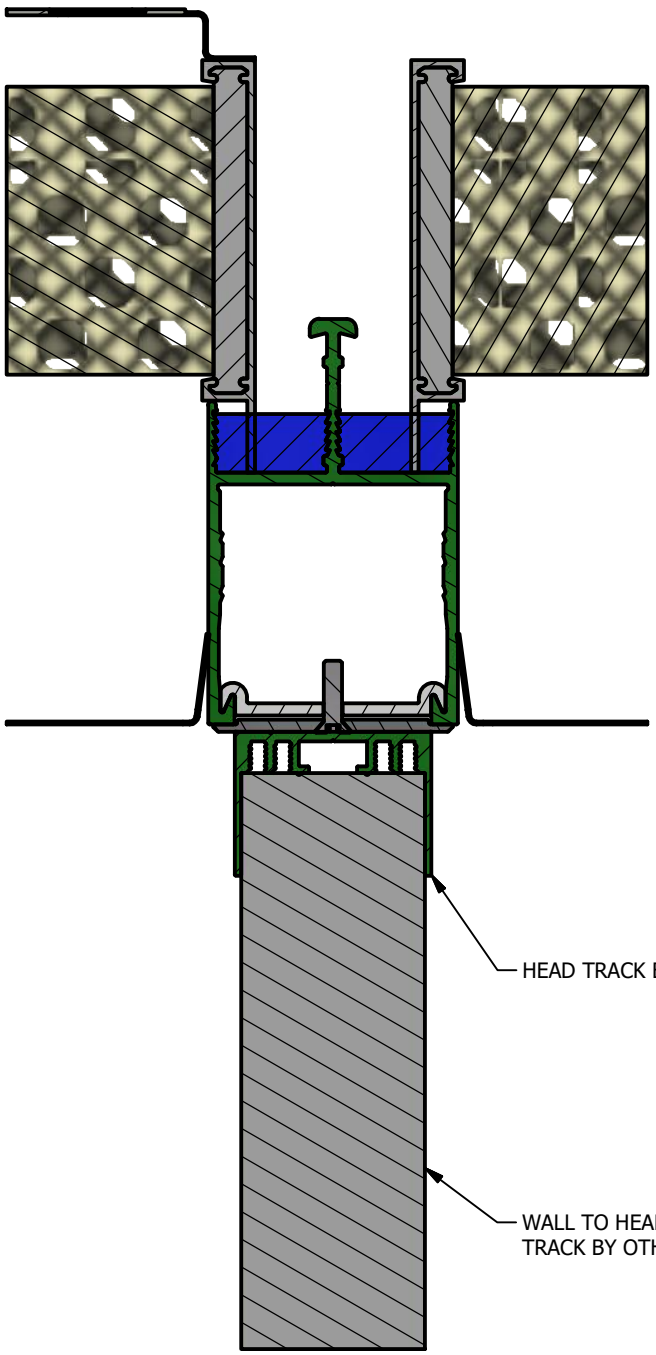


AT INTERIOR GRID SECTION W-W
SCALE 1 / 2


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.: FILE NAME: 2.6TopLoad.idw	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958 2.6 Top Load Grid w/ Wall Interface REV: 1 SHEET 25 OF 53	

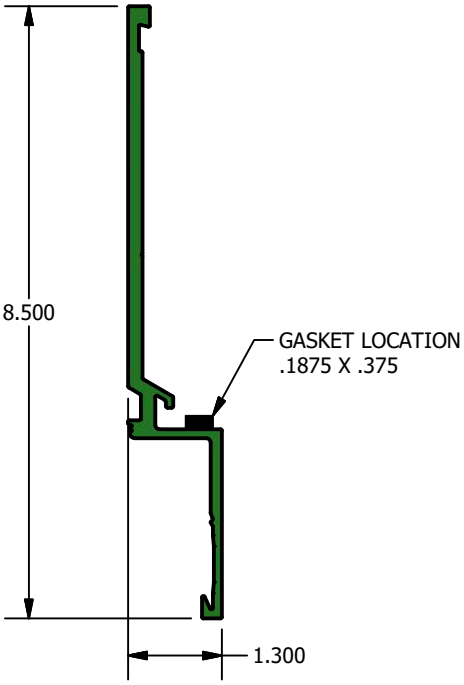

GASKET EXTERIOR EXTRUSION
SCALE .375

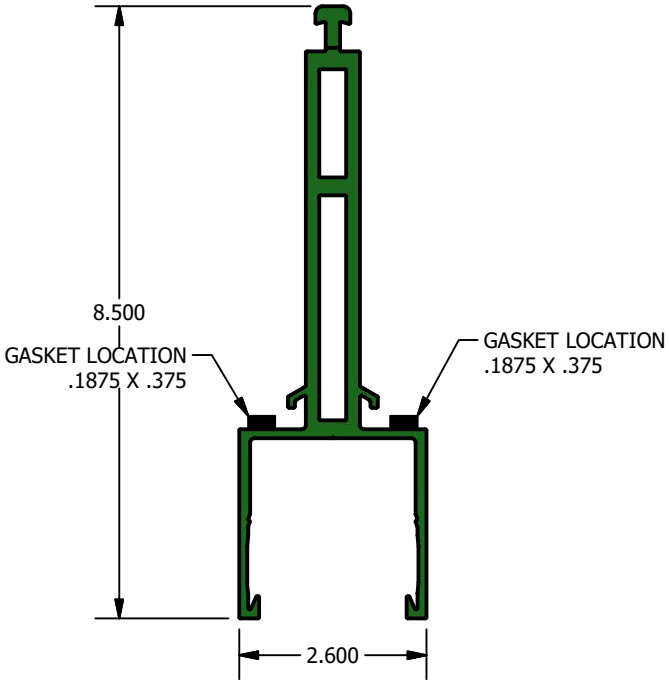


GASKET TUBE TOP II INTERIOR EXTRUSION
SCALE .375

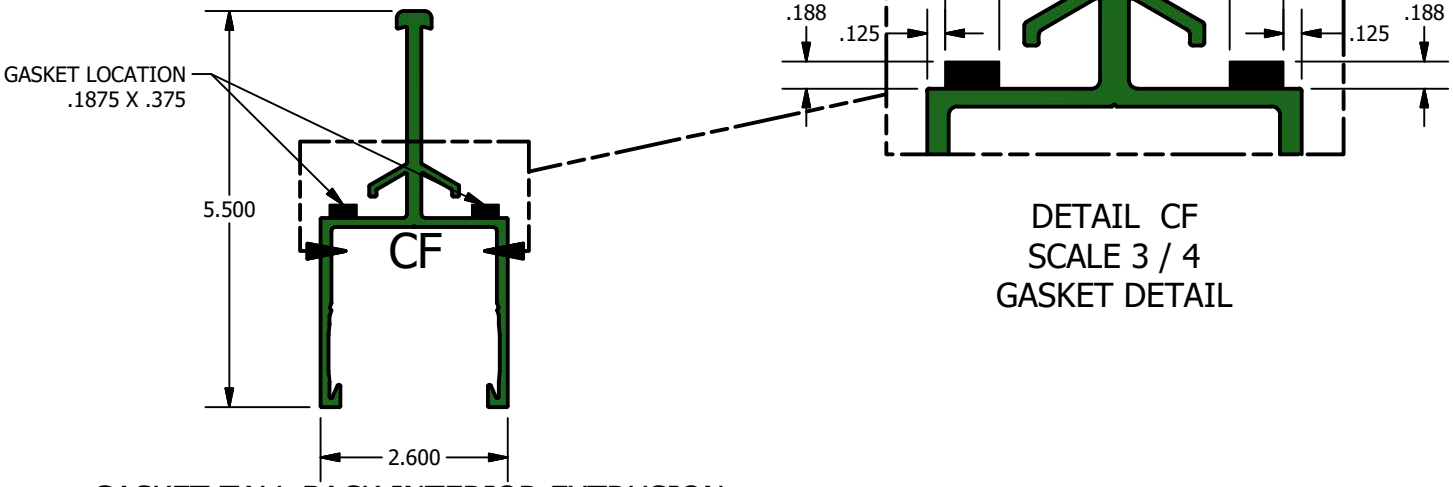


GASKET TALL BACK INTERIOR EXTRUSION
SCALE .375


DETAIL CF
SCALE 3 / 4
GASKET DETAIL

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
				2.6 TOP LOAD GASKET GRID TOP LOAD GASKET LOCATION	
			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 26 OF 53

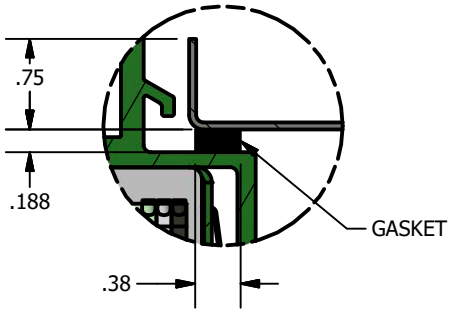


DETAIL CA
BLANK ACCESSORY GASKET

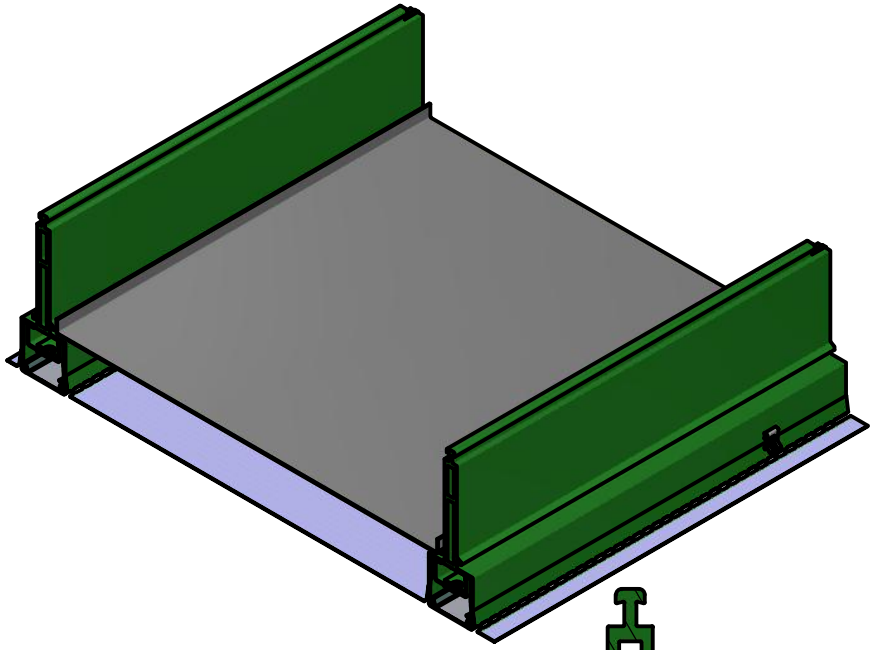


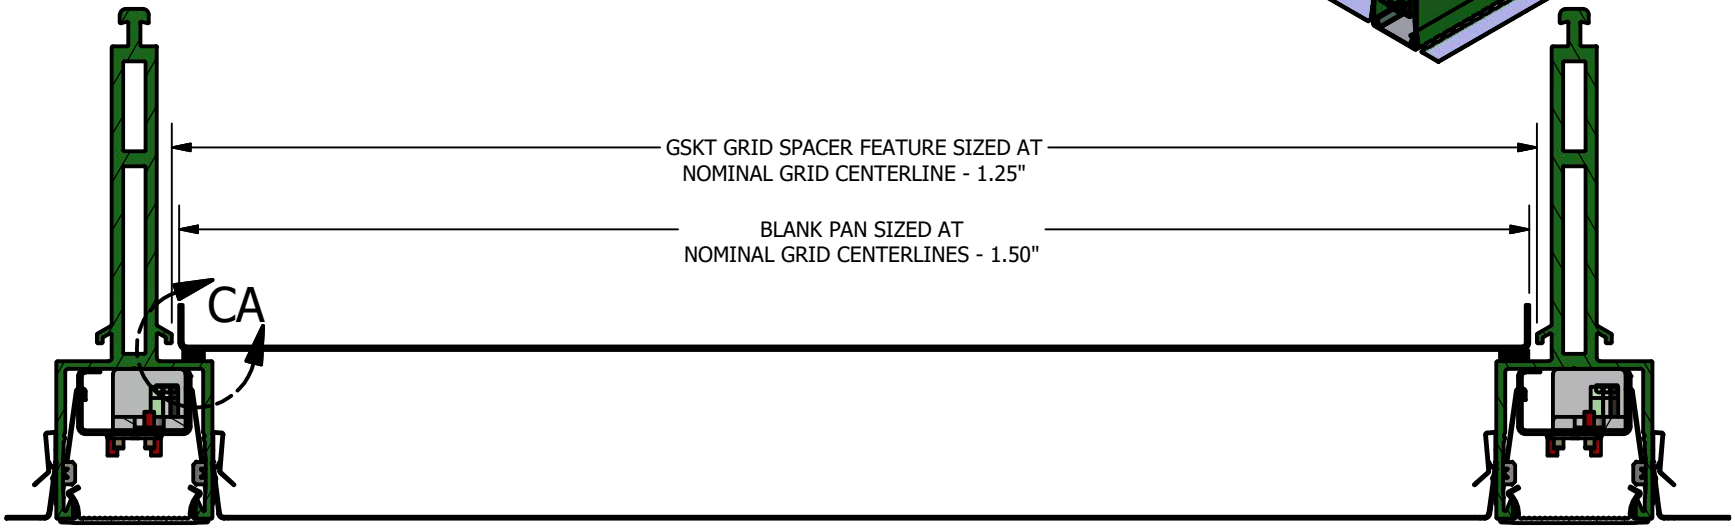

SECTION Y-Y
SCALE 5/16


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958	2.6 Top Load Gasketed Grid Top Load Blank Pan Gasket
			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 27 OF 53

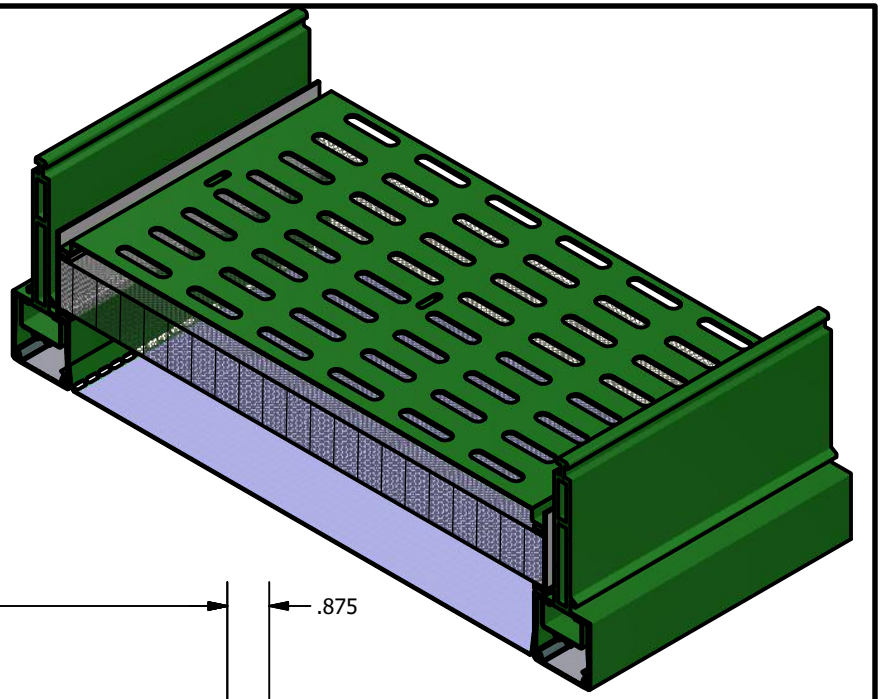


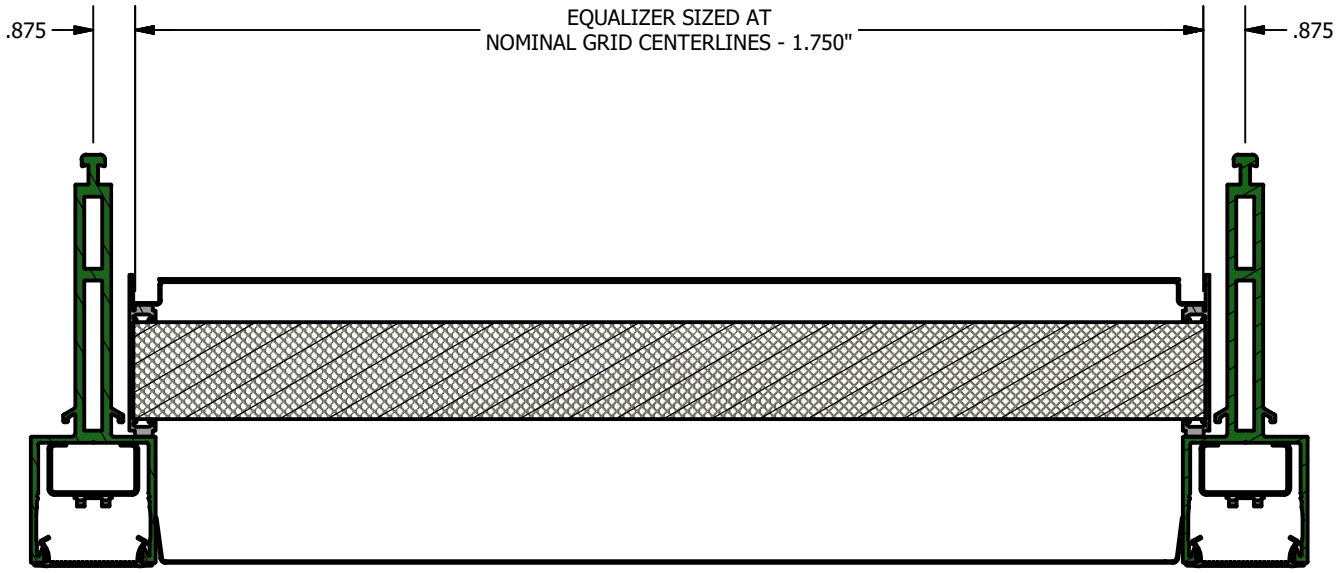

SECTION BM-BM
SCALE 1/4

TOLERANCES		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
UNLESS OTHERWISE SPECIFIED			ISSUED ON: 12/6/2018		2.6 TOP LOAD GSKT	
FRACTIONS:	±1/32		CHECKED BY:		EQUALIZER ON TOP LOAD GASKET FILTER	
0.0:	±0.1			JOB NO.:		
0.00:	±0.03					
0.000:	±0.010		PART NO.:			
ANGLES:	±0.5°			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 28 OF 53
OTHER: SEE DOC. QMS000.01A						

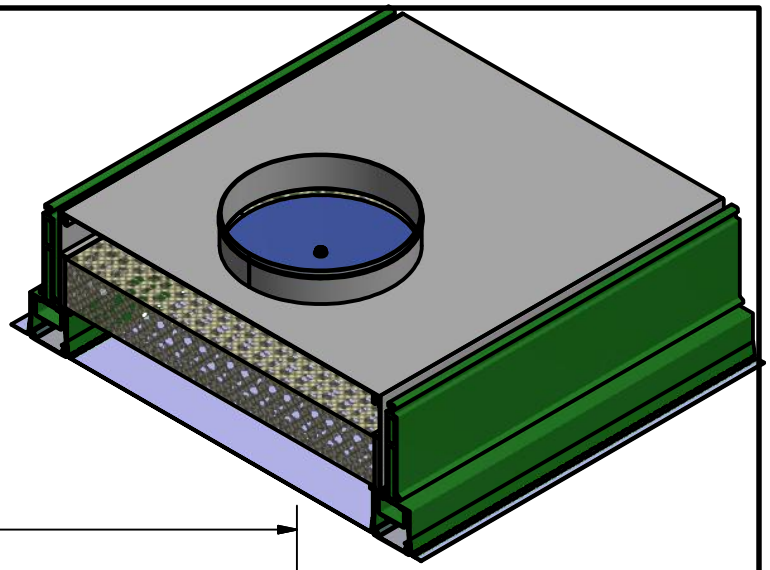


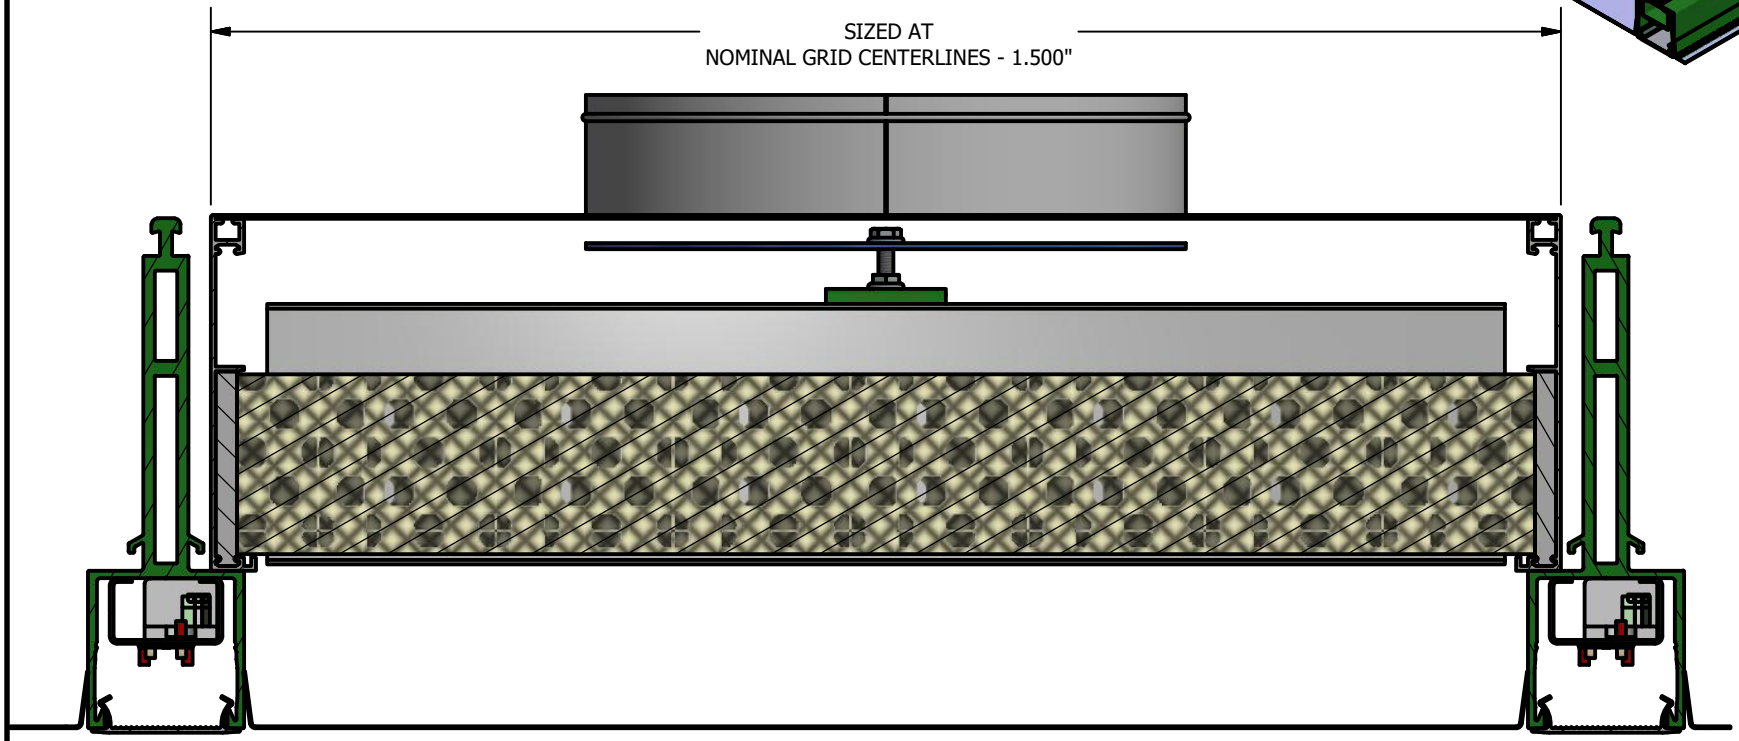

SECTION AA-AA
SCALE 5/16


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.: FILE NAME: 2.6TopLoad.idw	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958 REV: 1 SHEET 29 OF 53

2.6 Top Load
Gasketed Grid Filter Top Load Terminal
Ducted Filter Style

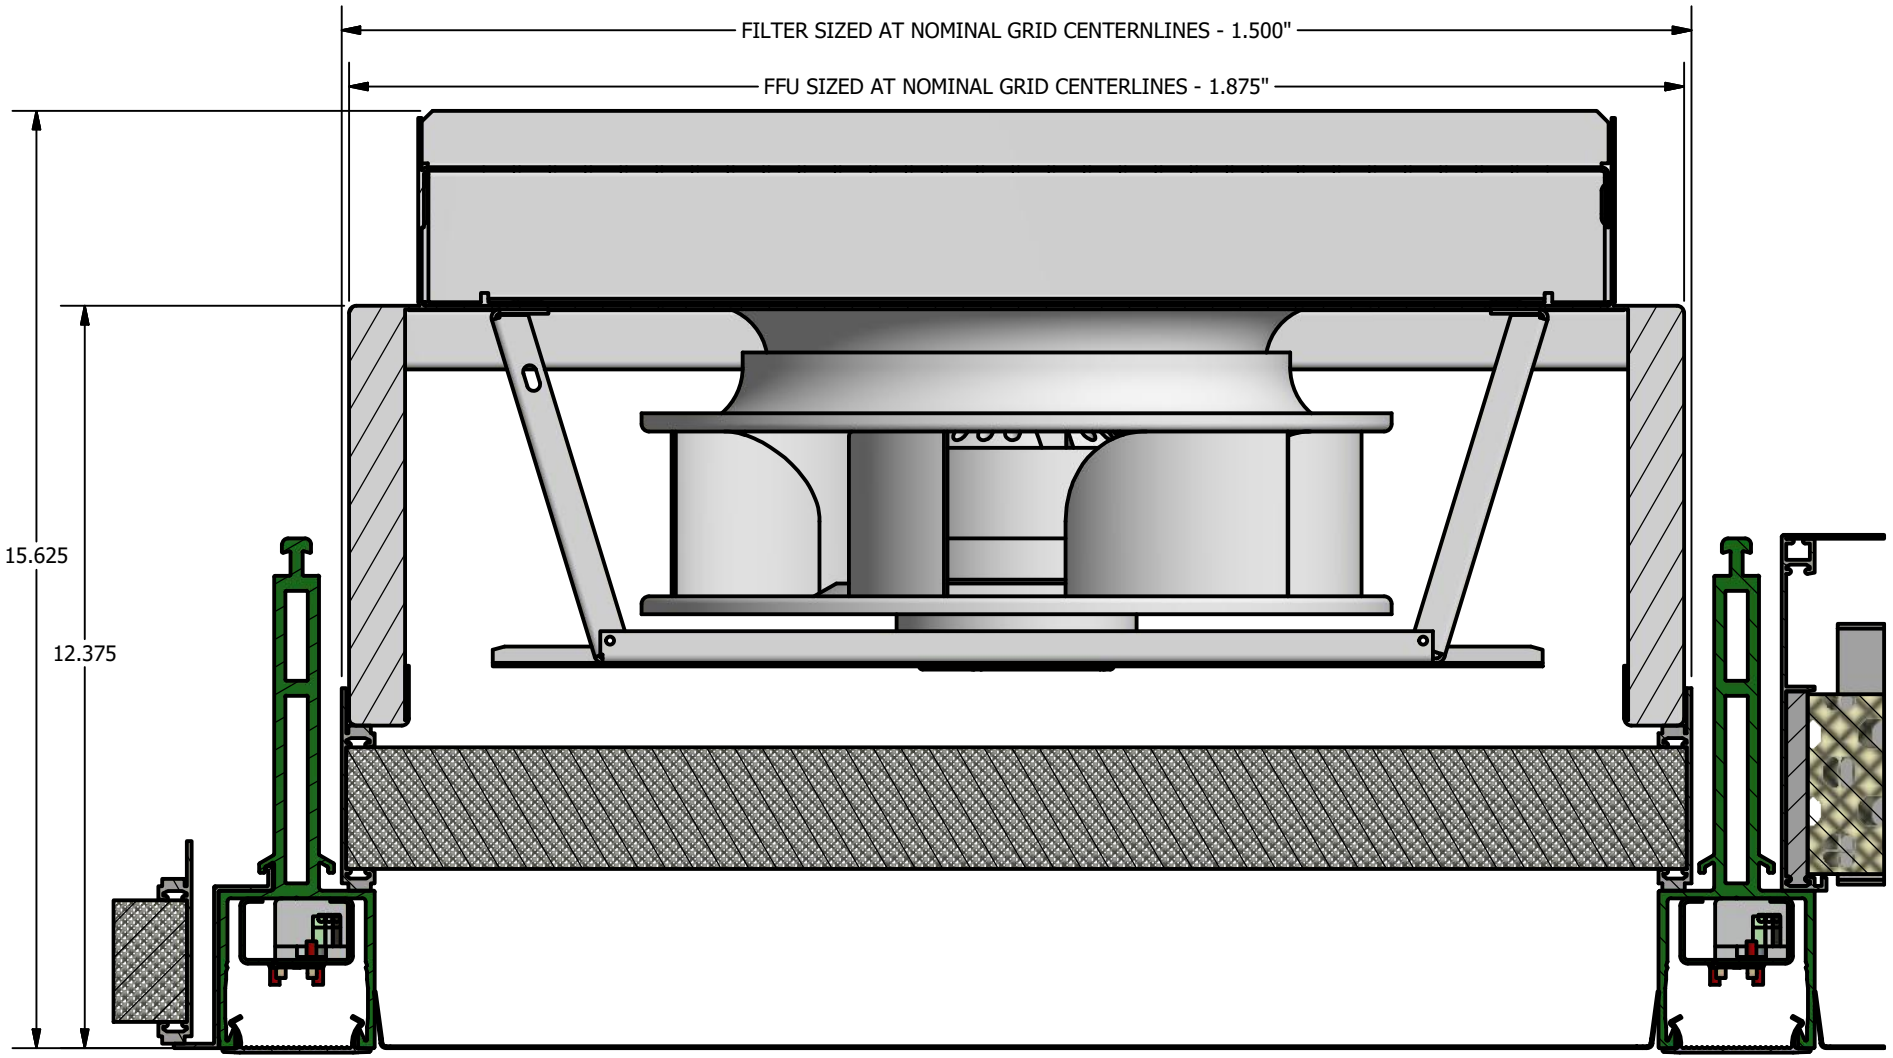

SECTION AB-AB
SCALE 5/16

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.: FILE NAME: 2.6TopLoad.idw	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958 2.6 Top Load Gasketed Grid FFU on Top Load Plenum Style Filter w/ Top Flange REV: 1 SHEET 30 OF 53

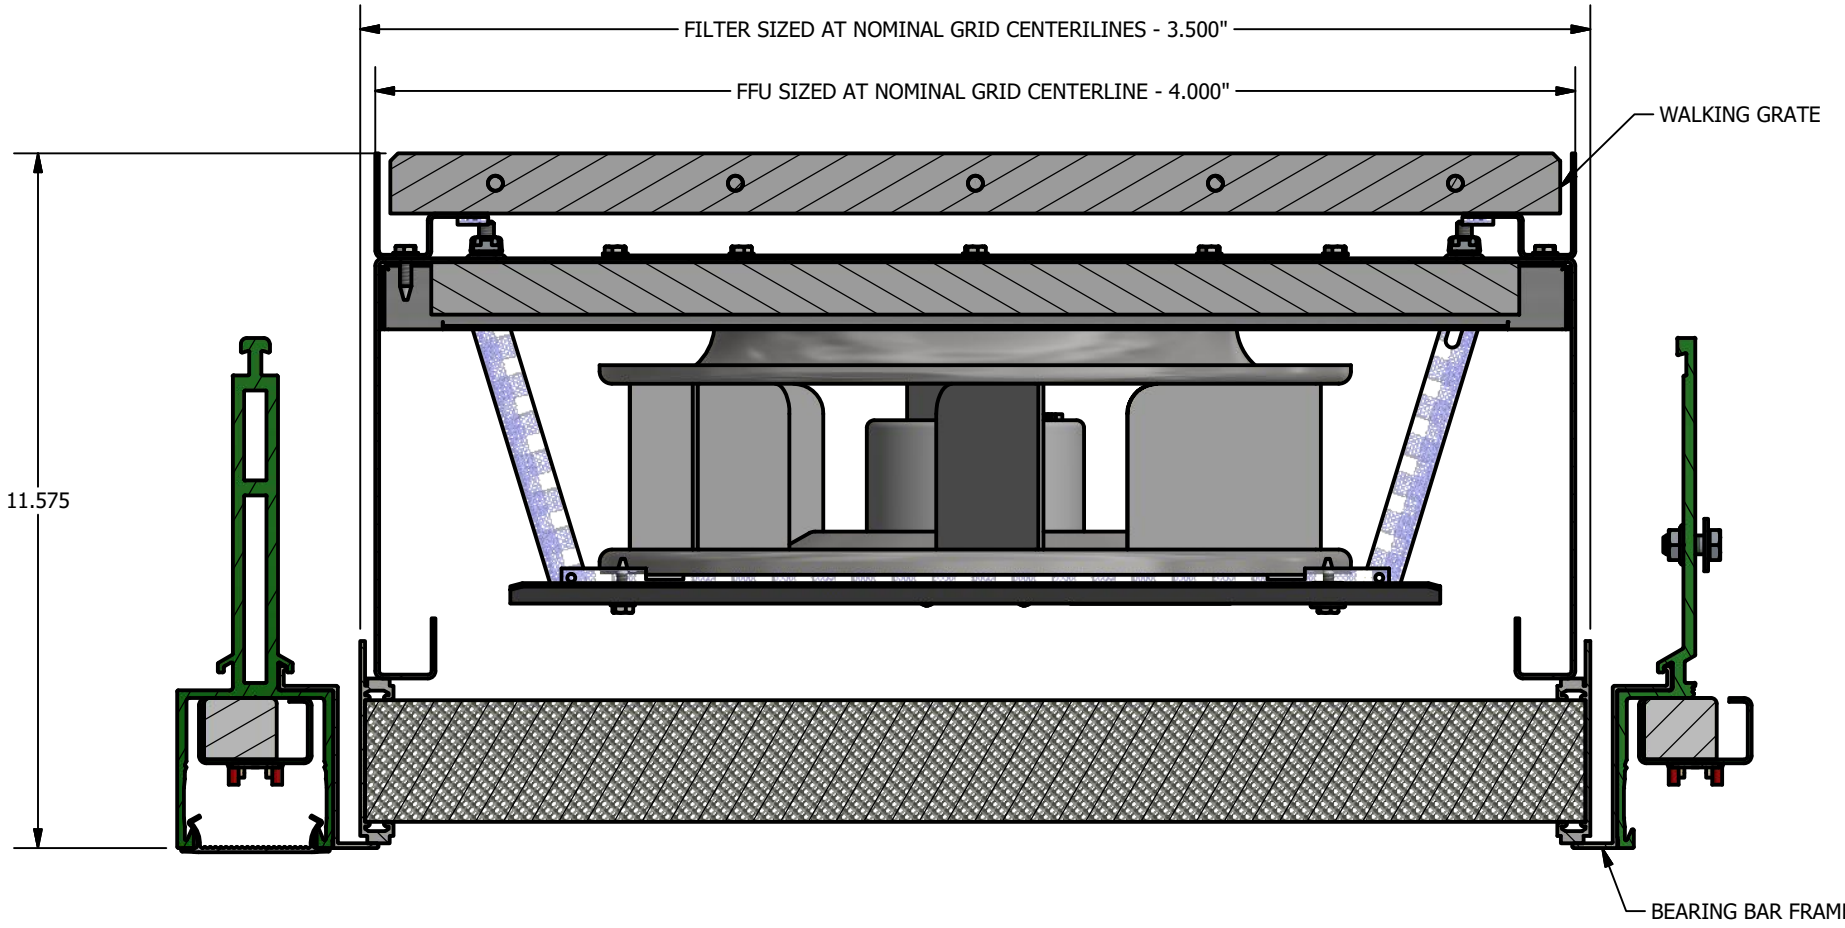


SECTION BY-BY
SCALE 5/16

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958


2.6 TOP LOAD

Gasketed Grid Walkable Grating FFU on Top Load Plenum Style Filter & Bearing Bar Frame


FILE NAME: 2.6TopLoad.idw | REV: 1 | SHEET 31 OF 53

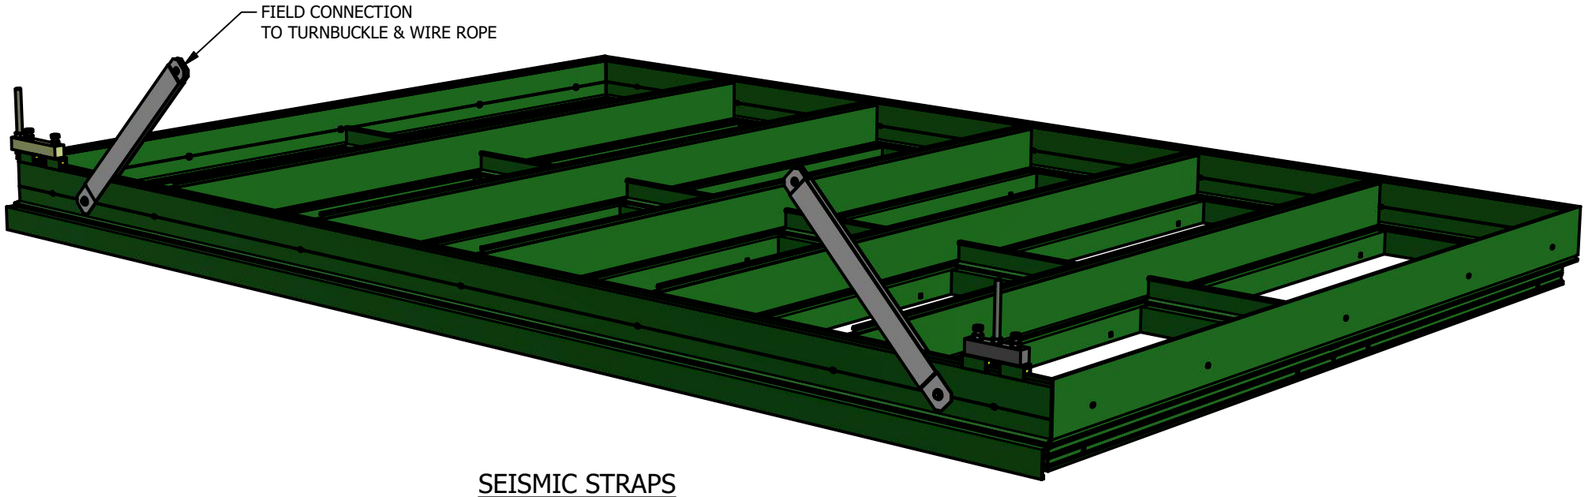

SEISMIC STRAPS

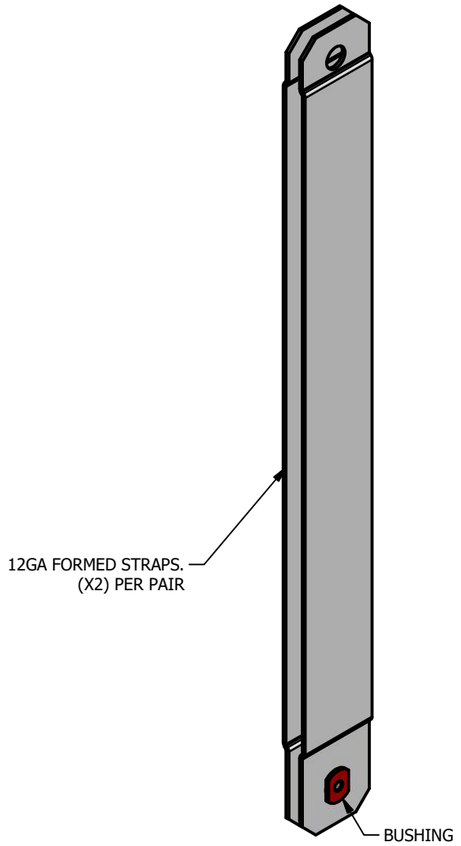


ISOMETRIC VIEW- SEISMIC STRAPS

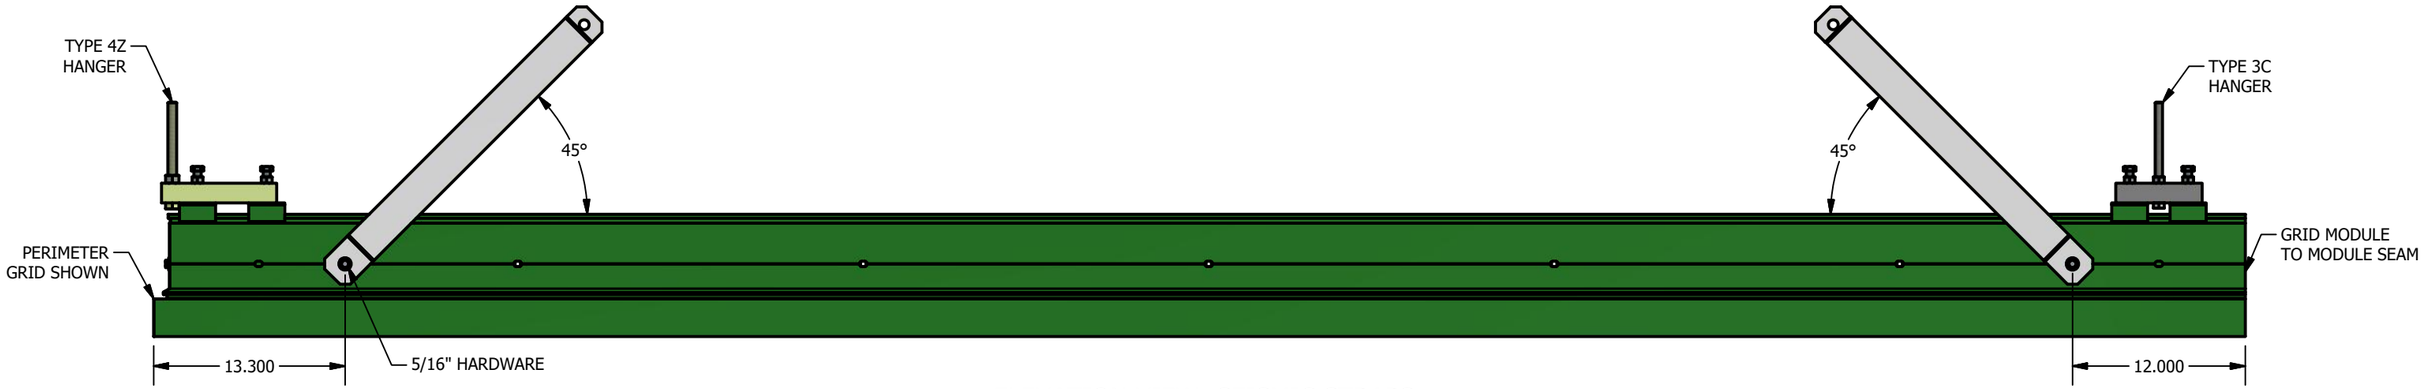


ELEVATION VIEW- SEISMIC STRAPS


TOLERANCES UNLESS OTHERWISE SPECIFIED		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
FRACTIONS:	±1/32		ISSUED ON: 12/6/2018		SEISMIC CONNECTIONS	
0.0:	±0.1		CHECKED BY:		SEISMIC STRAP OPTIONS	
0.00:	±0.03		PART NO.:	JOB NO.:		
0.000:	±0.010			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 32 OF 53
ANGLES:	±0.5°					
OTHER: SEE DOC. QMS000.01A						

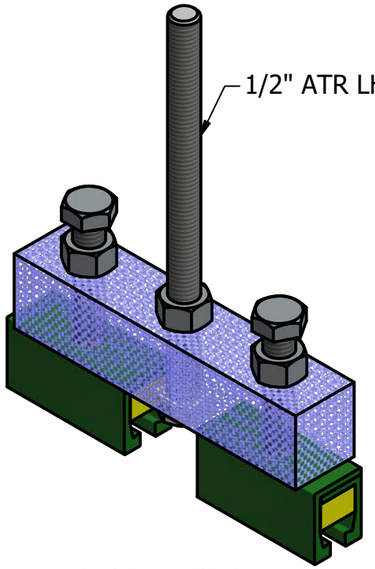


TYPE 3B HANGER

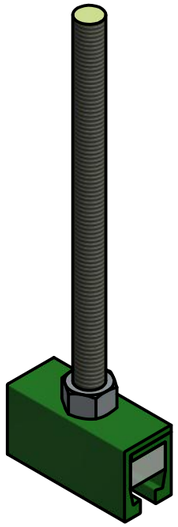


TYPE 2B HANGER

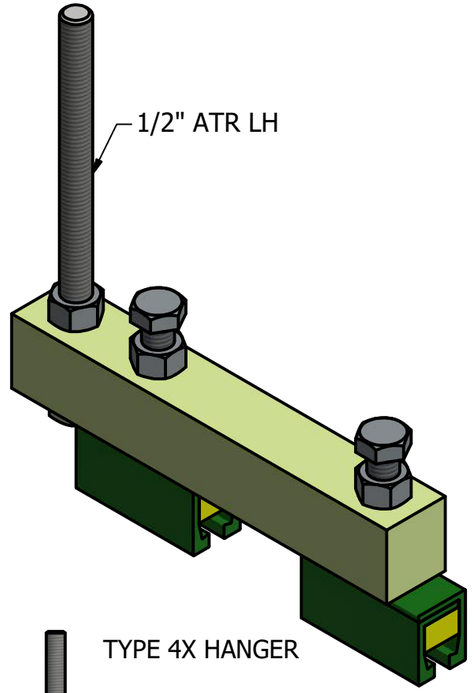


TYPE 4X HANGER

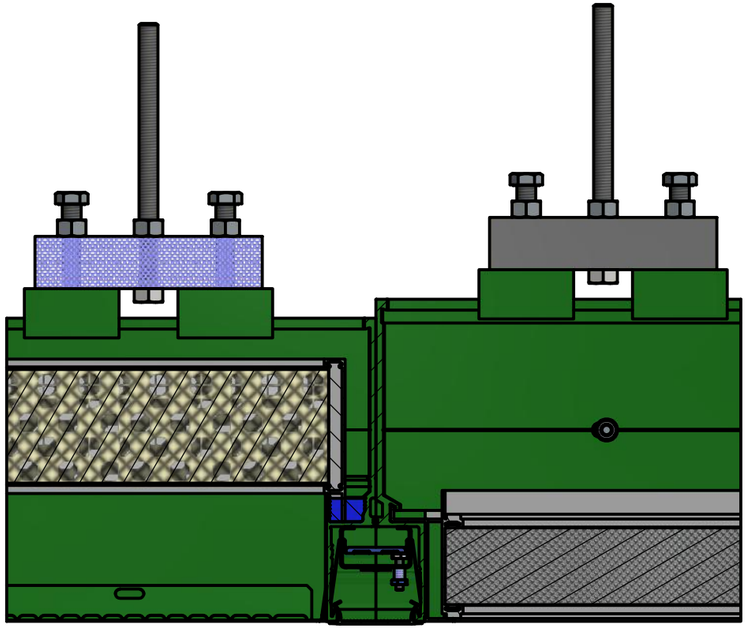

SECTION AC-AC
TYPE 3B HANGER GRID TO GRID
LOAD CAPACITY: 3.75 Kips

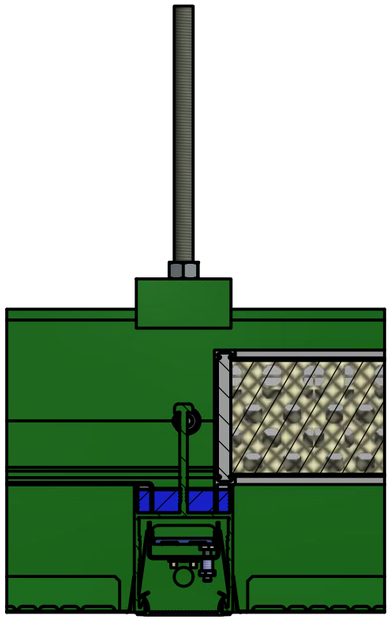

SECTION AD-AD
TYPE 2B HANGER MIDSPAN
LOAD CAPACITY: 3.75 Kips

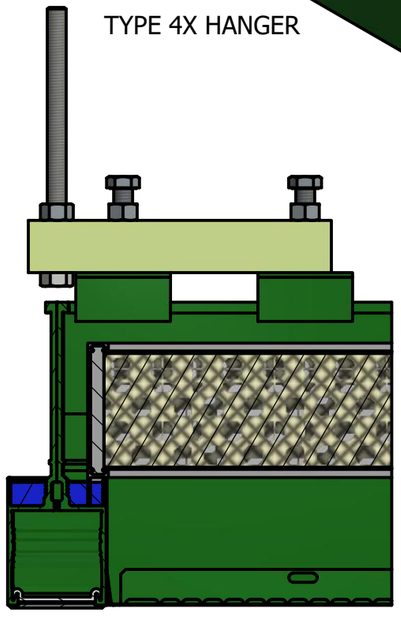

SECTION AE-AE
TYPE 4X HANGER CORNER
LOAD CAPACITY: 2.75 Kips

TOLERANCES UNLESS OTHERWISE SPECIFIED	
FRACTIONS: ±1/32	
0.0: ±0.1	
0.00: ±0.03	
0.000: ±0.010	
ANGLES: ±0.5°	
OTHER: SEE DOC. QMS000.01A	

THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS

DRAWN BY:

ISSUED ON: 12/6/2018

CHECKED BY:

PART NO.:

3rd ANGLE PROJECTION


JOB NO.:

FILE NAME: 2.6TopLoad.idw


NORTEK™
CLEANROOM SOLUTIONS
CLEANPAK
19855 SW 124th AVE.
TUALATIN, OR 97062
Phone (503) 639-0113
Fax (503) 692-0958

Typical Hangers
1/2" ATR


REV: 1

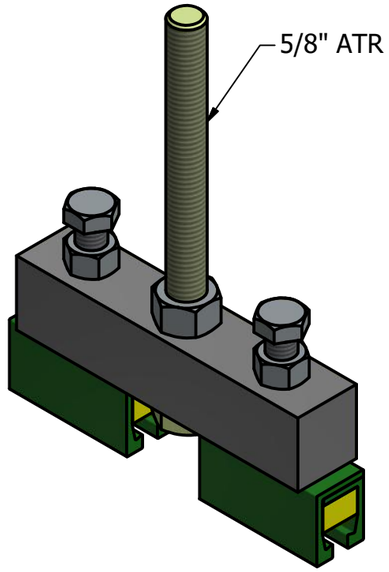


TYPE 3C HANGER

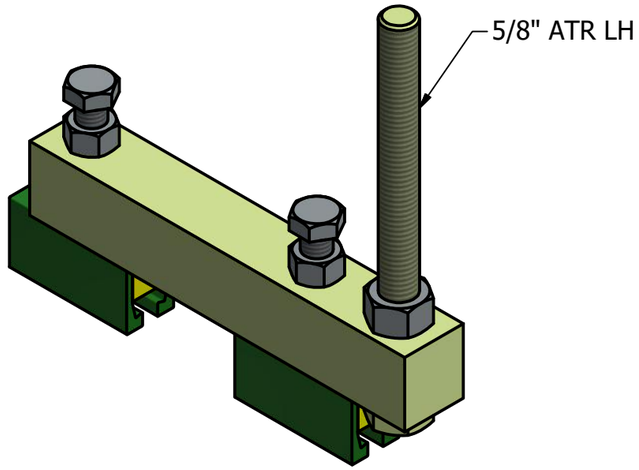


TYPE 4Z HANGER

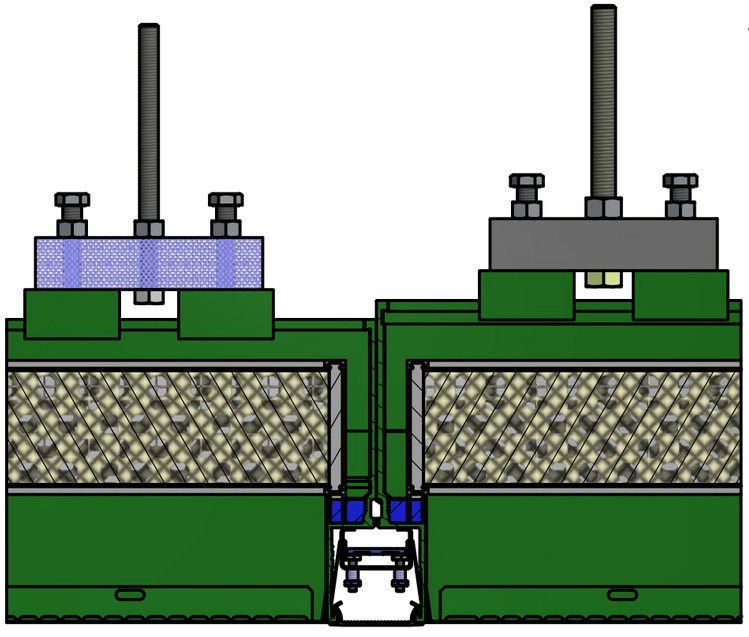

SECTION AF-AF
TYPE 3C HANGER GRID TO GRID
LOAD CAPACITY: 6.97 Kips

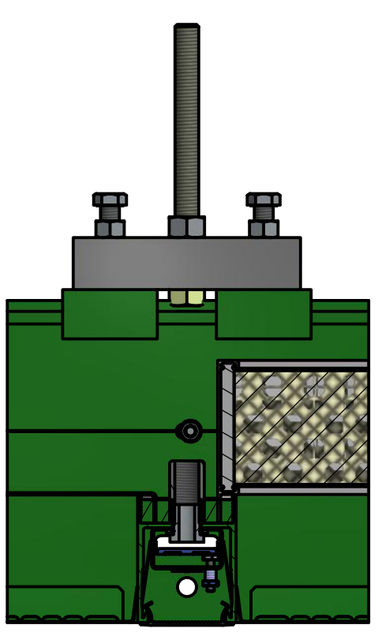



SECTION AG-AG
TYPE 3C HANGER MIDSPAN
LOAD CAPACITY: 6.97 Kips

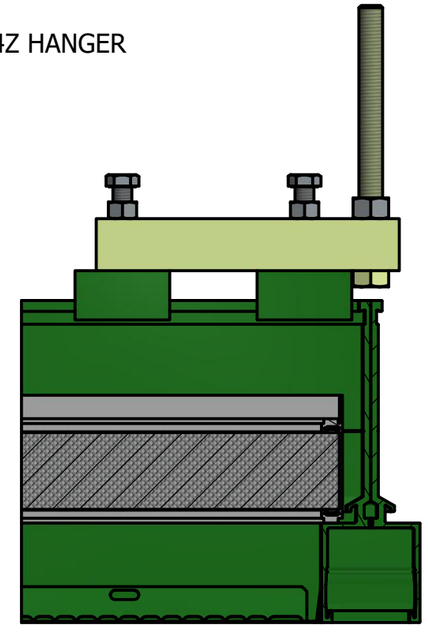

SECTION AH-AH
TYPE 4Z HANGER CORNER
LOAD CAPACITY: 2.75 Kips

TOLERANCES UNLESS OTHERWISE SPECIFIED		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
FRACTIONS:	±1/32		ISSUED ON: 12/6/2018		Typical Hangers 5/8" ATR	
0.0:	±0.1		CHECKED BY:			
0.00:	±0.03			JOB NO.:		
0.000:	±0.010		PART NO.:	FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 34 OF 53
ANGLES:	±0.5°					
OTHER: SEE DOC. QMS000.01A						

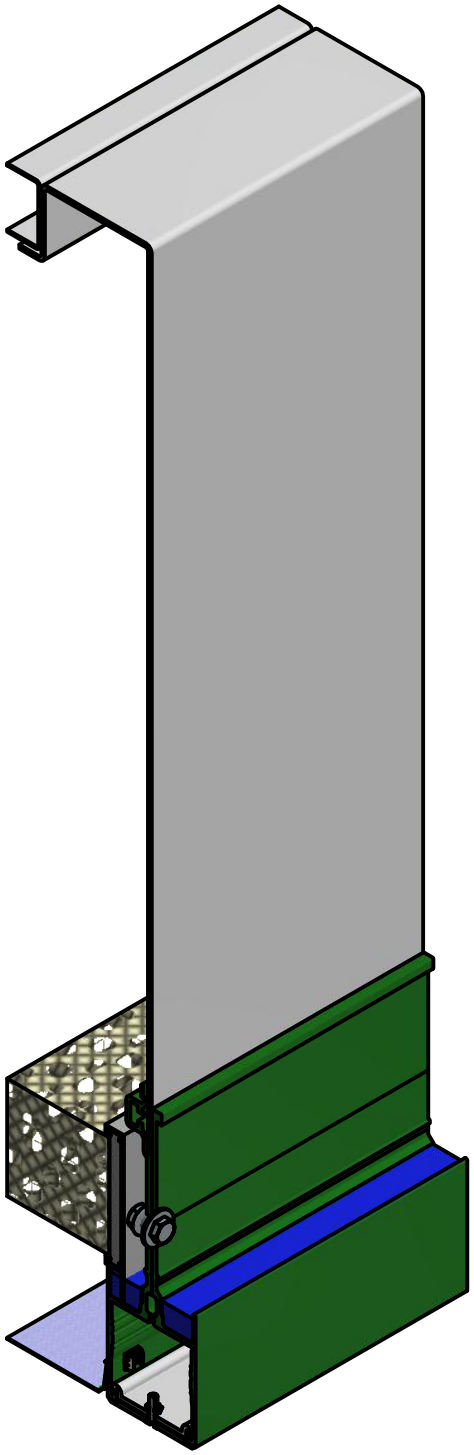

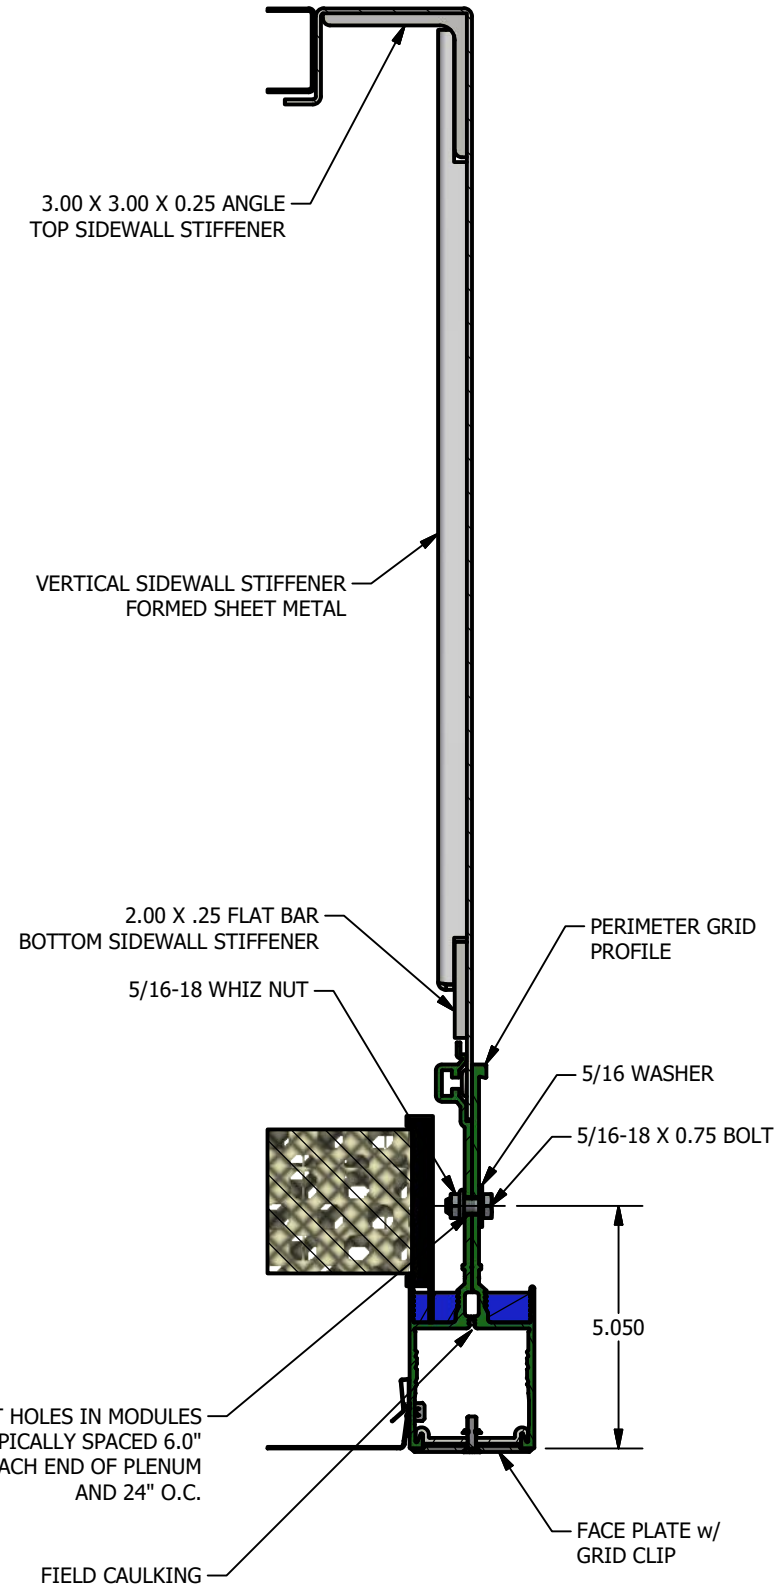

SECTION AJ-AJ
SCALE 1 / 4

NOTE:
FIELD CUTTING OF PERIMETER GRID INCLUDING CORNER MITERS ARE TO BE DONE IN THE FIELD. BOLT HOLES IN PERIMETER GRID PIECES WILL NEED TO BE CUSTOM DRILLED IN THE FIELD.

TOLERANCES	
UNLESS OTHERWISE SPECIFIED	
FRACTIONS:	±1/32
0.0:	±0.1
0.00:	±0.03
0.000:	±0.010
ANGLES:	±0.5°
OTHER:	
SEE DOC. QMS000.01A	

THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS

DRAWN BY:

ISSUED ON: 12/6/2018

CHECKED BY:

PART NO.:

3rd ANGLE PROJECTION


JOB NO.:


FILE NAME: 2.6TopLoad.idw

NORTEK CLEANROOM SOLUTIONS CLEANPAK
19855 SW 124th AVE.
TUALATIN, OR 97062
Phone (503) 639-0113
Fax (503) 692-0958

2.6 Top Load Plenum
Perimeter Grid

REV: 1

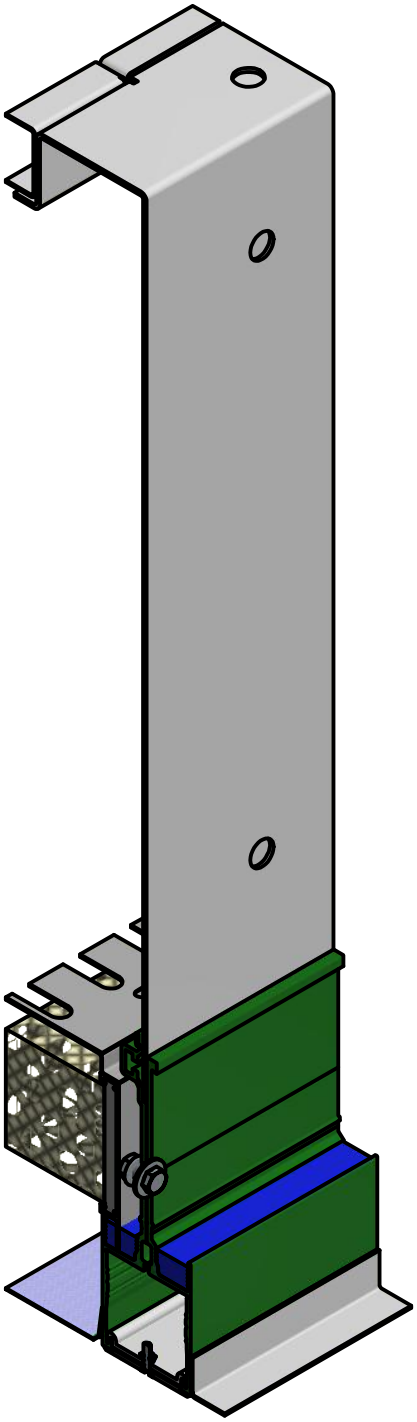


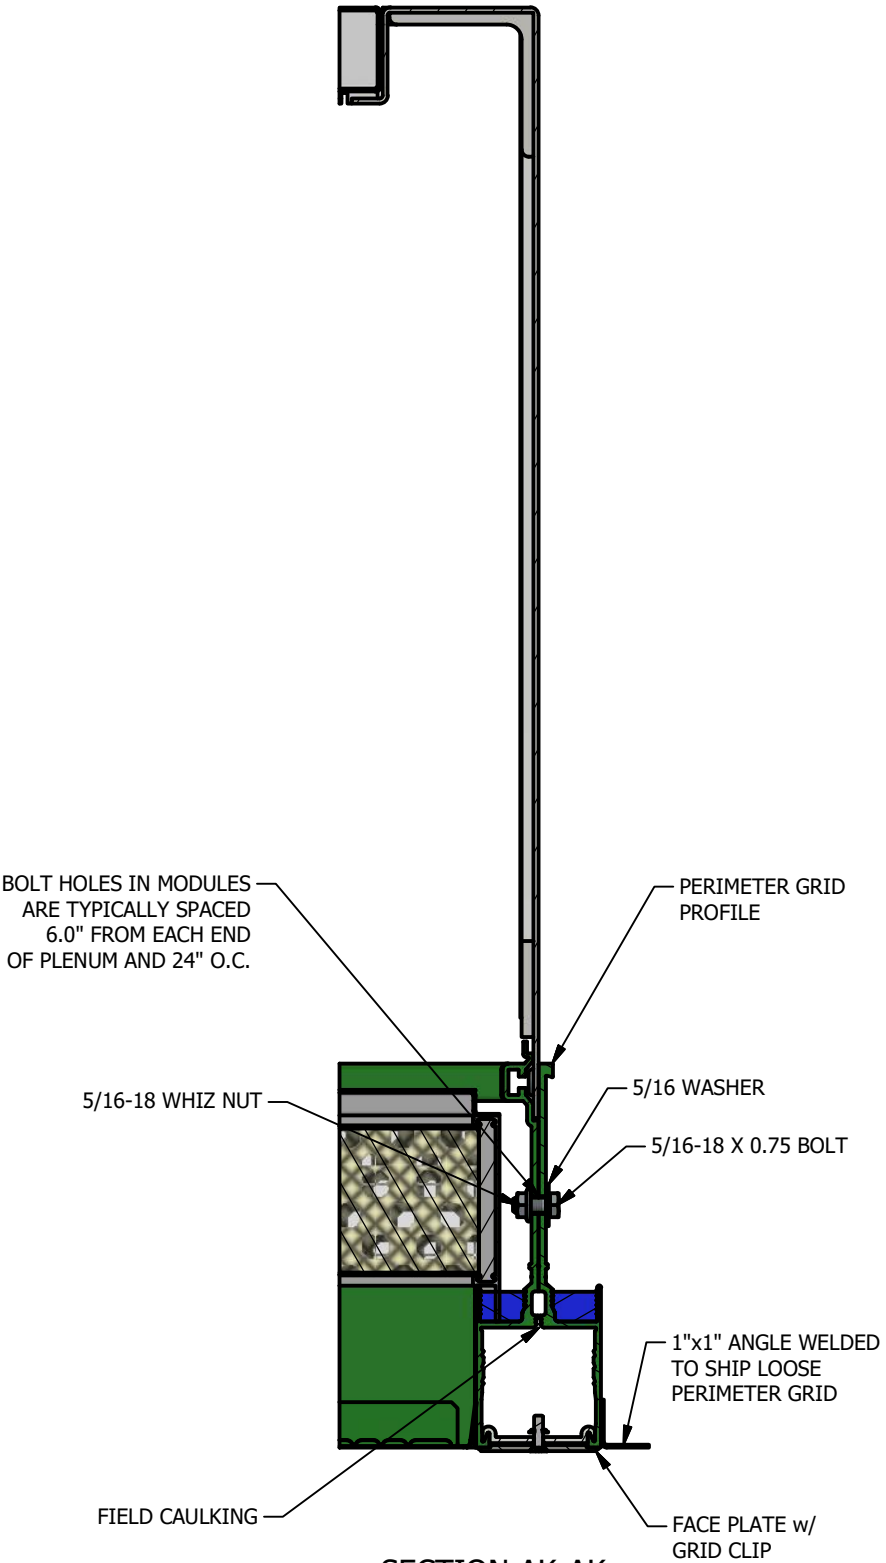


SECTION AK-AK
SCALE 1 / 4

NOTE:
FIELD CUTTING OF PERIMETER GRID INCLUDING CORNER MITERS ARE TO BE DONE IN THE FIELD. BOLT HOLES IN PERIMETER GRID PIECES WILL NEED TO BE CUSTOM DRILLED IN THE FIELD.

TOLERANCES		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
UNLESS OTHERWISE SPECIFIED			ISSUED ON: 12/6/2018		2.6 Top Load Plenum	
FRACTIONS:	±1/32		CHECKED BY:		Perimeter Grid w/ Angle Ledge	
0.0:	±0.1			JOB NO.:		
0.00:	±0.03					
0.000:	±0.010		PART NO.:			
ANGLES:	±0.5°			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 36 OF 53
OTHER: SEE DOC. QMS000.01A						

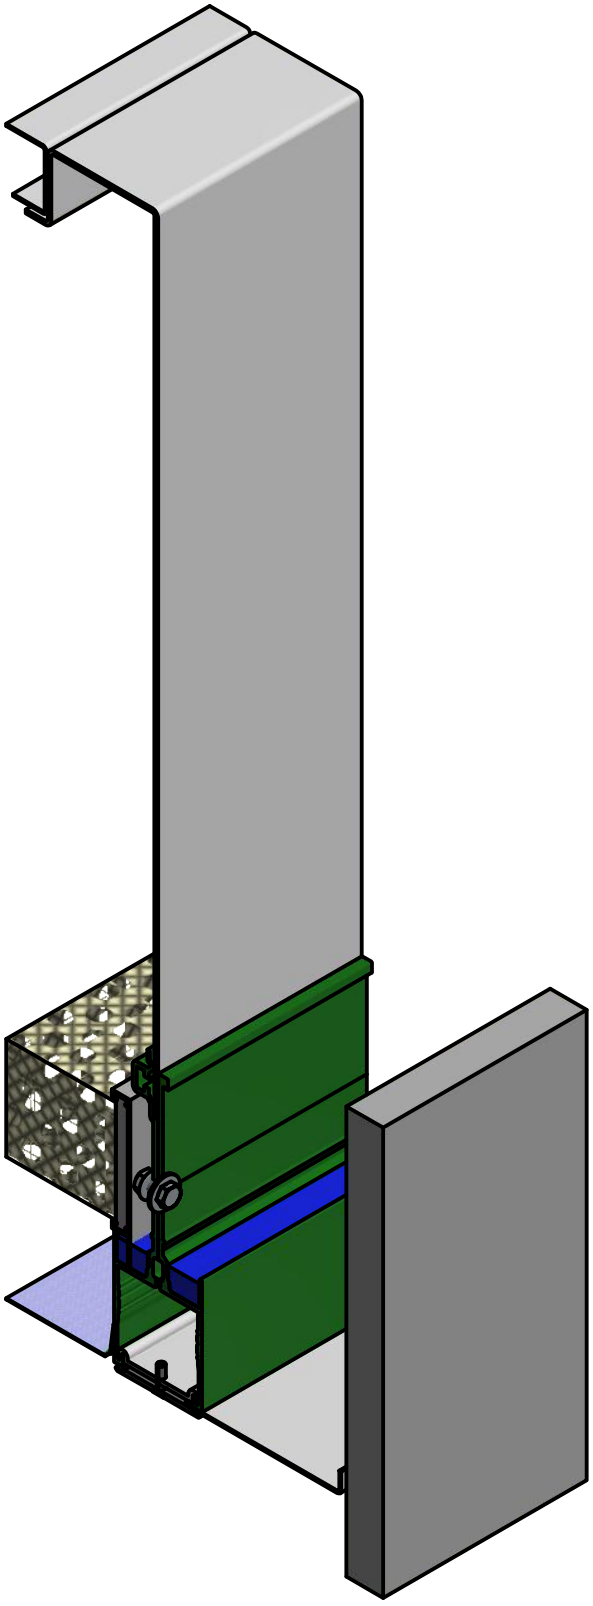

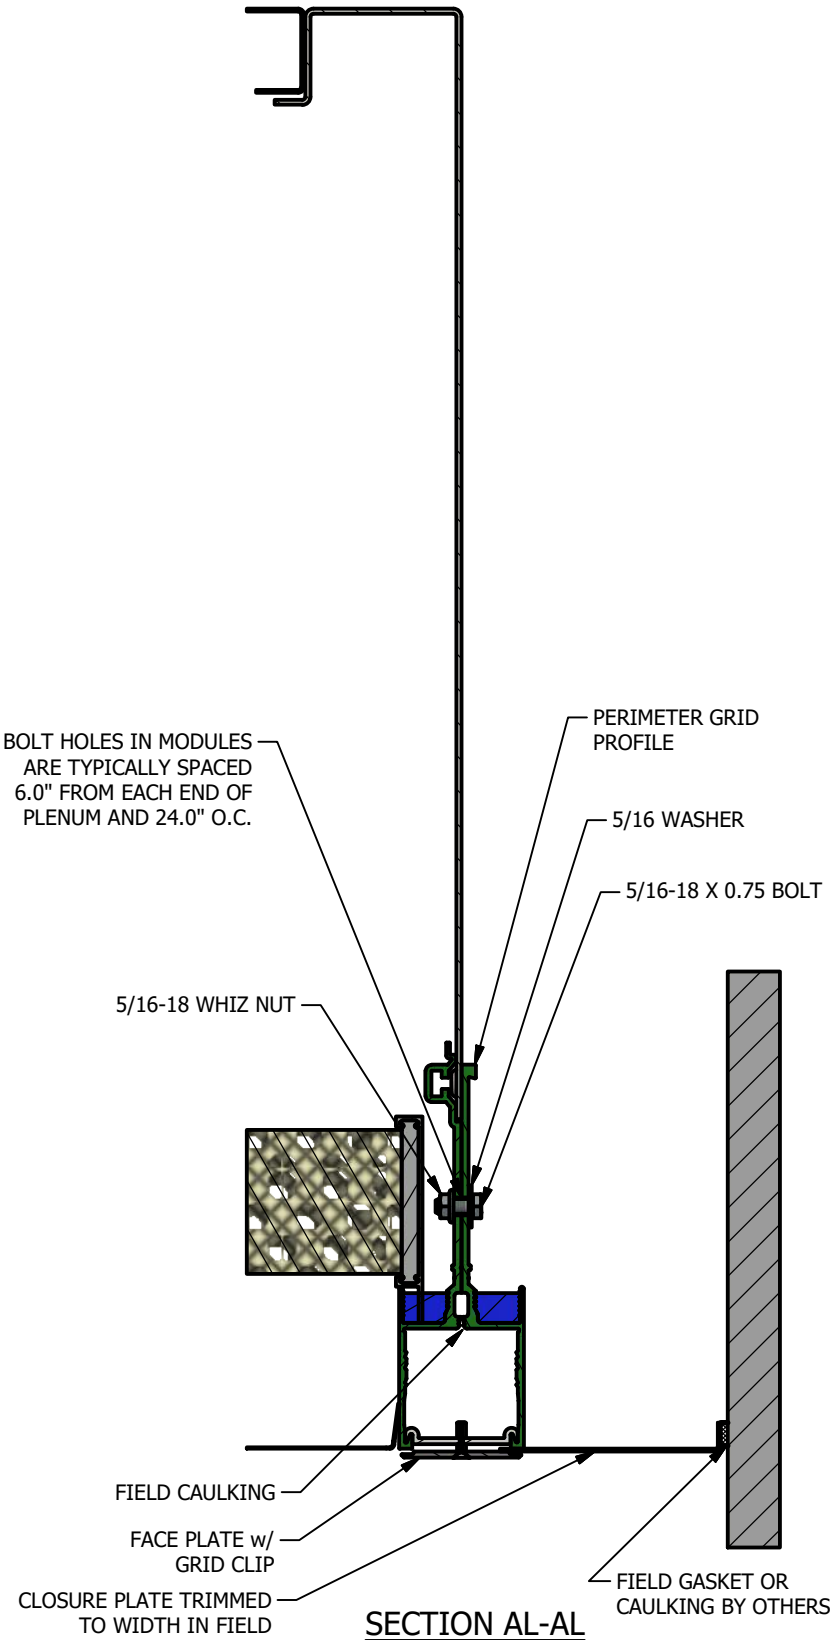

SECTION AL-AL
SCALE 1 / 4

NOTE:
FIELD CUTTING OF PERIMETER GRID INCLUDING CORNER MITERS ARE TO BE DONE IN THE FIELD. BOLT HOLES IN PERIMETER GRID PIECES WILL NEED TO BE CUSTOM DRILLED IN THE FIELD.

TOLERANCES	
UNLESS OTHERWISE SPECIFIED	
FRACTIONS:	±1/32
0.0:	±0.1
0.00:	±0.03
0.000:	±0.010
ANGLES:	±0.5°
OTHER: SEE DOC. QMS000.01A	

THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS

DRAWN BY:

ISSUED ON: 12/6/2018

CHECKED BY:

PART NO.:

3rd ANGLE PROJECTION

JOB NO.:


FILE NAME: 2.6TopLoad.idw


NORTEK™
CLEANROOM SOLUTIONS
CLEANPAK
19855 SW 124th AVE.
TUALATIN, OR 97062
Phone (503) 639-0113
Fax (503) 692-0958

2.6 Top Load Plenum

Perimeter Grid w/ Closure Plate to Wall

REV: 1

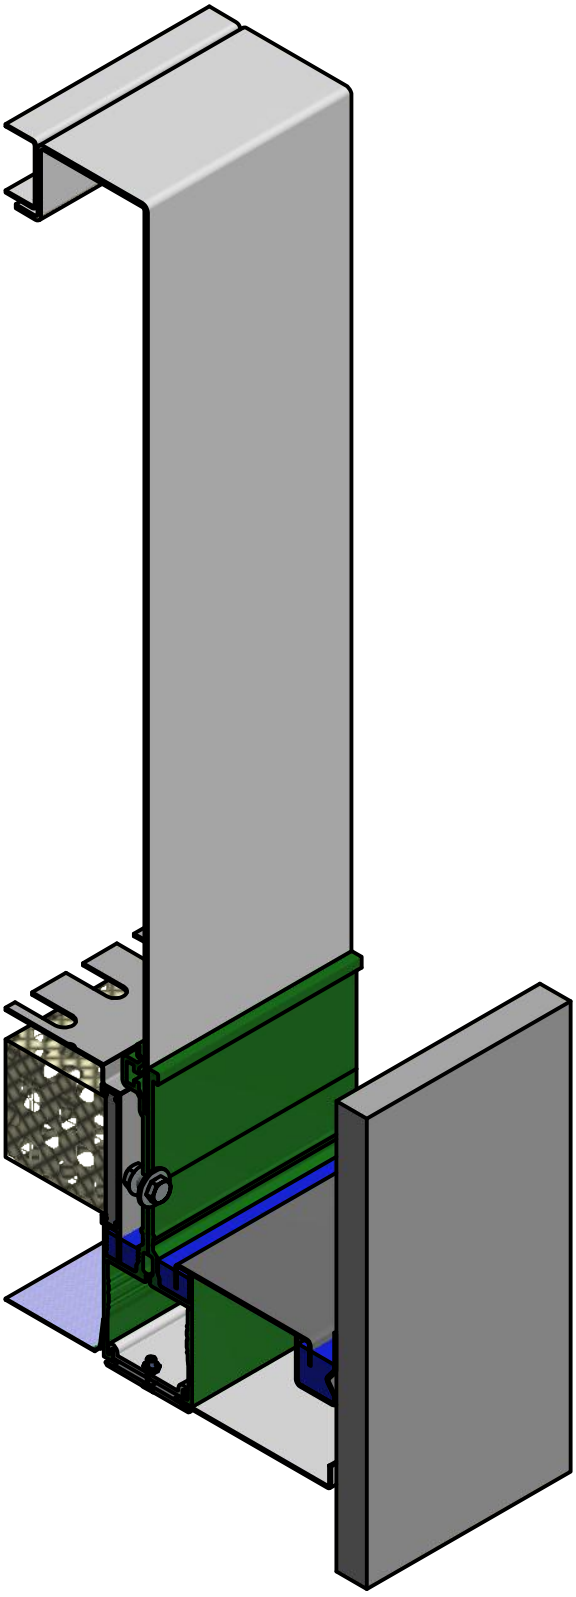

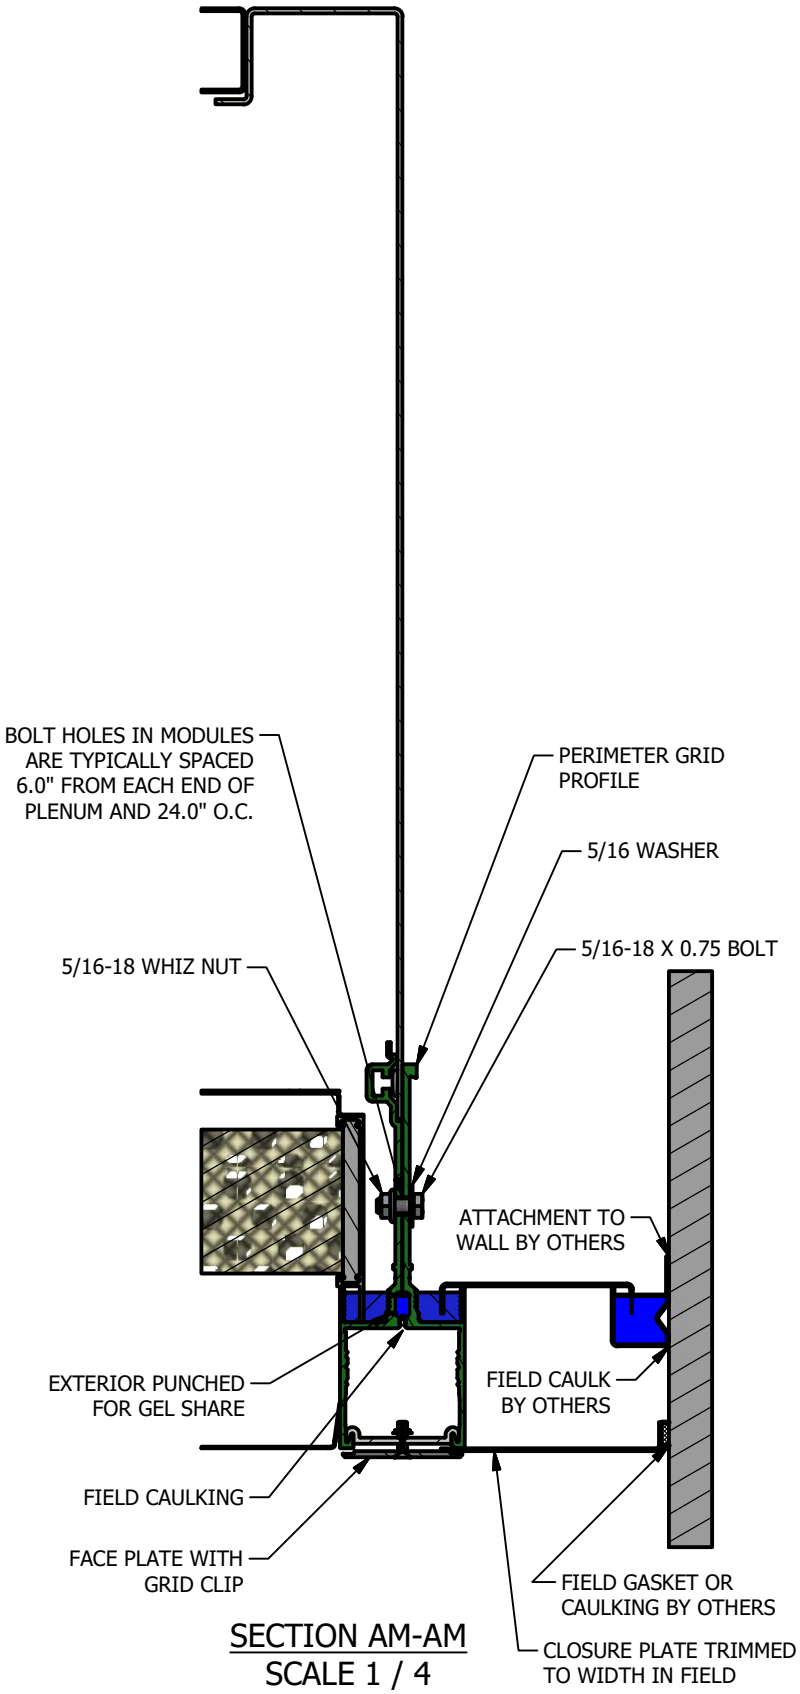

SECTION AM-AM
SCALE 1 / 4

NOTE:
FIELD CUTTING OF PERIMETER GRID INCLUDING CORNER MITERS ARE TO BE DONE IN THE FIELD. BOLT HOLES IN PERIMETER GRID PIECES WILL NEED TO BE CUSTOM DRILLED IN THE FIELD.

TOLERANCES	
UNLESS OTHERWISE SPECIFIED	
FRACTIONS:	±1/32
0.0:	±0.1
0.00:	±0.03
0.000:	±0.010
ANGLES:	±0.5°
OTHER: SEE DOC. QMS000.01A	

THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS

DRAWN BY:

ISSUED ON: 12/6/2018

CHECKED BY:

PART NO.:

3rd ANGLE PROJECTION

JOB NO.:


FILE NAME: 2.6TopLoad.idw


NORTEK™
CLEANROOM SOLUTIONS
CLEANPAK
19855 SW 124th AVE.
TUALATIN, OR 97062
Phone (503) 639-0113
Fax (503) 692-0958

2.6 Top Load Plenum

Perimeter Grid w/ Closure Plate to Wall and Gel Sealed Functional Wall Closure

REV: 1

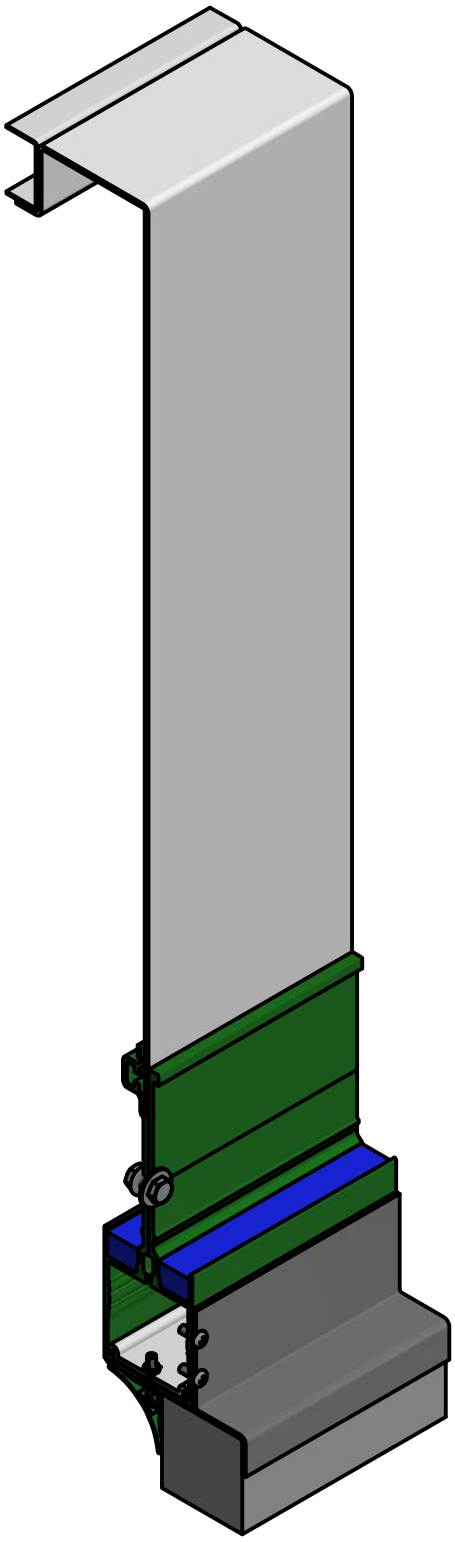

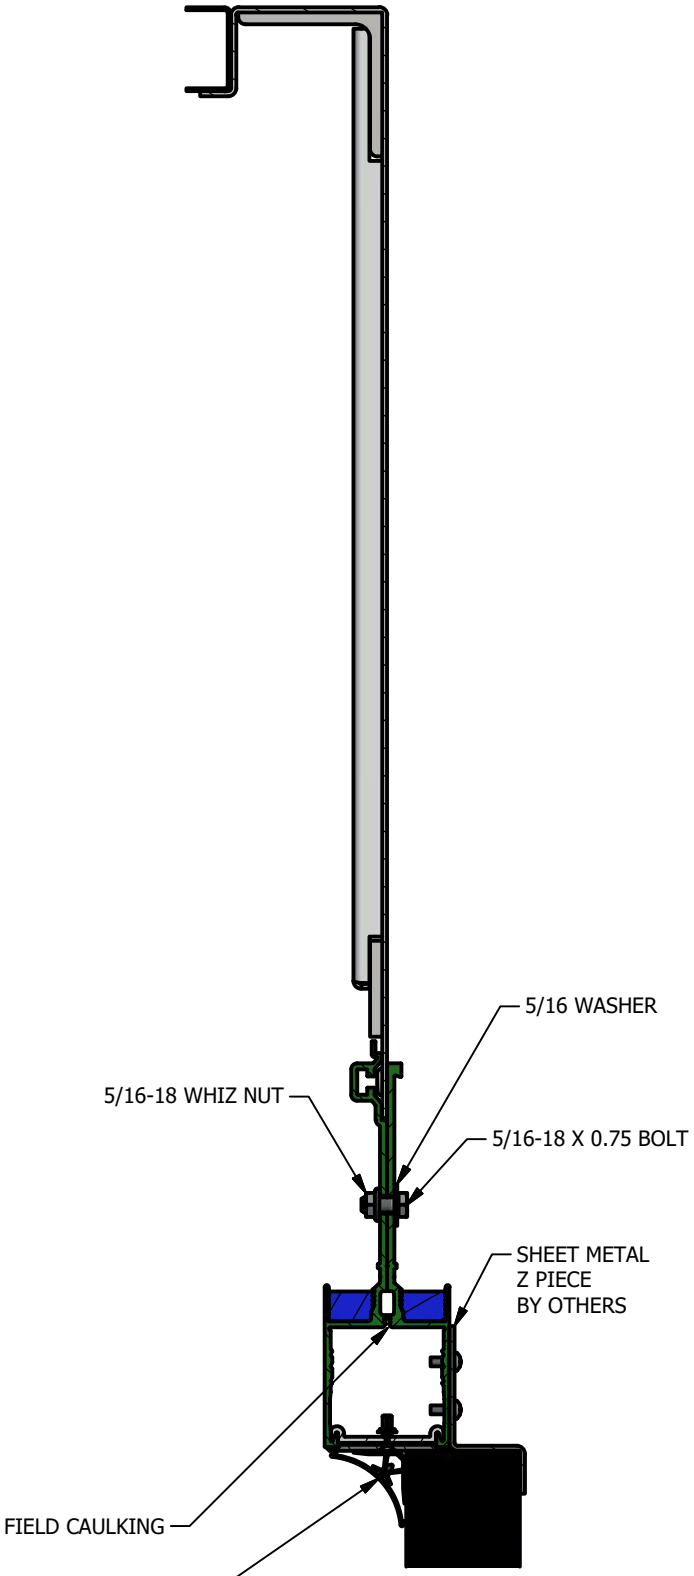

SECTION AN-AN
SCALE 1 / 4

NOTE:
FIELD CUTTING OF PERIMETER GRID INCLUDING CORNER MITERS ARE TO BE DONE IN THE FIELD. BOLT HOLES IN PERIMETER GRID PIECES WILL NEED TO BE CUSTOM DRILLED IN THE FIELD.

TOLERANCES		
UNLESS OTHERWISE SPECIFIED		
FRACTIONS:	±1/32	
0.0:	±0.1	
0.00:	±0.03	
0.000:	±0.010	
ANGLES:	±0.5°	
OTHER:		
SEE DOC. QMS000.01A		

THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS

DRAWN BY:

ISSUED ON: 12/6/2018

CHECKED BY:

PART NO.:

3rd ANGLE PROJECTION

JOB NO.:


FILE NAME: 2.6TopLoad.idw


NORTEK™
CLEANROOM SOLUTIONS
CLEANPAK
19855 SW 124th AVE.
TUALATIN, OR 97062
Phone (503) 639-0113
Fax (503) 692-0958

2.6 Top Load Plenum

Perimeter Grid Interface to Wall Coved


REV: 1

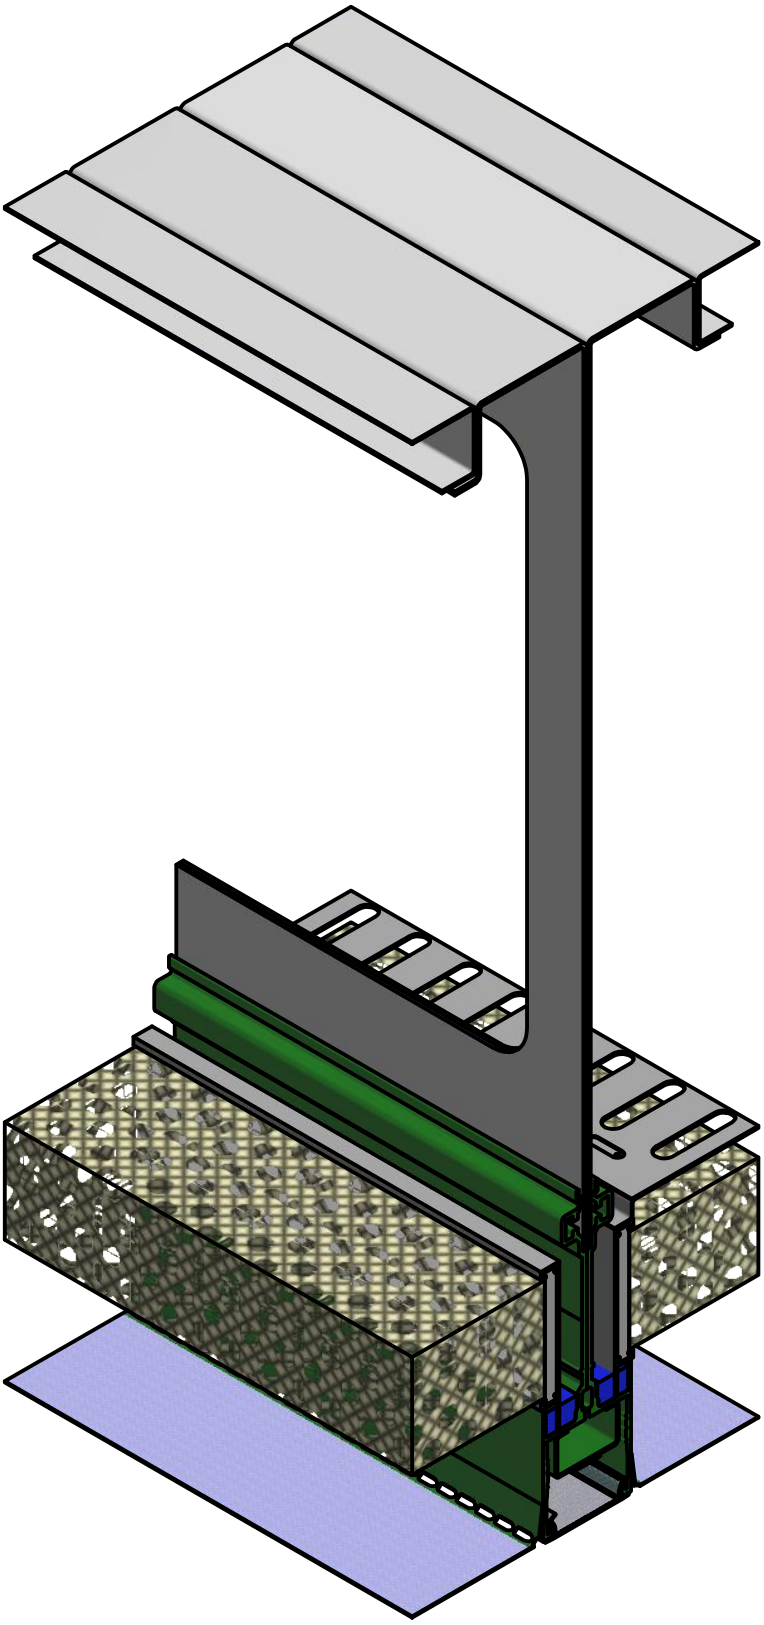


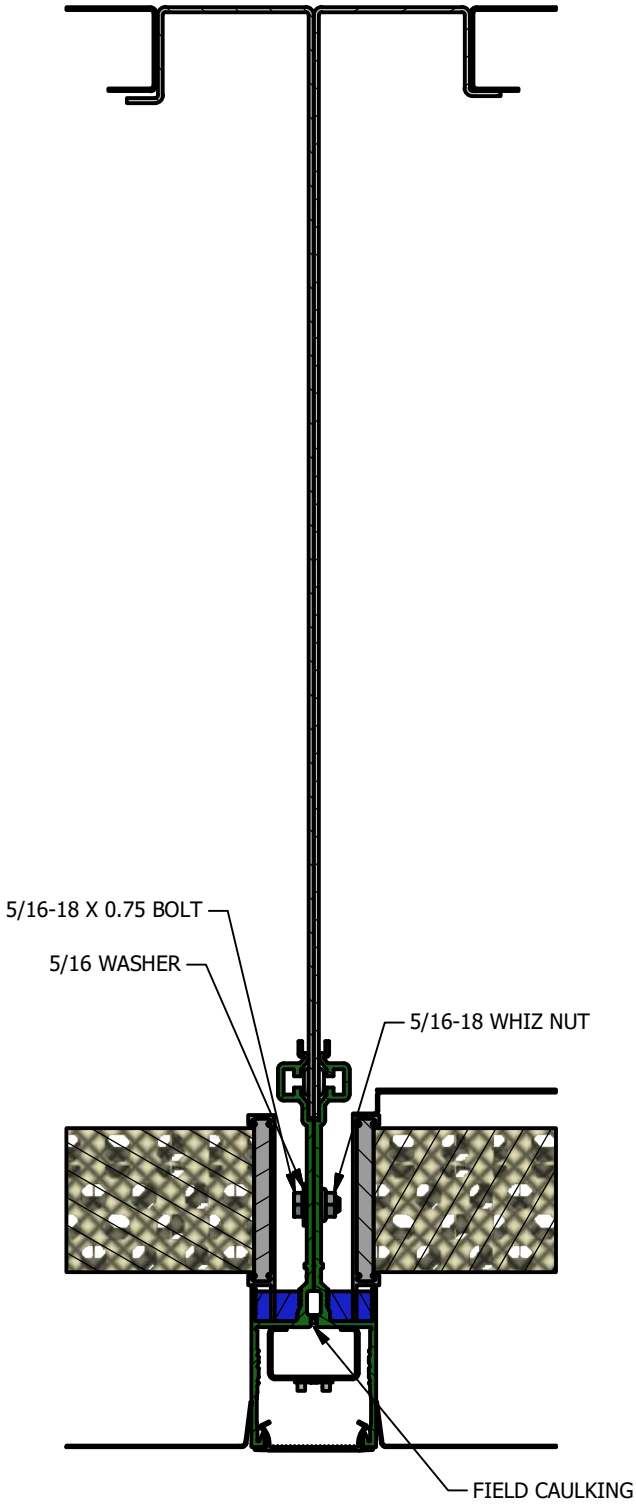

SECTION AP-AP
SCALE 1 / 4

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958	2.6 Top Load Plenum Module to Module Joint Module Seam Lighting Where Applicable FILE NAME: 2.6TopLoad.idw REV: 1 SHEET 40 OF 53

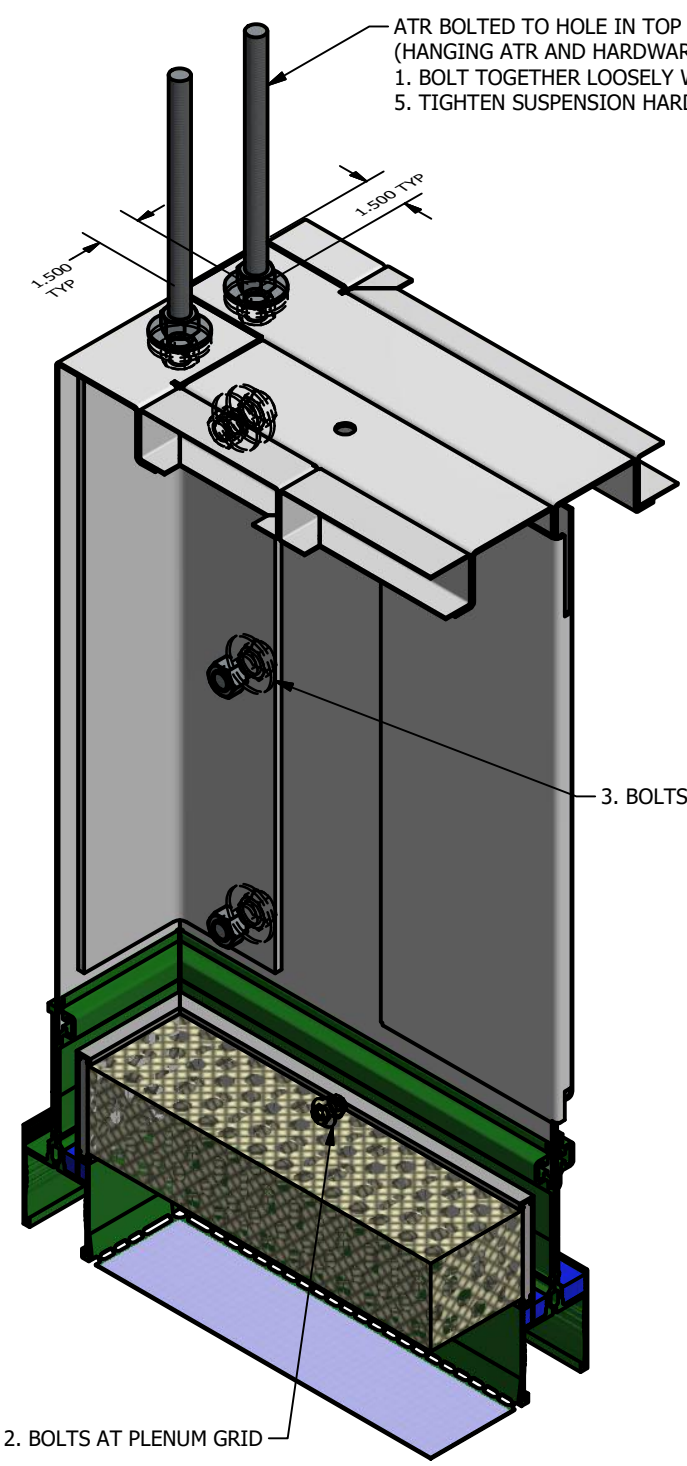


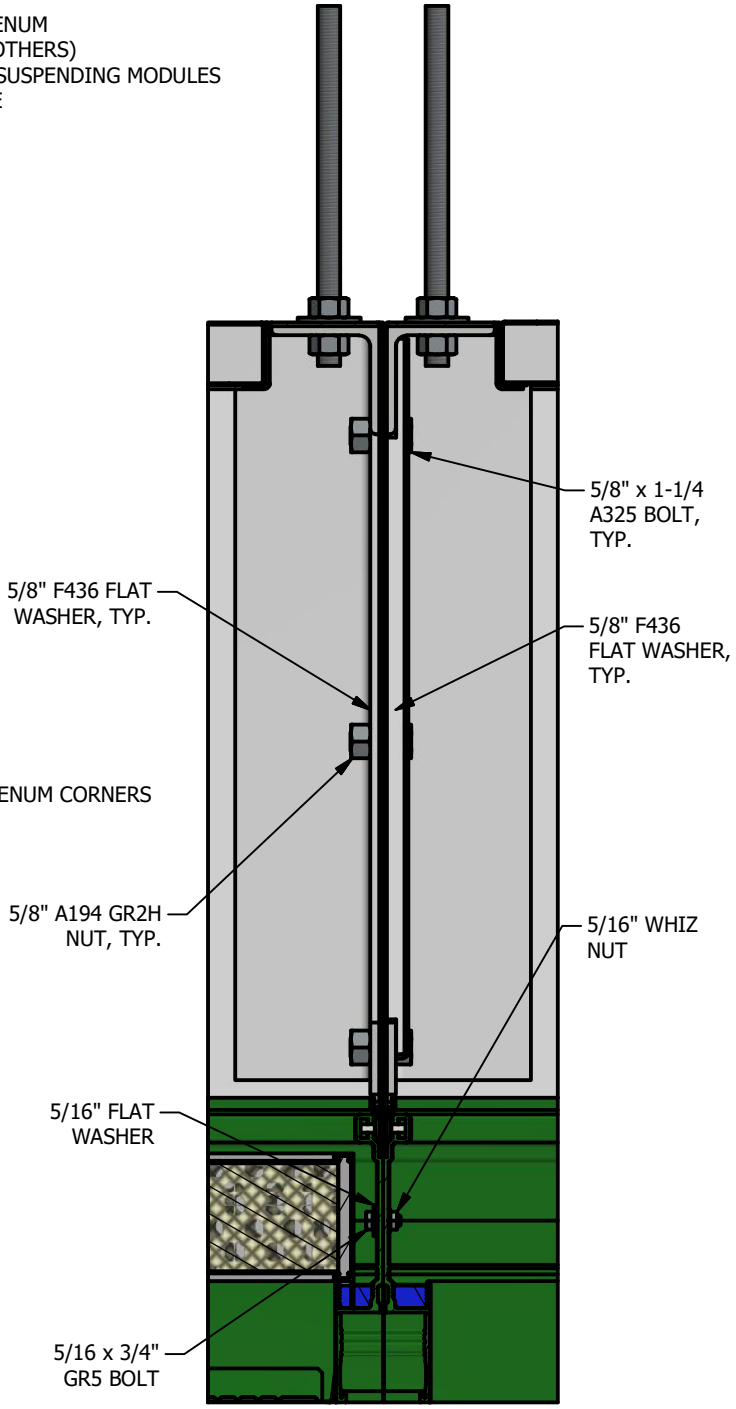

SECTION AR-AR
SCALE 3/16

NOTE:
NUMBERS INDICATE SEQUENCE ORDER
FOR MODULE INSTALLATION ASSEMBLY.

TOLERANCES		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
UNLESS OTHERWISE SPECIFIED			ISSUED ON: 12/6/2018		2.6 Top Load Grid	
FRACTIONS:	±1/32		CHECKED BY:		Bolting Detail Welded Plenum to Welded Plenum	
0.0:	±0.1			JOB NO.:		
0.00:	±0.03					
0.000:	±0.010		PART NO.:			
ANGLES:	±0.5°			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 41 OF 53
OTHER: SEE DOC. QMS000.01A						

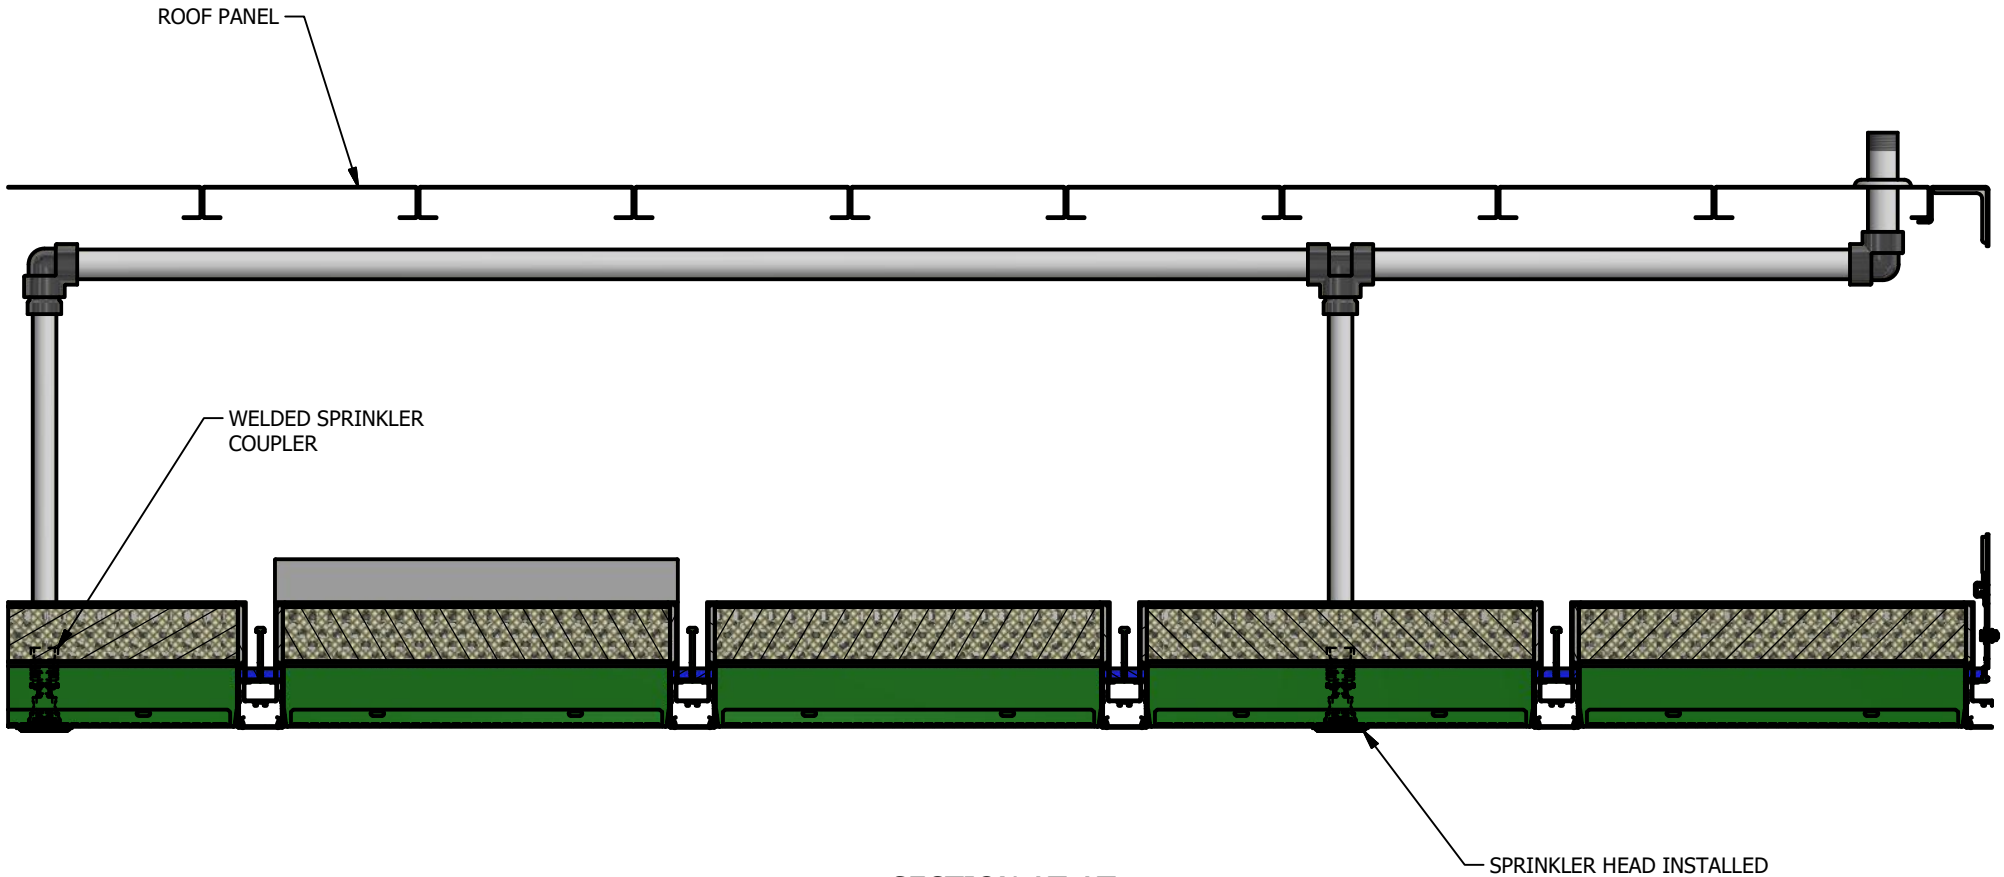

SECTION AT-AT
SCALE 3/32

TOLERANCES					
UNLESS OTHERWISE SPECIFIED					
FRACTIONS:	±1/32				
0.0:	±0.1				
0.00:	±0.03				
0.000:	±0.010				
ANGLES:	±0.5°				
OTHER: SEE DOC. QMS000.01A					

THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS

DRAWN BY:

ISSUED ON: 12/6/2018

CHECKED BY:

PART NO.:

3rd ANGLE PROJECTION

JOB NO.:

FILE NAME: 2.6TopLoad.idw


REV: 1

SHEET 42 OF 53


NORTEK™
CLEANROOM SOLUTIONS
CLEANPAK
19855 SW 124th AVE.
TUALATIN, OR 97062
Phone (503) 639-0113
Fax (503) 692-0958


2.6 Top Load Plenum

Sprinkler Piping

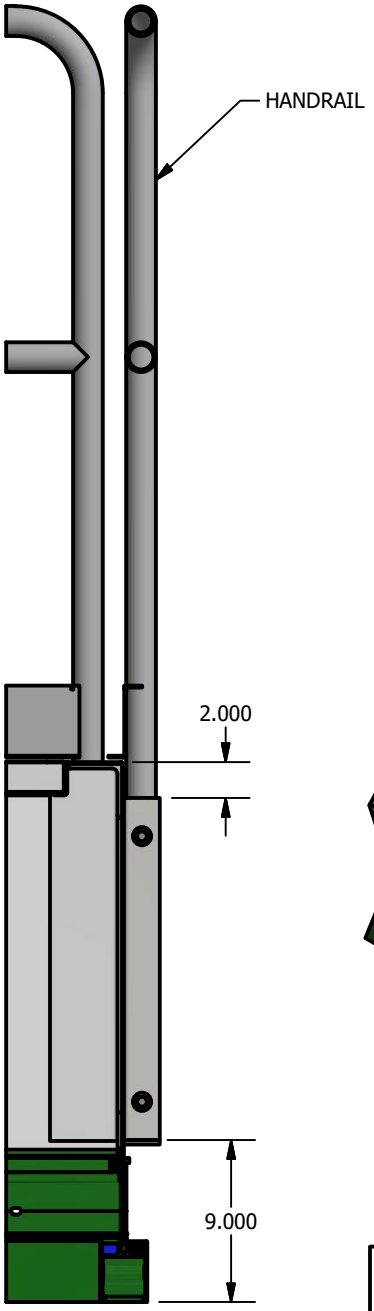


SECTION BE-BE

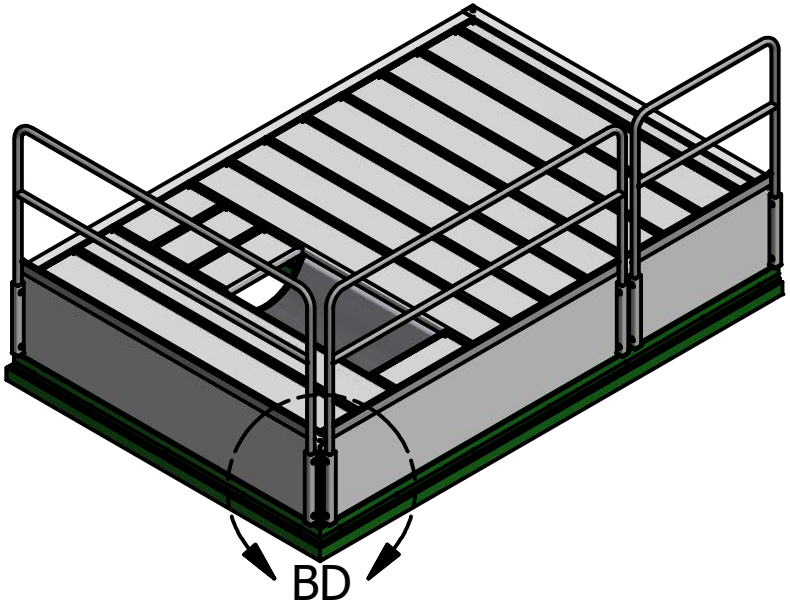

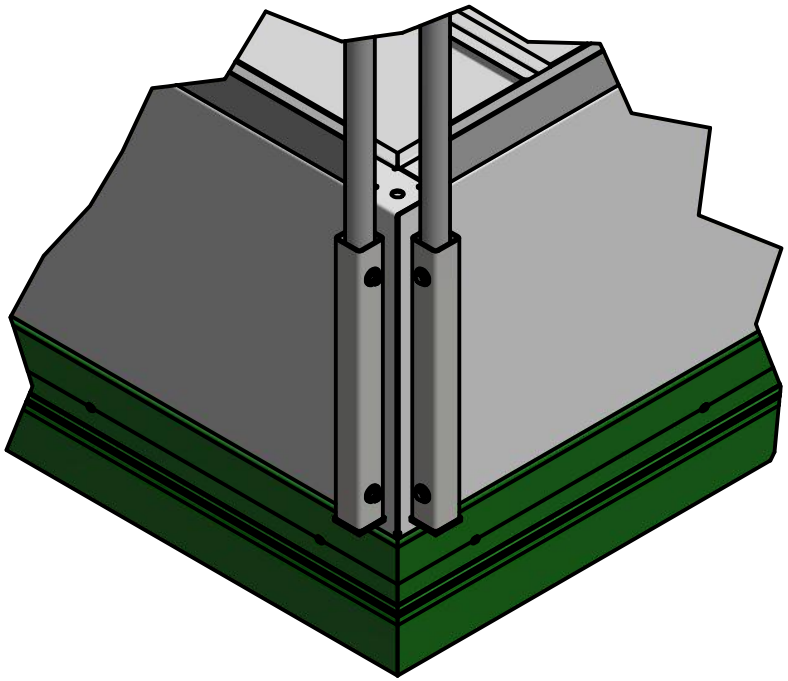


DETAIL BD


TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958	2.6 Top Load Plenum Tube Handrail Connection
			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 43 OF 53

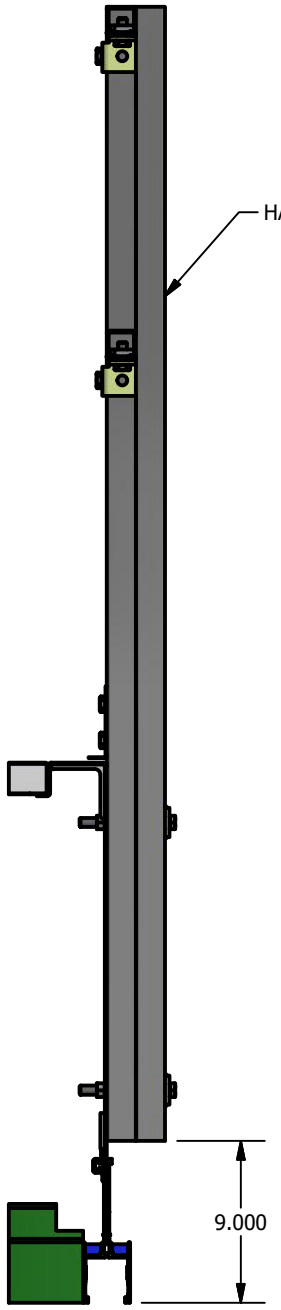

SECTION BG-BG
SCALE 3/32

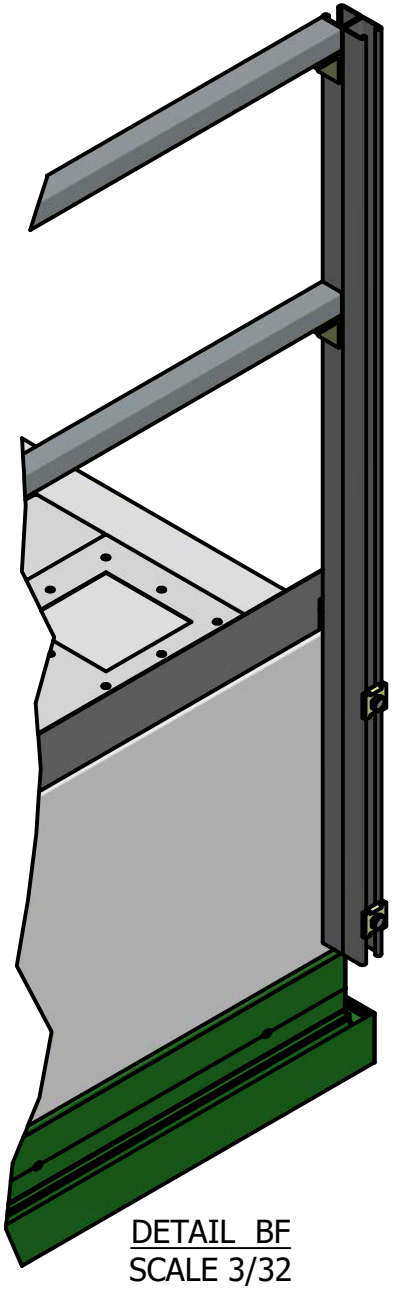


DETAIL BF
SCALE 3/32

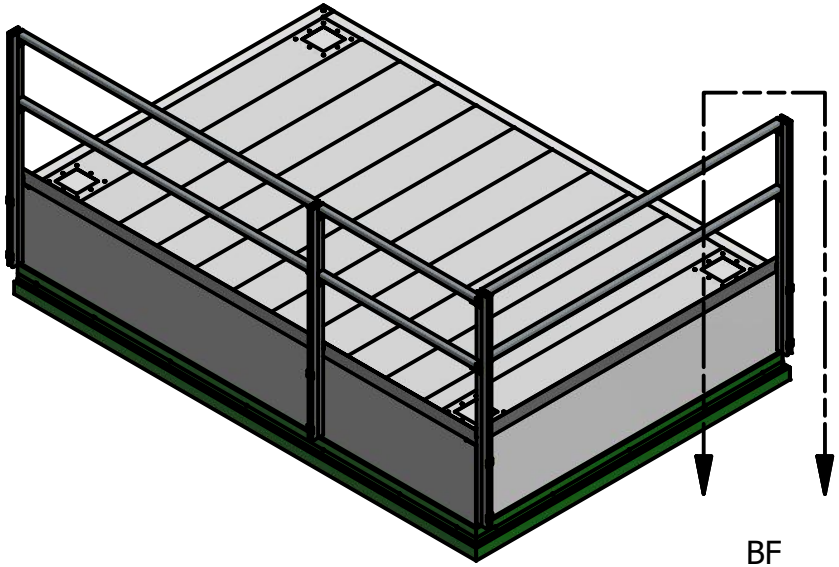



BF

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958	2.6 Top Load Plenum Strut Handrail Connection FILE NAME: 2.6TopLoad.idw REV: 1 SHEET 44 OF 53

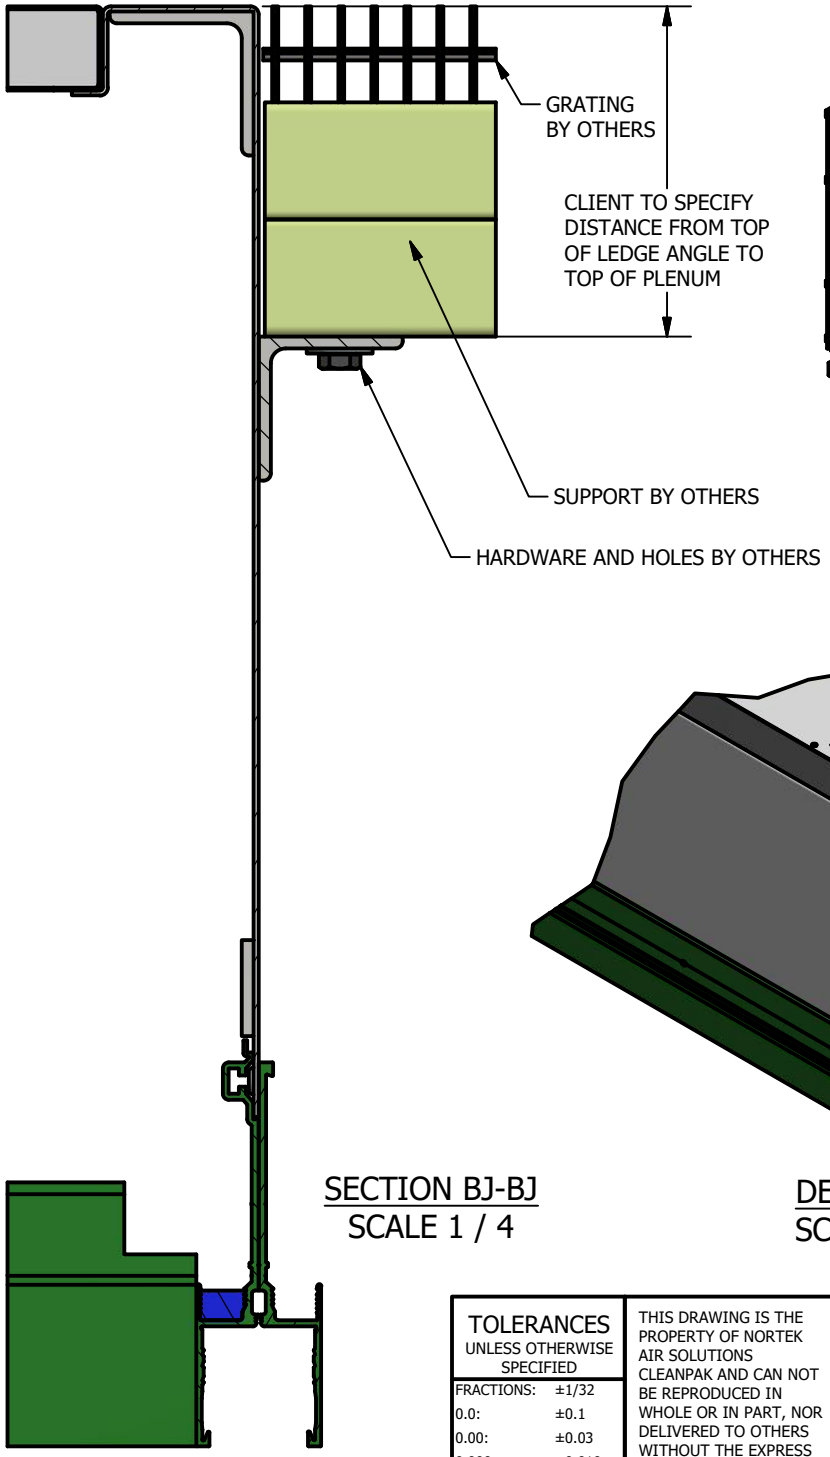


SECTION BJ-BJ
SCALE 1 / 4

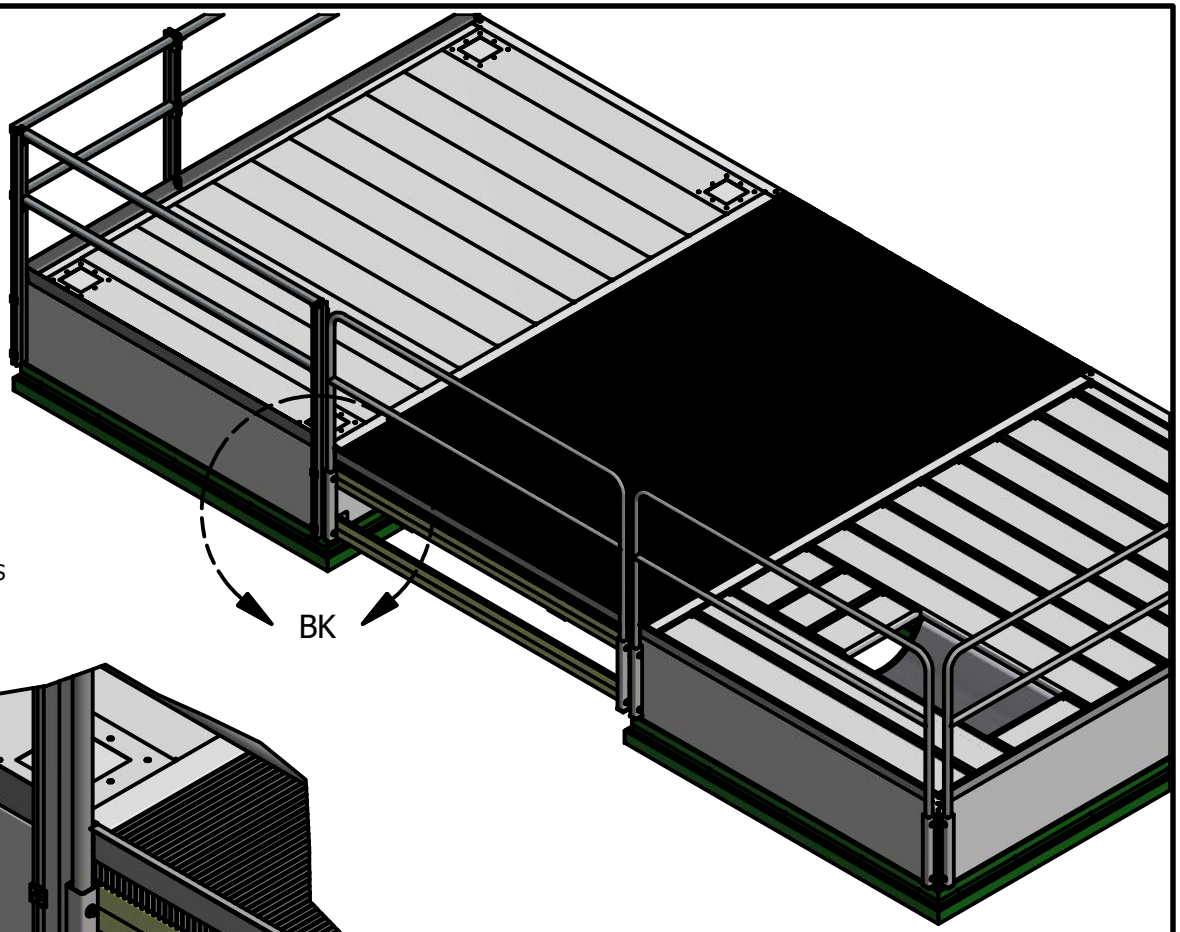

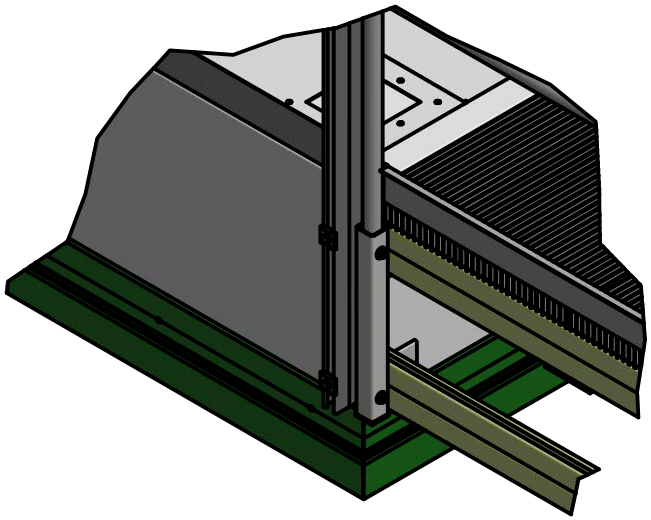


DETAIL BK
SCALE 1/16


TOLERANCES		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
UNLESS OTHERWISE SPECIFIED			ISSUED ON: 12/6/2018		2.6 Top Load Plenum	
FRACTIONS:	±1/32		CHECKED BY:		Grating Ledge Angle	
0.0:	±0.1			JOB NO.:		
0.00:	±0.03					
0.000:	±0.010		PART NO.:			
ANGLES:	±0.5°			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 45 OF 53
OTHER: SEE DOC. QMS000.01A						

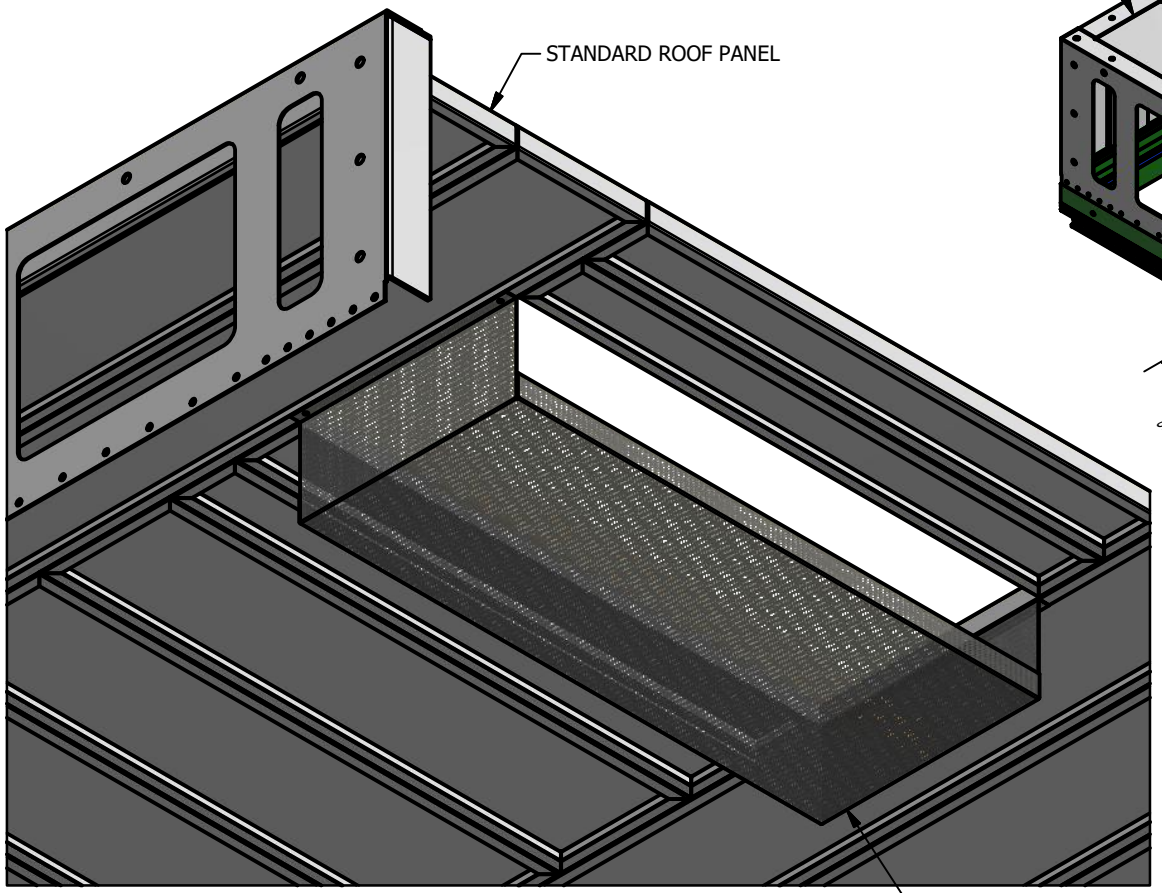

ROOF SUPPLY OPENING
& BLAST PLATE- GRID NOT SHOWN

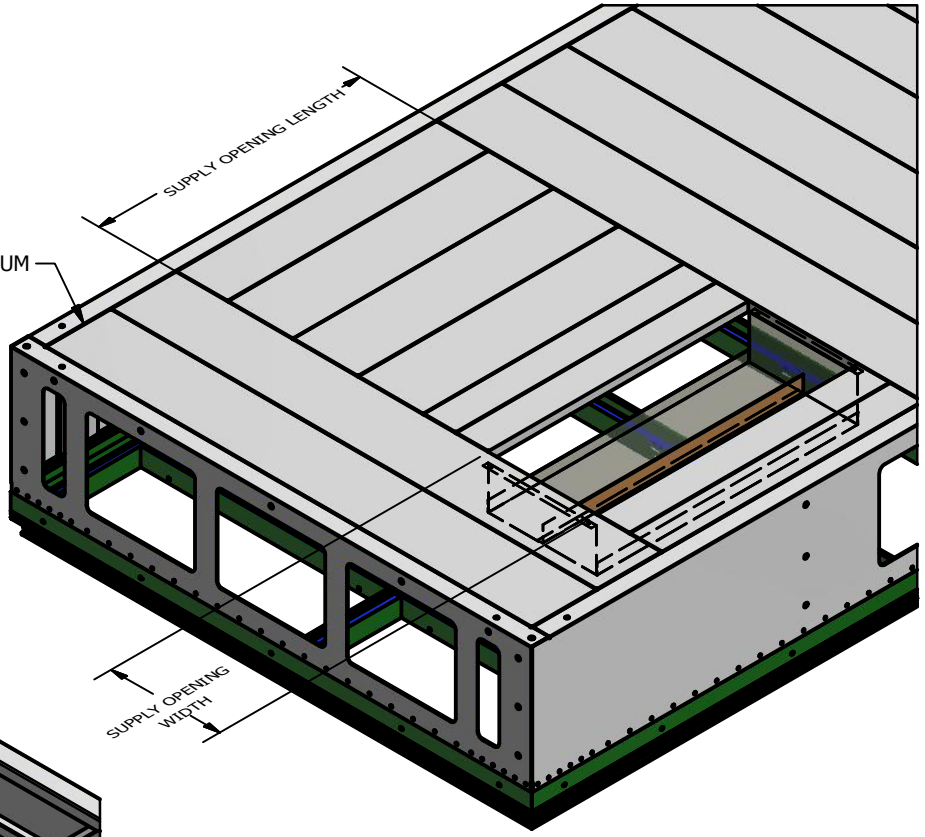

ROOF SUPPLY OPENING

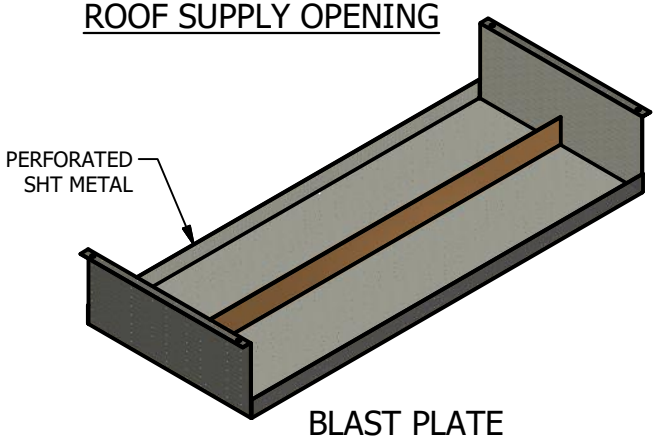


BLAST PLATE

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958


2.6 TOP LOAD PLENUM

SUPPLY OPENING OPTIONS
BLAST PLATE


FILE NAME: 2.6TopLoad.idw | REV: 1 | SHEET 46 OF 53

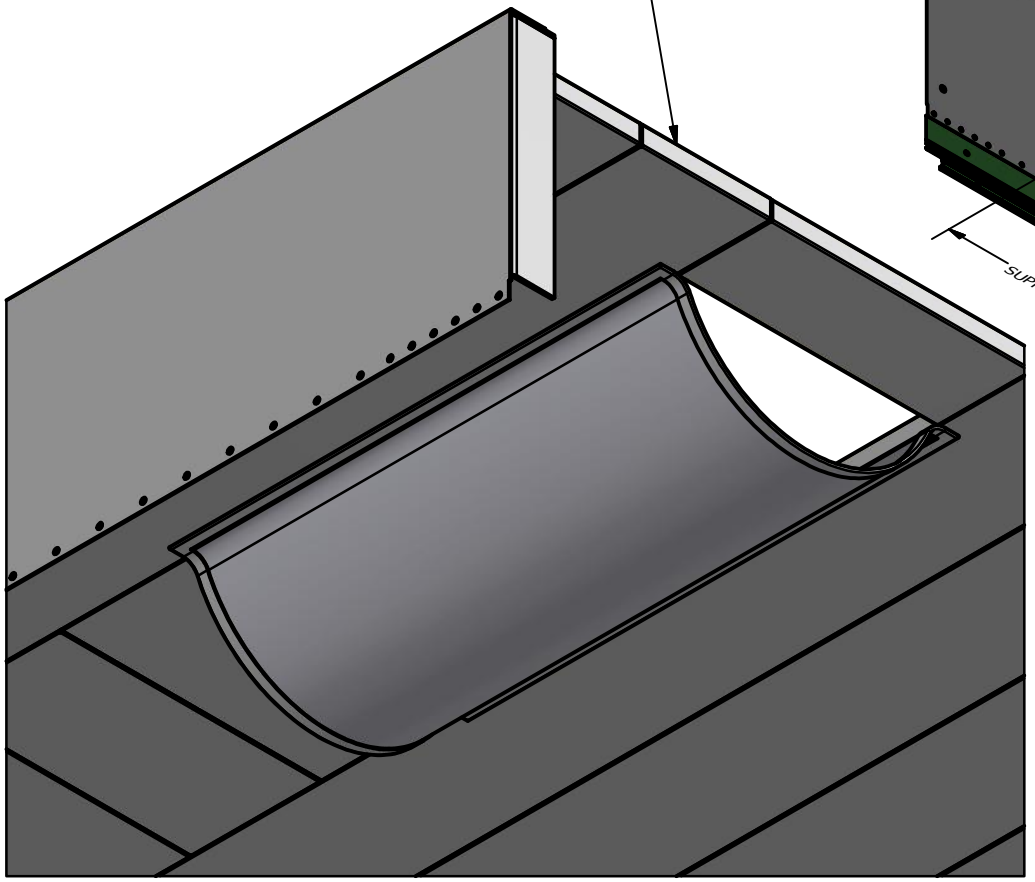

ROOF SUPPLY OPENING &
DIFFUSER MEMBRANE- GRID NOT SHOWN

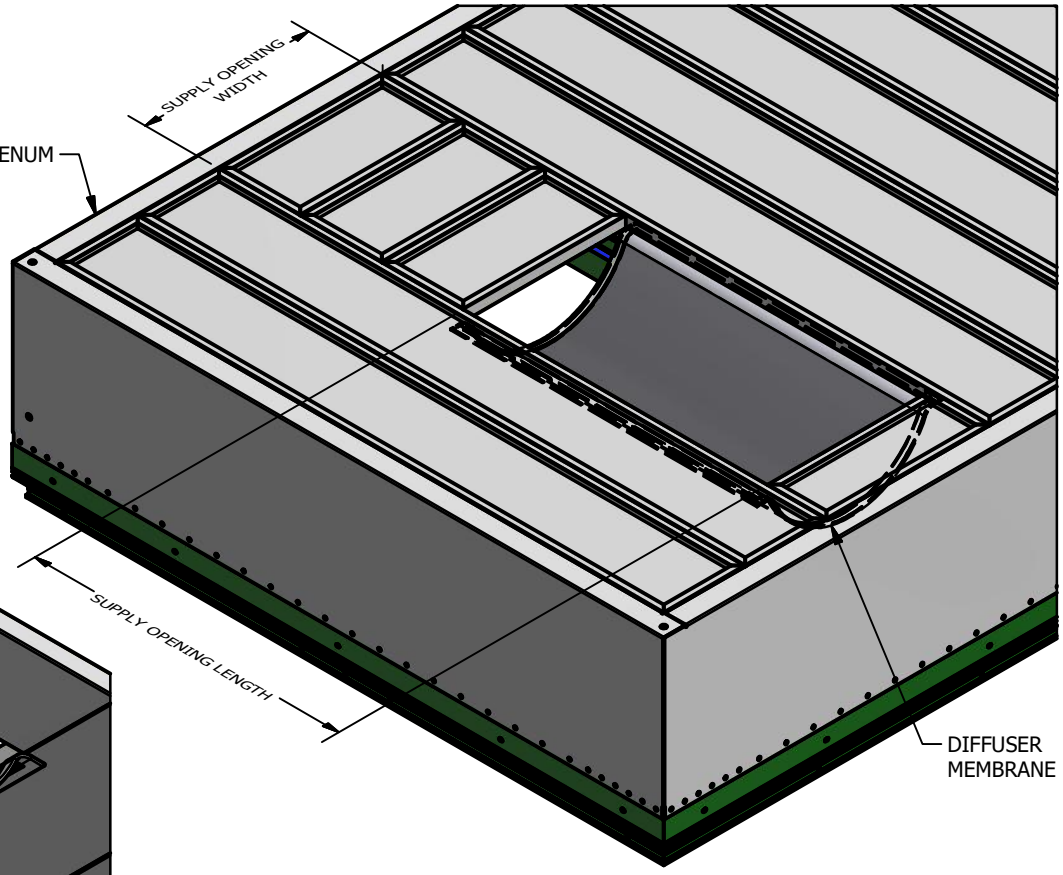

ROOF SUPPLY OPENING

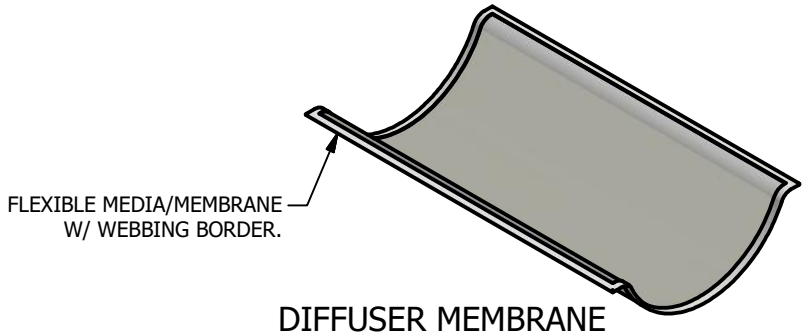


DIFFUSER MEMBRANE

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958


2.6 TOP LOAD PLENUM

SUPPLY OPENING OPTIONS
DIFFUSER MEMBRANE


FILE NAME: 2.6TopLoad.idw | REV: 1 |

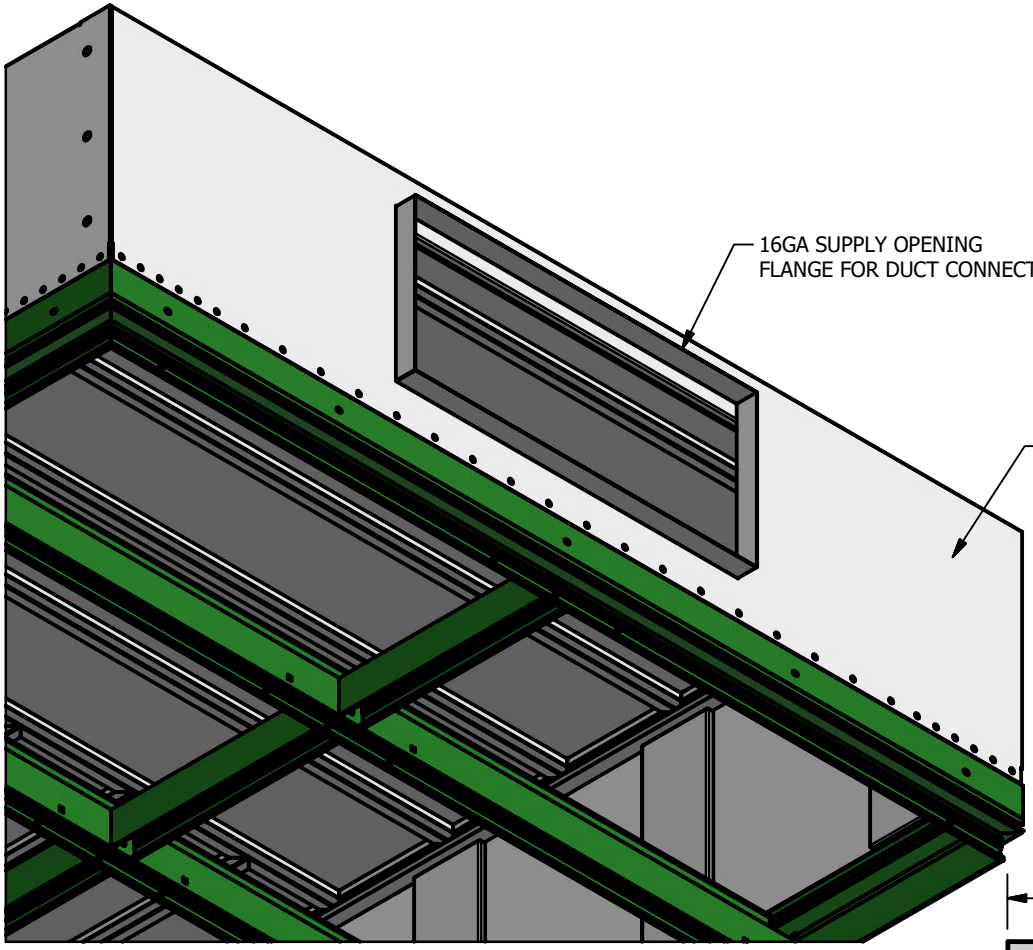

SUPPLLY OPENING
FLANGED SIDEWALL SUPPLY

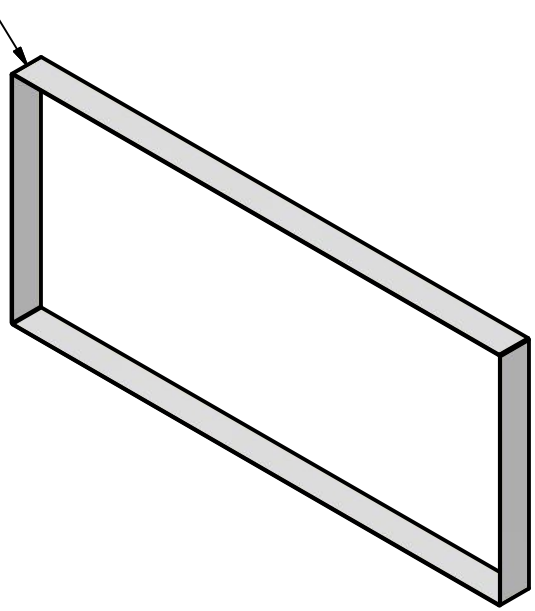

SUPPLY OPENING DUCT FLANGE

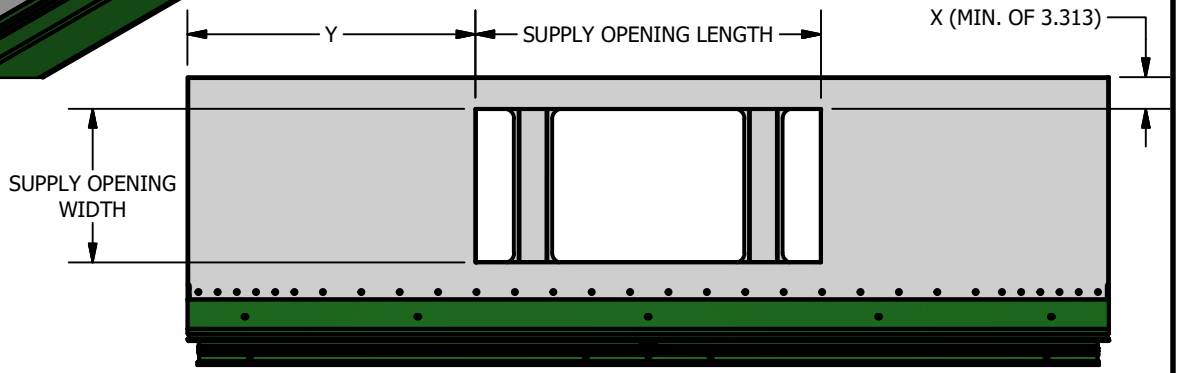

ELEVATION VIEW

TOLERANCES	
UNLESS OTHERWISE SPECIFIED	
FRACTIONS:	±1/32
0.0:	±0.1
0.00:	±0.03
0.000:	±0.010
ANGLES:	±0.5°
OTHER:	
SEE DOC. QMS000.01A	

THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS

DRAWN BY:

ISSUED ON: 12/6/2018

CHECKED BY:

PART NO.:

3rd ANGLE PROJECTION

JOB NO.:


FILE NAME: 2.6TopLoad.idw

NORTEK CLEANROOM SOLUTIONS CLEANPAK
19855 SW 124th AVE.
TUALATIN, OR 97062
Phone (503) 639-0113
Fax (503) 692-0958


2.6 TOP LOAD PLENUM

SUPPLY OPENING OPTIONS
SIDEWALL FLANGED SUPPLY OPENING


REV: 1

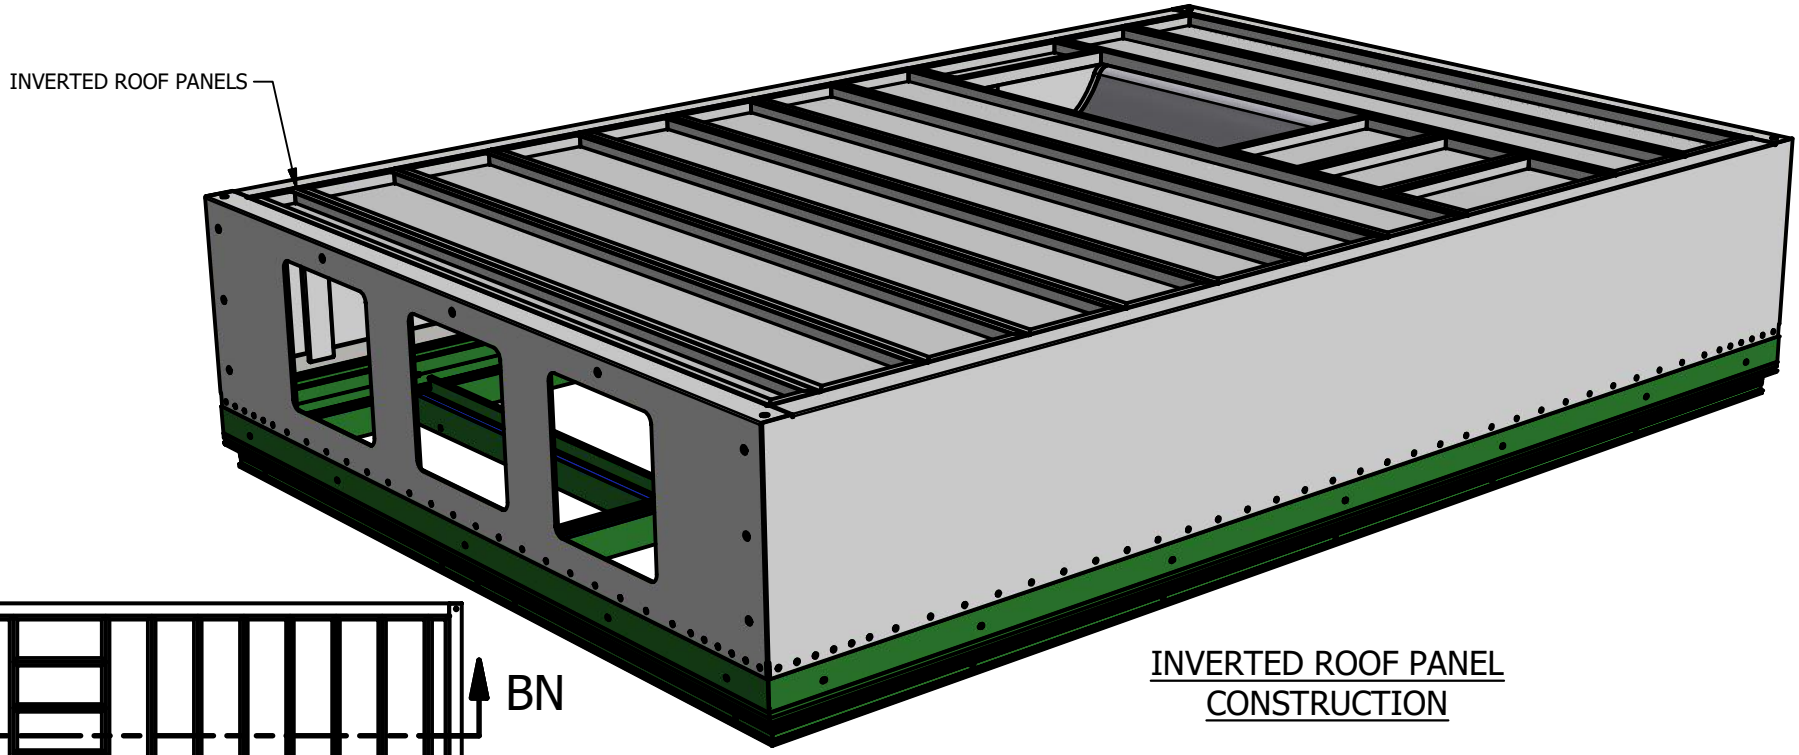


INVERTED ROOF PANEL CONSTRUCTION

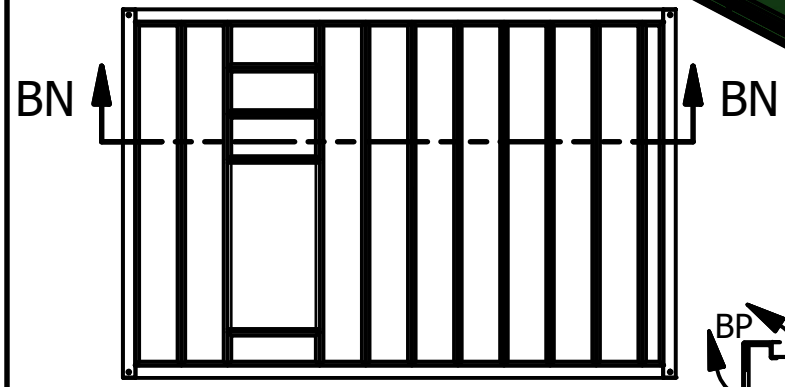

PLAN VIEW- INVERTED ROOF PANELS

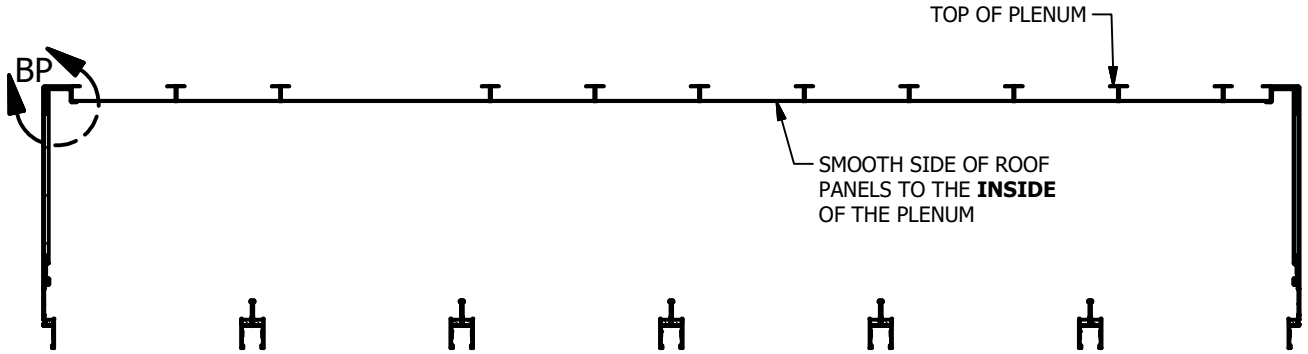

SECTION BN-BN

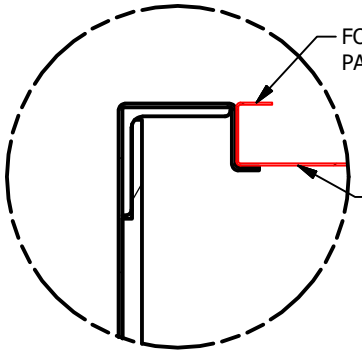

DETAIL BP
INVERTED ROOF PANELS

TOLERANCES UNLESS OTHERWISE SPECIFIED	
FRACTIONS:	±1/32
0.0:	±0.1
0.00:	±0.03
0.000:	±0.010
ANGLES:	±0.5°
OTHER:	SEE DOC. QMS000.01A

THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS

DRAWN BY:

ISSUED ON: 12/6/2018

CHECKED BY:

PART NO.:

3rd ANGLE PROJECTION

JOB NO.:


FILE NAME: 2.6TopLoad.idw

NORTEK CLEANROOM SOLUTIONS CLEANPAK
19855 SW 124th AVE.
TUALATIN, OR 97062
Phone (503) 639-0113
Fax (503) 692-0958


2.6 TOP LOAD PLENUM

ROOF PANEL OPTIONS
INVERTED


REV: 1

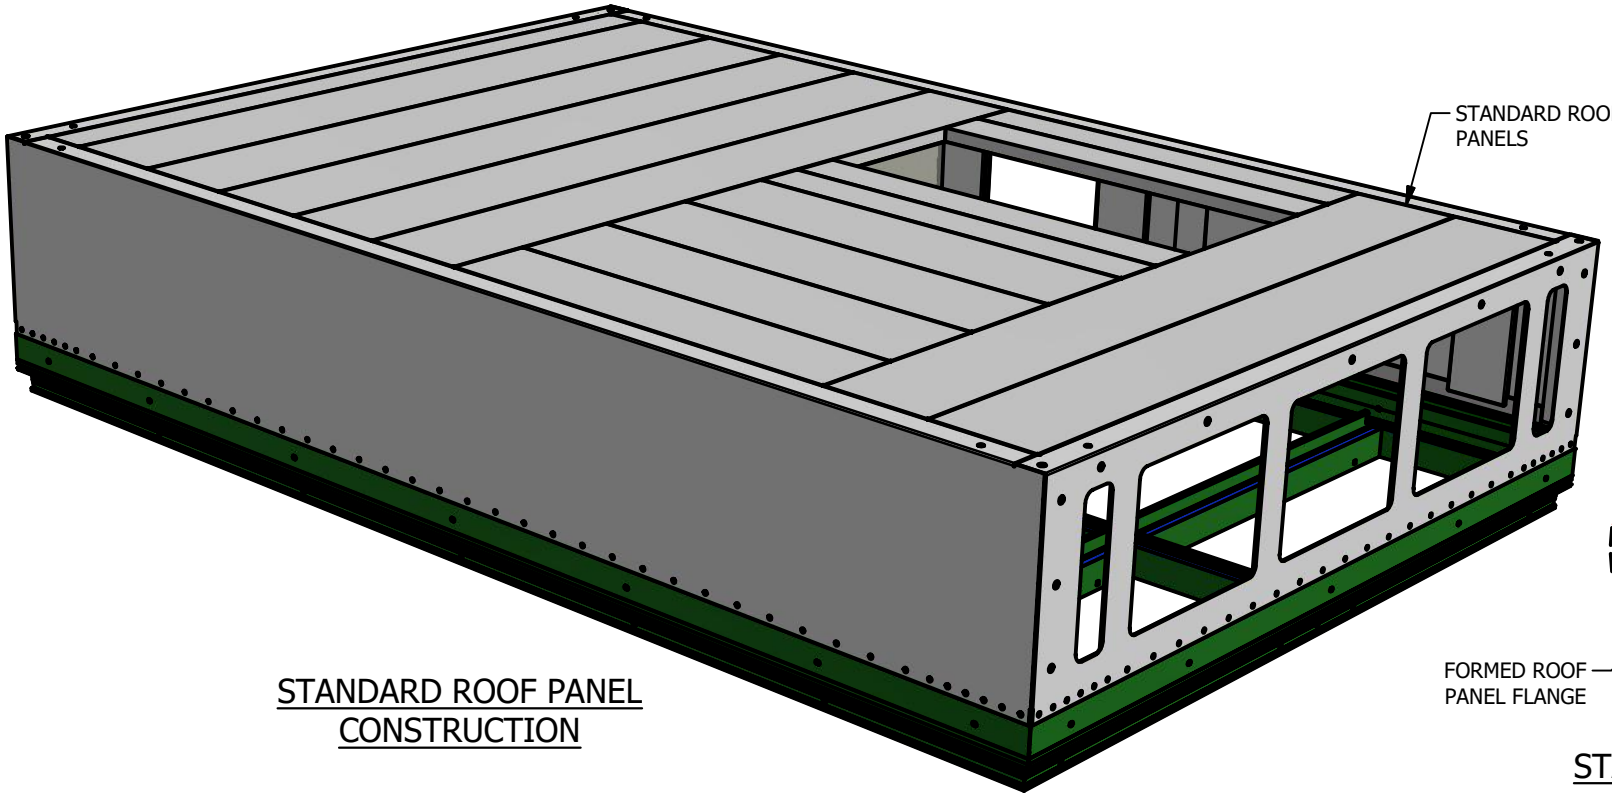


STANDARD ROOF PANEL
CONSTRUCTION

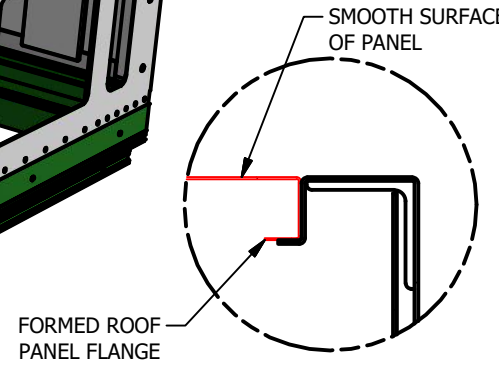

DETAIL BT
STANDARD ROOF PANELS

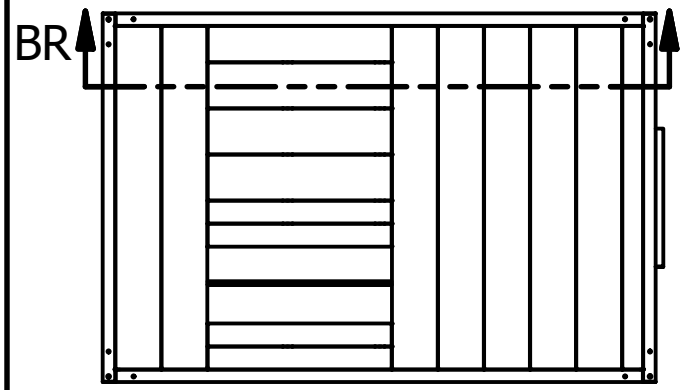


PLAN VIEW- STANDARD ROOF PANELS

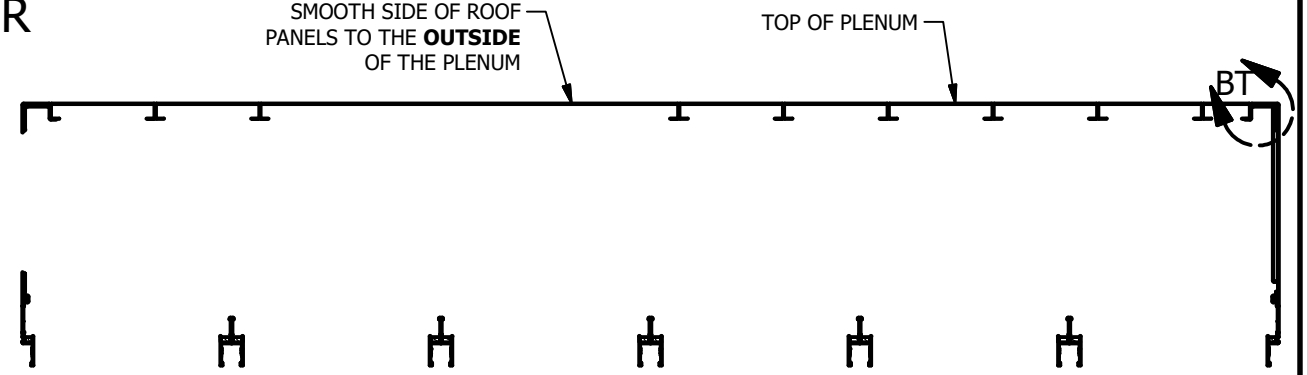


SECTION BR-BR

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958	2.6 TOP LOAD PLENUM ROOF PANEL OPTIONS STANDARD
			FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 50 OF 53

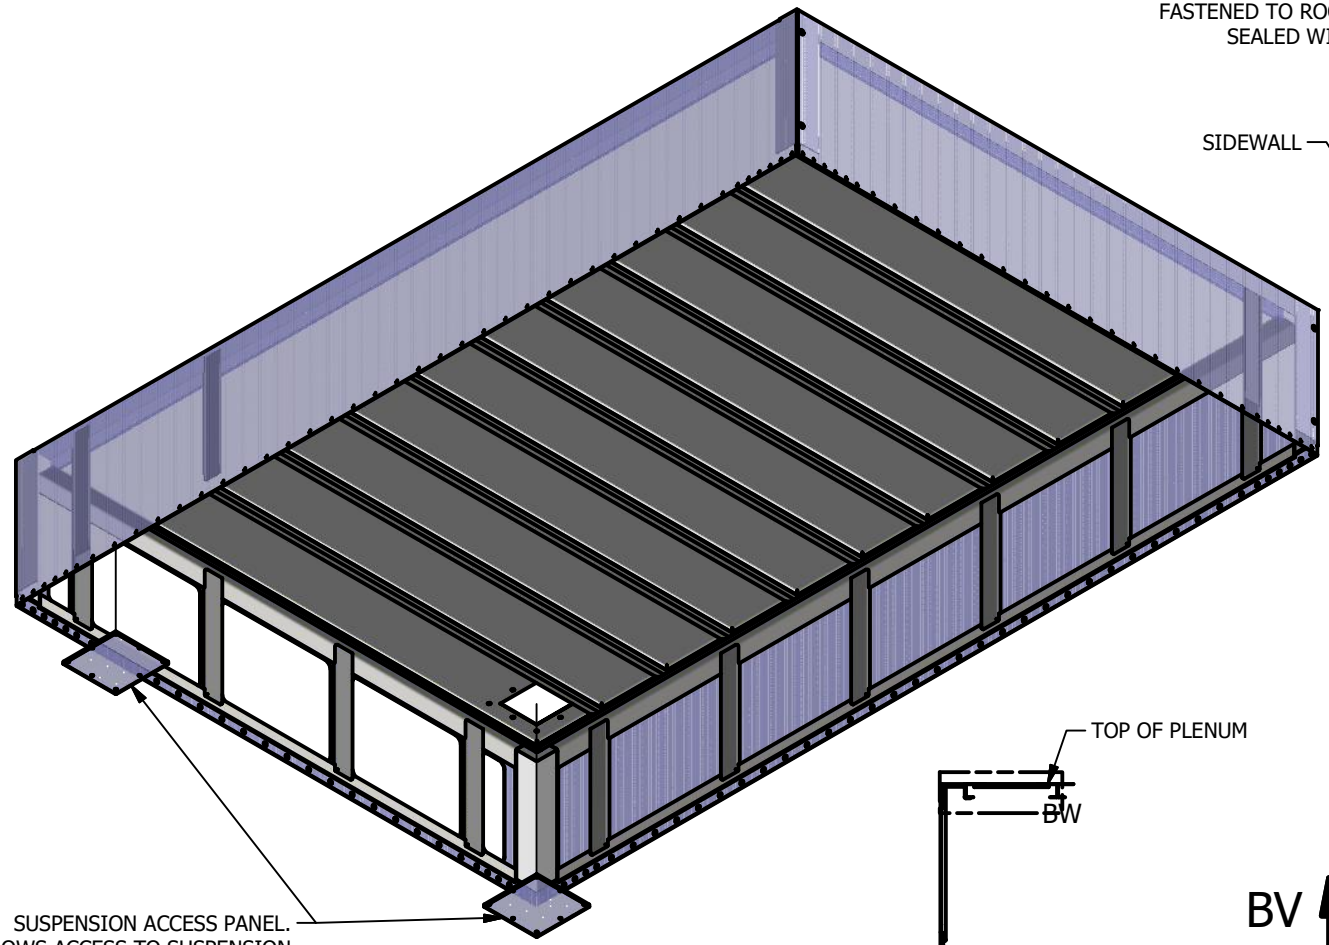


PLENUM SUSPENSION ACCESS PANELS
GRID NOT SHOWN

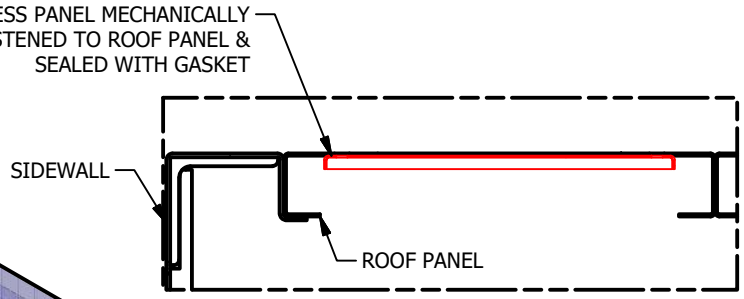


DETAIL BW
ROOM SIDE PLENUM ACCESS PANEL

SECTION BV-BV
PLENUM ELEVATION

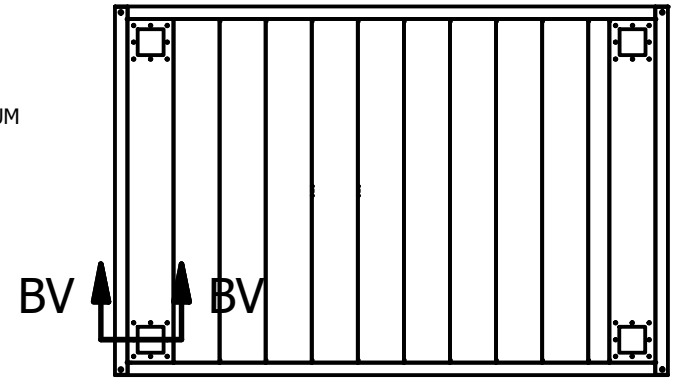


PLAN VIEW- PLENUM WITH ACCESS PANELS

TOLERANCES UNLESS OTHERWISE SPECIFIED		THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY:	3rd ANGLE PROJECTION	NORTEK CLEANROOM SOLUTIONS CLEANPAK	19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958
FRACTIONS:	±1/32		ISSUED ON: 12/6/2018		2.6 TOP LOAD PLENUM	
0.0:	±0.1		CHECKED BY:		PLENUM ACCESS PANELS ROOF ACCESS	
0.00:	±0.03			JOB NO.:		
0.000:	±0.010		PART NO.:	FILE NAME: 2.6TopLoad.idw	REV: 1	SHEET 51 OF 53
ANGLES:	±0.5°					
OTHER: SEE DOC. QMS000.01A						

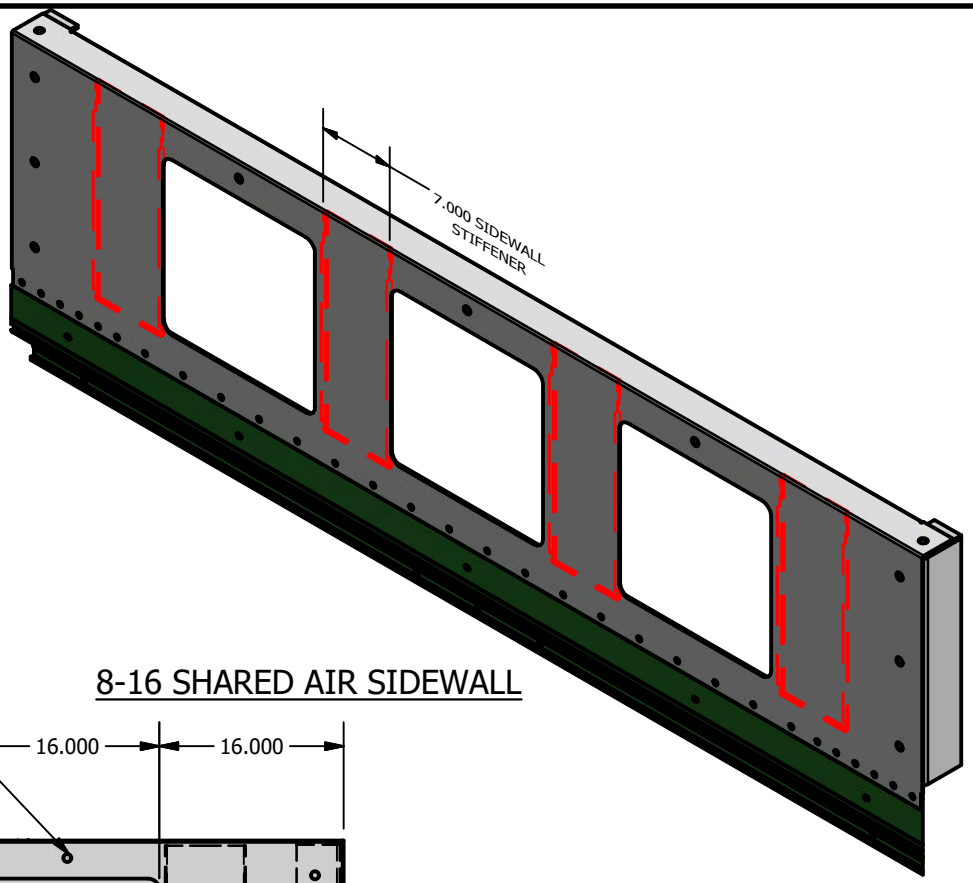

8-16 SHARED AIR SIDEWALL

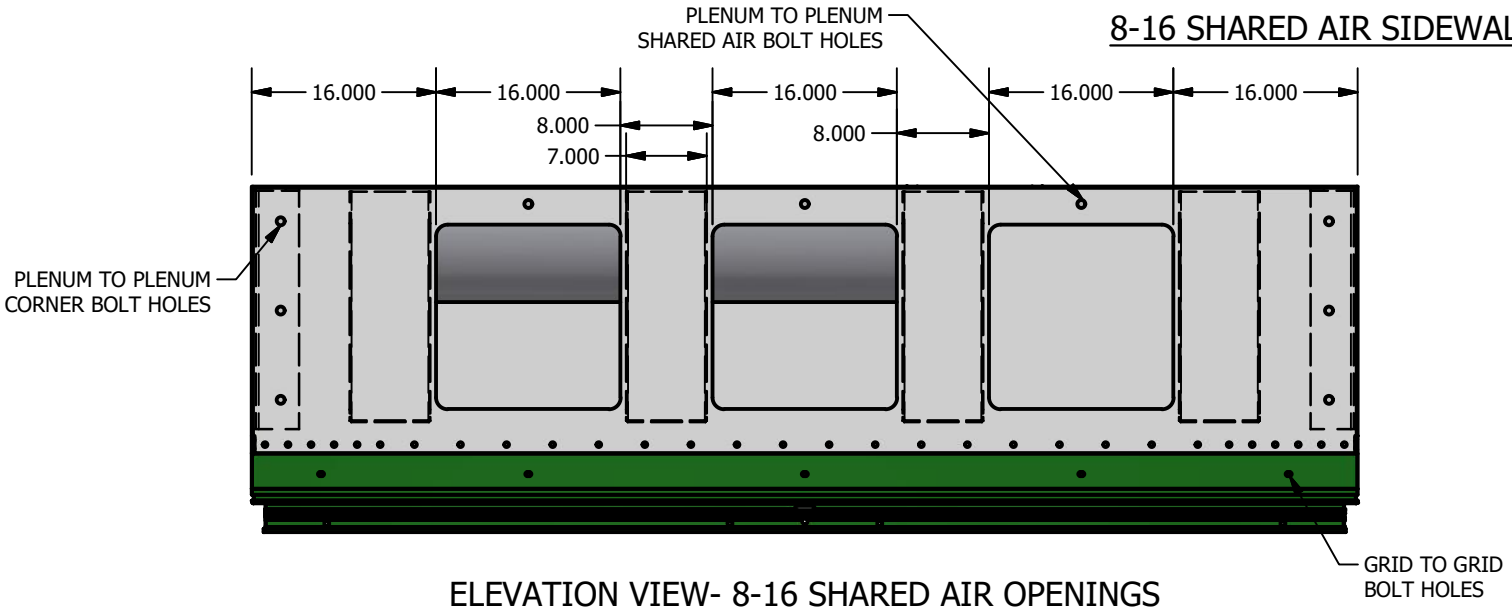


ELEVATION VIEW- 8-16 SHARED AIR OPENINGS EXTERNAL TO MODULE

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958


2.6 TOP LOAD PLENUM

PLENUM SHARED AIR OPENING OPTIONS

FILE NAME: 2.6TopLoad.idw | REV: 1 |

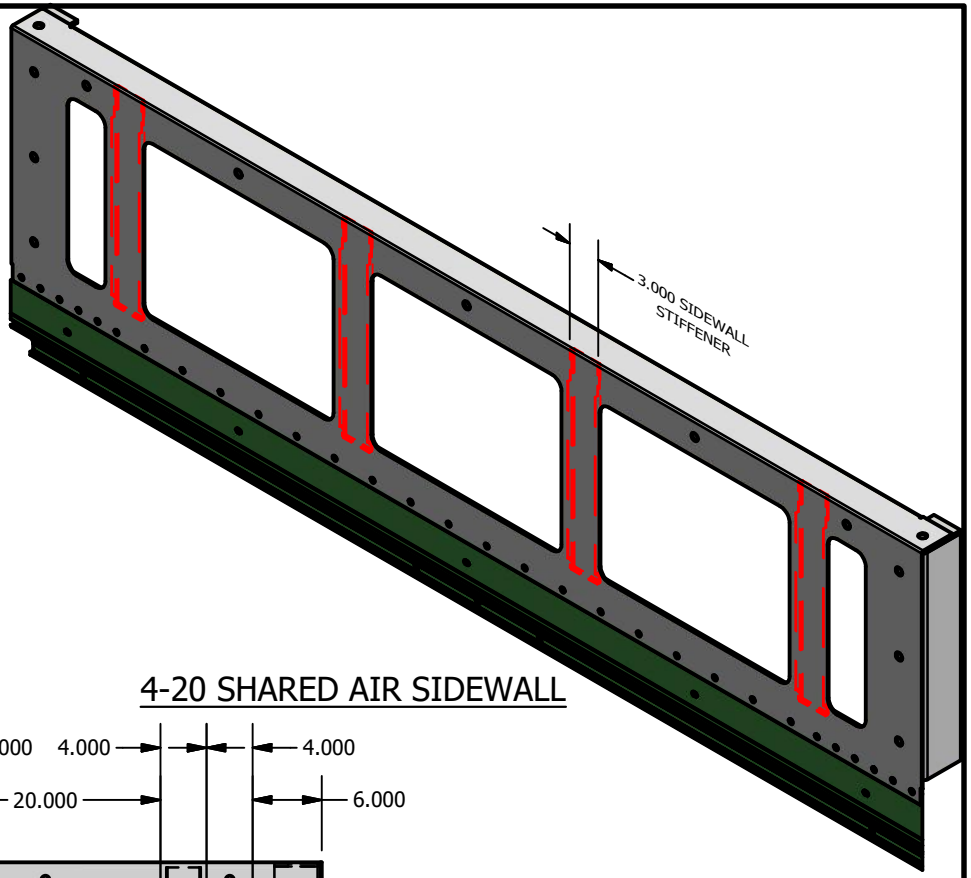

4-20 SHARED AIR SIDEWALL

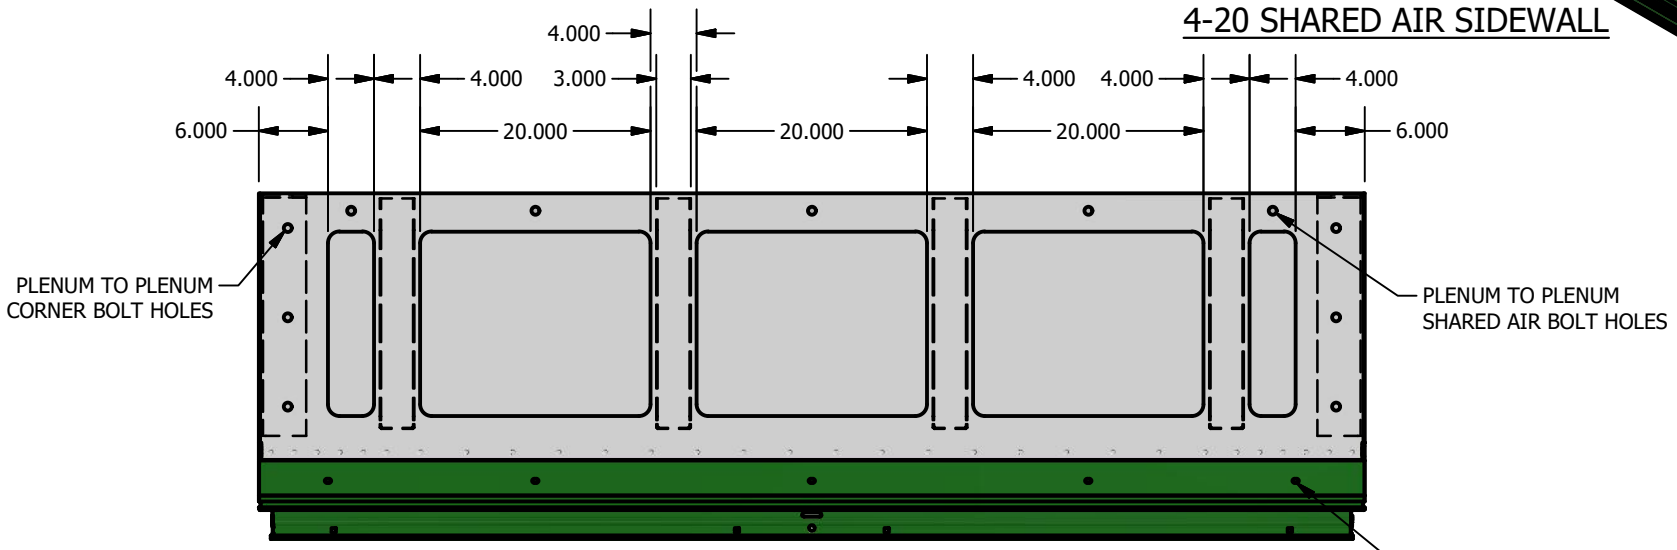

ELEVATION VIEW- 4-20 SHARED AIR OPENINGS EXTERNAL TO MODULE

TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS: ±1/32 0.0: ±0.1 0.00: ±0.03 0.000: ±0.010 ANGLES: ±0.5° OTHER: SEE DOC. QMS000.01A	THIS DRAWING IS THE PROPERTY OF NORTEK AIR SOLUTIONS CLEANPAK AND CAN NOT BE REPRODUCED IN WHOLE OR IN PART, NOR DELIVERED TO OTHERS WITHOUT THE EXPRESS WRITTEN PERMISSION OF NORTEK AIR SOLUTIONS	DRAWN BY: ISSUED ON: 12/6/2018 CHECKED BY: PART NO.:	3rd ANGLE PROJECTION JOB NO.:	NORTEK CLEANROOM SOLUTIONS CLEANPAK 19855 SW 124th AVE. TUALATIN, OR 97062 Phone (503) 639-0113 Fax (503) 692-0958

2.6 TOP LOAD PLENUM

PLENUM SHARED AIR OPENING OPTIONS

FILE NAME: 2.6TopLoad.idw | REV: 1 | SHEET 53 OF 53